


Introduction to smart grids

Beyond smart meters
July 2015

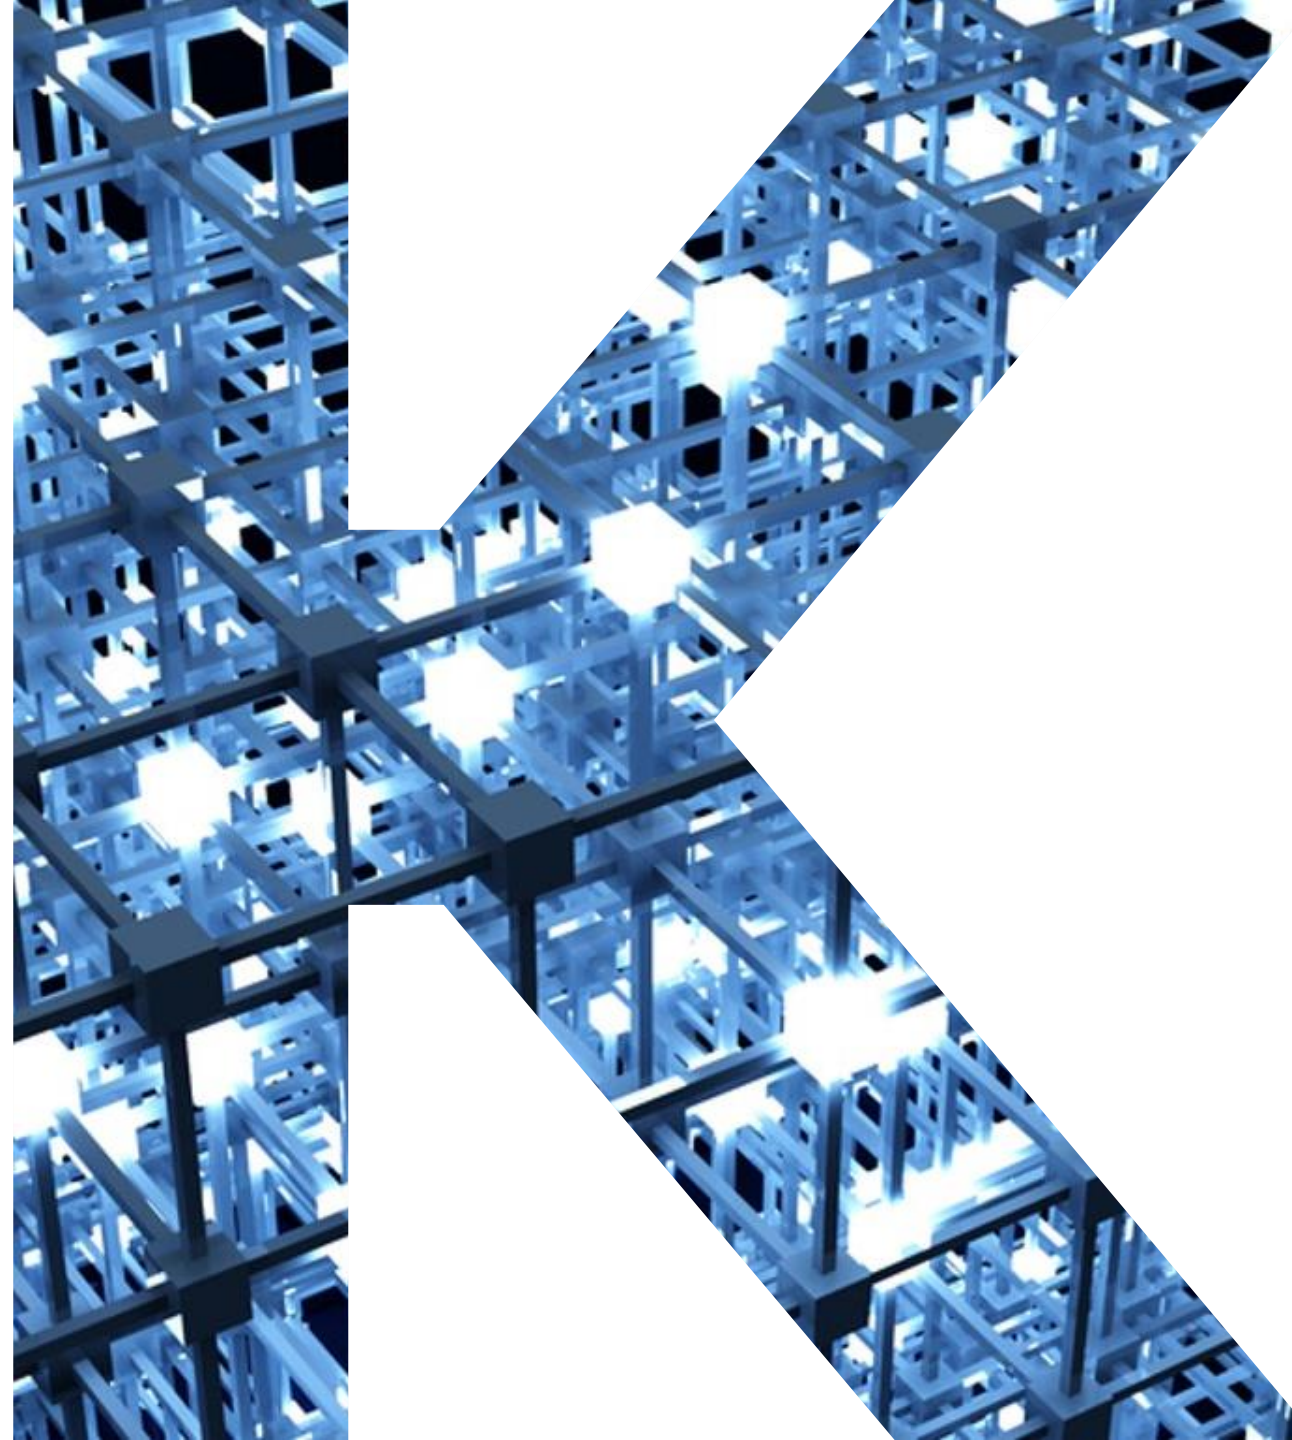

Compiled by the A.T. Kearney Energy Transition Institute

Acknowledgements

A.T. Kearney Energy Transition Institute wishes to acknowledge for their review of this FactBook: Dr. Mohamed A. El-Sayed, Professor Electrical Department at College of Engineering and Petroleum, Kuwait University; Professor Anna Creti, Université Paris Dauphine, Senior Research Fellow at Ecole Polytechnique, Visiting Research Fellow at University of California Berkeley; Jacqueline Chia, Senior Assistant Director Energy Division (Energy Market) at Ministry of Trade & Industry, Singapore. The Institute also wishes to thank the authors of this FactBook for their contribution: Bruno Lajoie, Romain Debarre, Yann Fayet and Gautier Dreyfus.

About the “Smart Grids Series”

The “Smart Grids Series” is a series of publicly available studies on smart grids conducted by the A.T. Kearney Energy Transition Institute that aim to provide a comprehensive overview of the current and future electricity landscape, and the keys to understanding its principal challenges and developments through a technological prism.

About the FactBook - Introduction to Smart Grids

This FactBook summarizes the innovations that are collectively known as smart-grid technologies. It highlights the challenges faced by traditional grid designs; identifies key smart-grid technologies and categorizes them into three main applications; assesses the net economic and environmental benefits of smart grid roll-outs; highlights the technological and financial status of smartgrid deployment; and analyzes the historical and political context in order to identify selected policies for successful adoption.


About the A.T. Kearney Energy Transition Institute

The A.T. Kearney Energy Transition Institute is a nonprofit organization. It provides leading insights on global trends in energy transition, technologies, and strategic implications for private sector businesses and public sector institutions. The Institute is dedicated to combining objective technological insights with economical perspectives to define the consequences and opportunities for decision makers in a rapidly changing energy landscape. The independence of the Institute fosters unbiased primary insights and the ability to co-create new ideas with interested sponsors and relevant stakeholders.

Electricity grids need to be modernized to meet growing demand and integrate new applications

Power grids, which bring electricity to 85% of the world's population, are arguably one of the most important engineering achievements of the 20th century. Today's grids, century-old by design, were built to accommodate centralized generators, unidirectional electricity transport through high-voltage transmission lines, dispatch to consumer via lower-voltage distribution lines, and centralized control centers collecting information from a limited number of network hubs called substations.

Simplified view of the smart grid

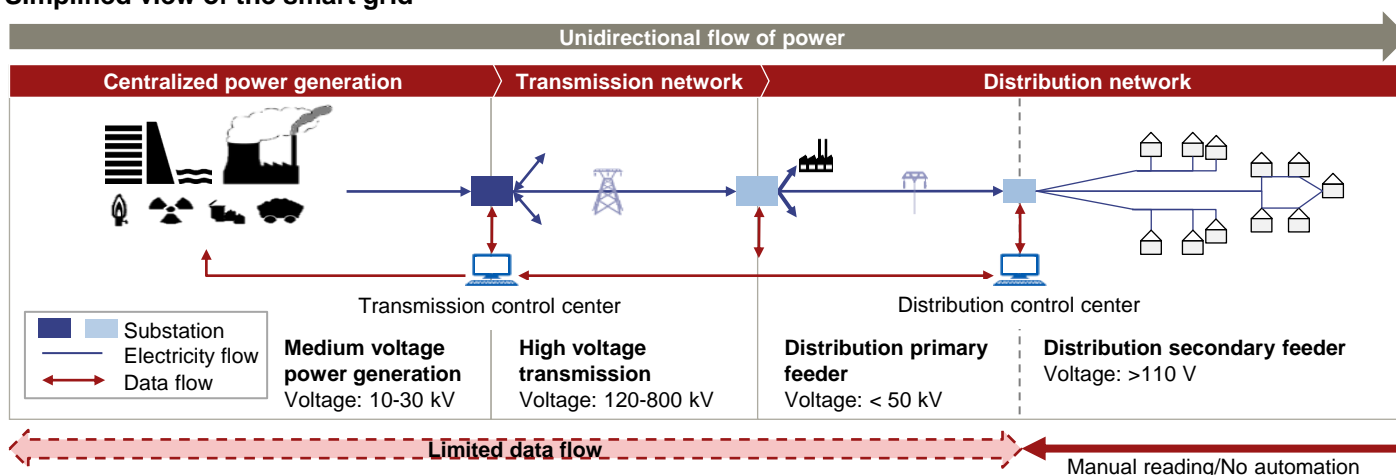


The goal of a power grid is to optimize, for a given combination of generation capacity and demand patterns, the reliability of power supply (the frequency and extent of outages), the quality of power supplied (in terms of voltage signal shape, frequency and phase angle), and its affordability.

Today's grids are facing four principal problems and these are growing in severity. First, global electricity demand is rising faster than demand for any other final energy source; in addition, the electrification of the economy intensifies end-user demand around peak hours, stressing grids and making rapid expansion a necessity. Second, aging infrastructure tends to compromise reliability of power supply and exacerbate energy losses to the detriment of economies undergoing rapid electrification. Third, as the share of Variable Renewable Energy (VRE) in the energy mix grows, the power grid will need to become more flexible to match supply and demand in real time. Finally, as the penetration of Distributed Generation (DG) rises to very high levels in some areas, issues relating to power quality and bi-directional electricity flows arise that cannot be properly managed by traditional grids.

A smart grid refers to a modernized electricity network that monitors, protects, and optimizes the operation of its interconnected elements

The notion of grid modernization differs from country to country, depending on the smartness of the existing system. However, notwithstanding such differences, smart grids are generally characterized by the use of digital information and communications technologies to manage both the bi-directional flow of data between end-users and system operators, and the bi-directional flow of power between centralized and decentralized generation.

Simplified view of the traditional grid

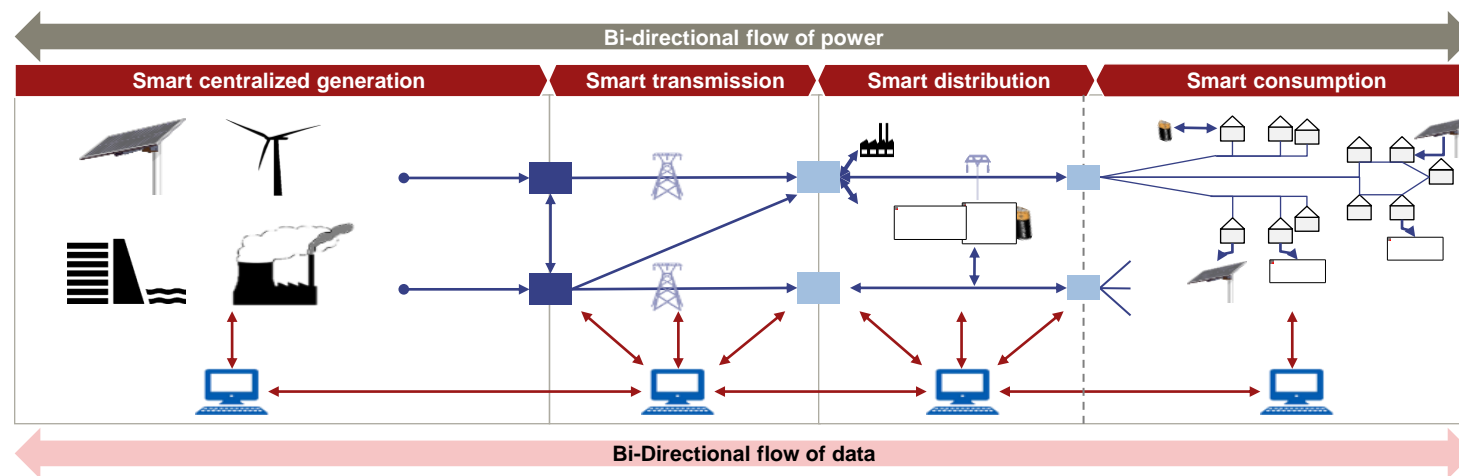

The goal of such a modernized network is to address grid challenges at a minimal cost. It should be able to accommodate all generation and storage options, optimize energy efficiency and asset utilization, improve power quality for end-user devices, self-heal, resist physical and cyber attacks, and enable new business solutions in a more open-access electricity market, such as demand-response programs and virtual power plants.

Beyond incremental changes in traditional grids, smart grids facilitate the expansion of independent micro-grids that are capable of “islanding” themselves from the main grid during power-system disruptions and blackouts. The modular nature of micro-grids may allow for their independence, interconnection and, ultimately, the construction of a new type of super-reliable grid infrastructure.

Smart-grid technologies can be segmented into three main applications for addressing grid challenges


The transition to a smart grid requires the deployment of new power infrastructure, along with various kinds of devices, such as electronic sensors and computer systems, throughout the electricity network and their interconnection via high-speed communications networks using standardized protocols. This FactBook covers the most important smart-grid technology solutions, which can only achieve their intended benefits – the three main smart-grid applications – when integrated together.

The first application involves the *optimization of grid monitoring and control*, with advanced sensors and IT solutions interconnected via modern communications networks in Wide-Area Monitoring & Control (WAMC) or Distribution Automation (DA) systems. Such systems enhance control over dispatchable power plants; improve routing of electricity flows; anticipate demand patterns or grid weaknesses by virtue of predictive algorithms and condition-based maintenance; react automatically to incidents threatening the reliability of power supply with the use of smart reclosers, which enable distribution grids to be self-healing.

The second purpose of smart grids is to *enable consumers to contribute to grid management* through the medium of intelligent end-user devices. Combining advanced metering infrastructure with smart appliances makes dynamic demand-response programs possible. These can contribute to system flexibility (in addition to peaking power plants or electricity storage) to compensate for fluctuations in VRE output or to flatten out aggregated peak loads. Bi-directional smart meters enable net metering and vehicle-to-grid programs that incentivize individual customers to become local suppliers of power and storage capacity. In addition, automated meter readings reduce the operating costs of distribution-system operators and provide greater visibility into pilferage.

The third principal aim of smart-grid technology is to *enhance the physical capacity of the network*. Ultra-high voltage lines, direct-current underground cables or superconductors transport more power with lower energy losses and a smaller visual footprint than conventional power lines. These new technologies could be especially effective in connecting remote offshore wind farms to distribution grids or interconnecting asynchronous grids. Finally, it would also be possible to adjust dynamically the maximum admissible power throughput of transmission lines by installing special temperature sensors along them. This would allow the deferral of expensive and sometimes-controversial grid-extension plans.

Key smart-grid technologies segmented by main application

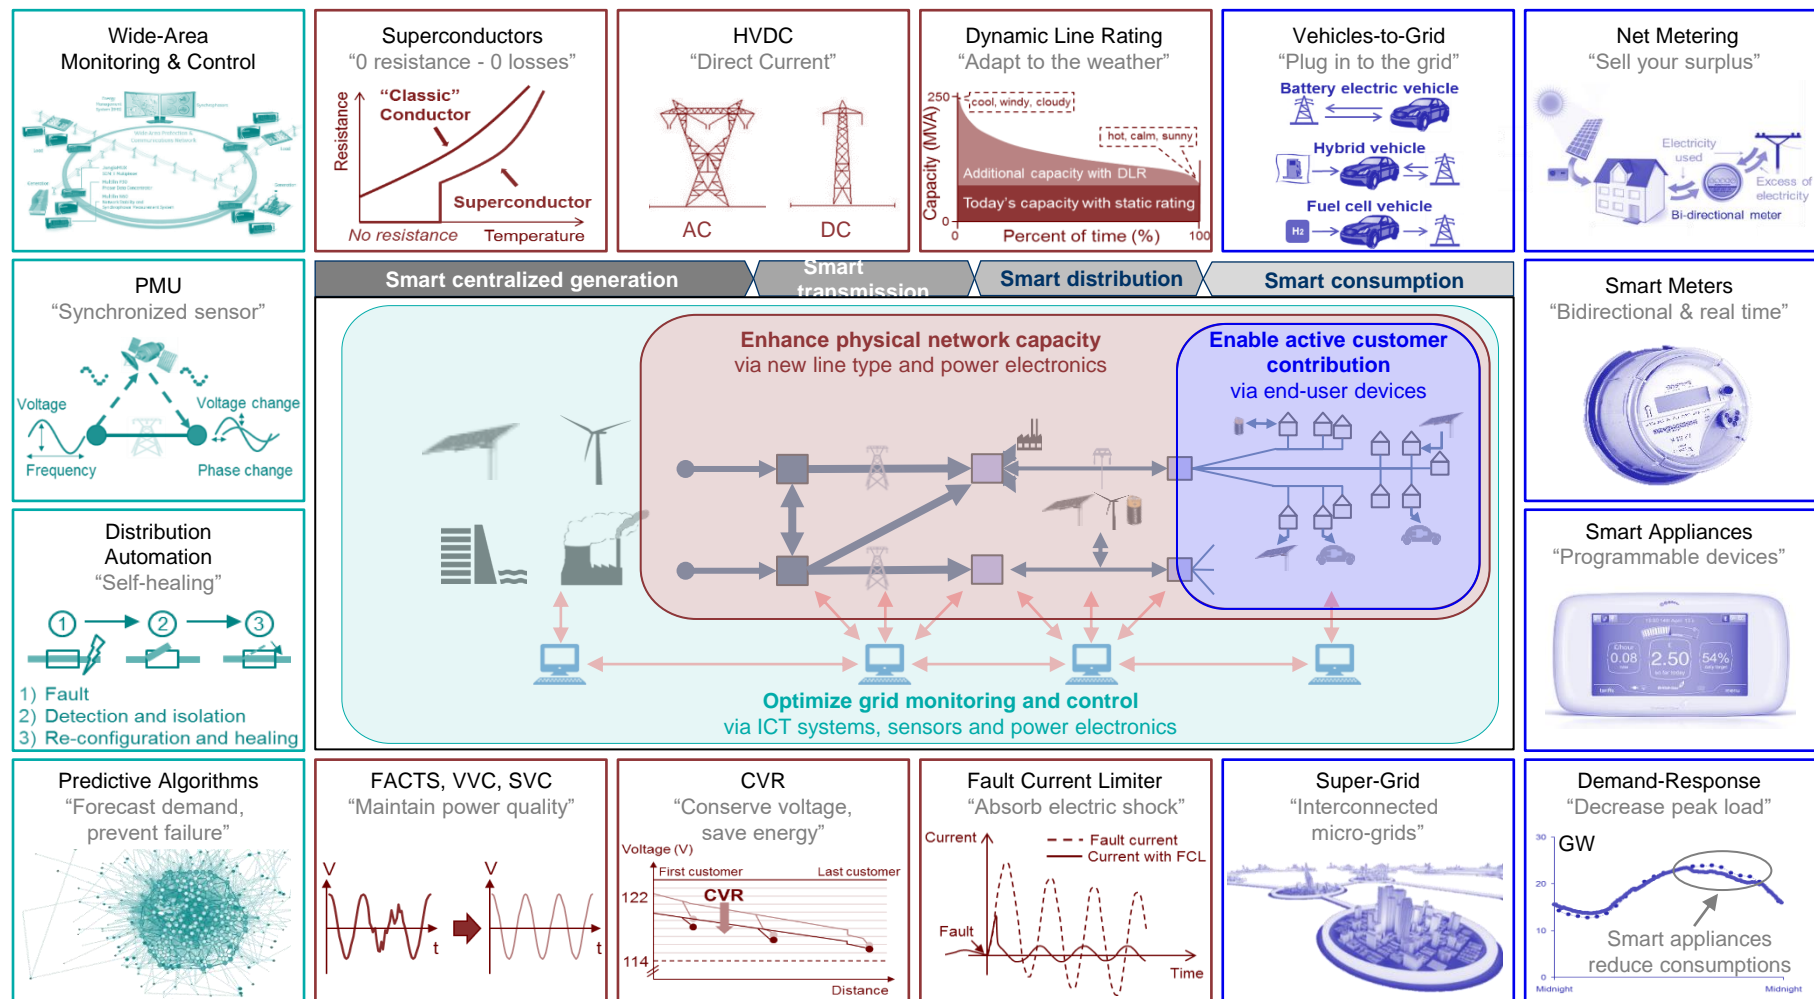

Smart grids promise numerous economic and environmental benefits, provided social acceptance and cybersecurity issues are thoroughly addressed

It is estimated that a smart-grid roll-out would generate net economic and environmental benefits in all regions where studies have taken place, although impacts are difficult to quantify. The U.S.' Electric Power Research Institute (EPRI) estimates that the benefits for U.S. society as a whole would outweigh its costs by a factor of between 2.7 and 6. Restricting the scope to electricity-grid stakeholders, the International Energy Agency (IEA) estimates the ratio to be between 2 and 4 in OECD countries, and between 3 and 4.5 in China.

Although environmental sustainability is not the primary driver behind the adoption of smart grids, they help limit greenhouse gas emissions both directly (through energy savings) and indirectly (by encouraging the development of electric vehicles and renewables). The IEA estimates that smart grids could contribute to 4% of cumulated CO2 emissions-reduction efforts until 2030 in the lowest-cost pathway towards the 2°C target.

The concept of a smart grid relies to a large extent on active consumer participation and, for this reason, requires social acceptance. As future electricity grids will collect, communicate and store operational and private data, the issues of cybersecurity, data protection and data sharing must be carefully addressed.

Smart-grid technologies are attracting investor interest, but proper regulation and collaboration in standardization and best practices are vital to successful deployment

Global annual investments in electricity grids amounted to \$218 billion in 2014 and are growing by 4% a year. Smart-grid technologies currently represent 20% of these investments (\$44 billion), or \$16 billion if the scope is restricted to digital energy technologies. Smart-grid investments are expected to grow by 5% a year until 2020, led by digital energy (9% a year), due in particular to rapid smart-meter roll-out: 100 million units were installed in 2014, and the penetration rate globally is set to increase from 22% to 40% in 2020.

In addition to technology deployment, private investors' interests in smart-grid RD&D intensified after 2008, following announcements of support from the U.S. DOE (\$4.5 billion committed), and EU (€3 billion already allocated). Although raised funds have stabilized since 2011, venture capitalists remain highly interested in digital-energy technologies, which comprise one of the most coveted clean energy investments – only just behind solar PV – in terms of numbers of deals (35) and funds raised (\$200 million) in 2014.

If smart-grid investments are mostly borne by system operators, benefits are spread among many parties (including customers and all citizens, if environmental benefits are taken into account). Yet as electricity markets evolve, with the unbundling of monopolies, the design of smart-grid business models is becoming more complex. Therefore, carefully planned regulation is required to encourage smart-grid roll-outs. Finally, standards covering interoperability, compatibility and industry best practice are among the most crucial prerequisites for smart-grid deployment, in avoiding the premature obsolescence of smart-grid devices.

Table of contents

Executive summary.....	2
1. Challenges in existing electricity grids.....	8
2. Smart-grid concepts and solutions	20
2.1 Smart-grid concepts	22
2.2 Smart-grid solutions.....	29
3. Benefits and challenges of smart-grid roll-out.....	35
3.1 Economic and environmental benefits.....	37
3.2 Social acceptance and cybersecurity.....	44
4. Status of smart-grid deployment.....	47
4.1 Private investments.....	49
4.2 Public initiatives.....	56
4.3 RD&D landscape.....	62
5. Regulation and policy.....	64
5.1 Evolution of grid regulations.....	66
5.2 Best practices.....	71
6. Appendix: Smart-grid technologies insights.....	75
6.1 Enhance physical network capacity.....	76
6.2 Optimize grid monitoring and control.....	85
6.3 Enable active customer contribution.....	93
7. Acronyms & bibliography.....	100

1. Challenges in existing electricity grids



Main findings

Challenges in existing electricity grids

- Sometime century-old by design, existing grids face four main challenges globally:
 - **Electricity demand is rising** faster than any other final-energy source (2% per year until 2040), and intensifying around peak times because of the progressive shift in consumption from steady industrial baseload to variable household and commercial demand. As a result, networks are being both reinforced to increase existing capacity, and extended to reach larger customer bases;
 - **Existing grid infrastructure is aging**, because of very long return-on-investment cycles. In the U.S., the aging transmission network is causing a decline in power reliability. In some developing economies, such as India, theft and technical losses in inadequate distribution networks result in 20% of transmitted electricity being lost. The global financial impact of such grid issues is growing, as economies are ever-more reliant on electricity;
 - **As wind and solar capacity increase**, the penetration of Variable Renewable Energy (VRE) in some regions is reaching levels that are creating difficulties in the balancing of supply and demand at a reasonable cost;
 - **Distributed Generation (DG)** annual capacity addition is set to double in the next 10 years. Yet, in most cases so far, distributed capacity is either off-grid or merely connected to the grid, but not properly integrated into grid operation. As a result, bi-directional electricity flows and power-quality issues arise where the penetration of DG becomes critically high.
- In response to these challenges, investments in electricity grids are increasing by 4% a year globally, a growing share of which is directed towards smart-grid technologies (20% in 2014).
- Overall, the goal of a power grid is to co-optimize, for a given set of generation capacity and demand patterns:
 - **Power reliability** (frequency and extent of outages);
 - **Power quality** (voltage signal shape, frequency and phase angle); and
 - **Power affordability** for consumers.

Electricity networks will face four main challenges in the coming decades

Four main challenges for the electricity networks

1

Rising and intensifying electricity demand

- Rising demand in developing economies requires rapid extension of grid capacity
- Intensifying demand around peak hours puts specific strains on the grid



2

Aging grid infrastructure

- Electricity losses (from inefficiencies or theft) are a growing weight on the economy of developing countries
- Aging infrastructure increasingly raises concerns about power reliability (blackouts), an issue that also affects some developed Western countries



3

Increasing share of Variable Renewables (VRE)

- Increasing need for flexibility sources to compensate for variability of supply
- Long distance between offshore wind farms and main demand centers



4

Increasing share of Distributed Generation (DG) & electric vehicles


- Potential power-quality issue and backflow of electricity into the transmission grid
- Uncontrolled charging or discharging of electric vehicles needs to be anticipated




Electricity-demand growth is outpacing that of all other final energy carriers, and will be increasingly supplied by variable renewables (VRE)

1 Rising demand

Global final¹ energy consumption by type of energy carrier

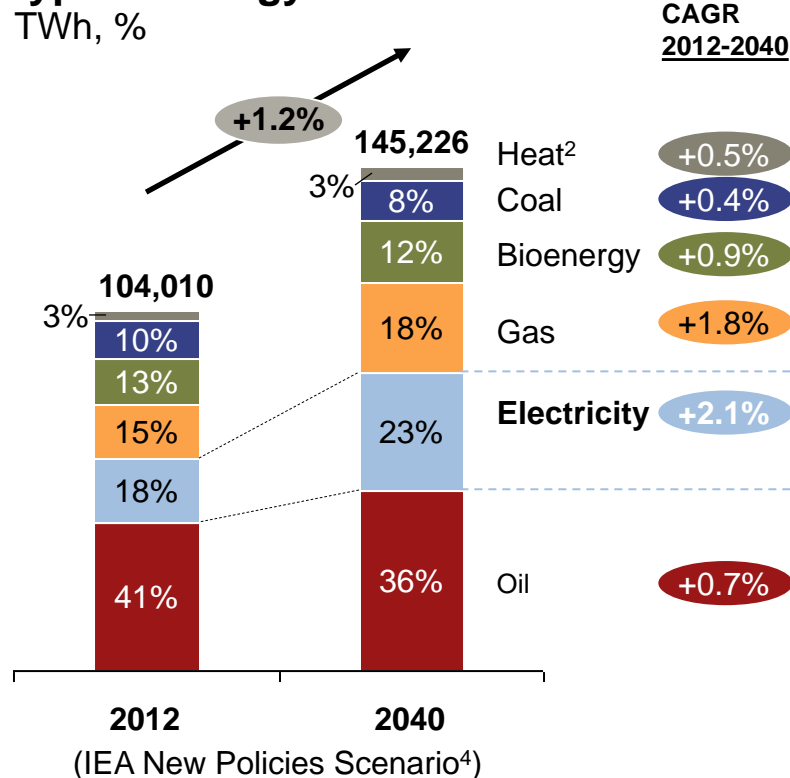

Global Electricity Production¹ By Primary Energy Source

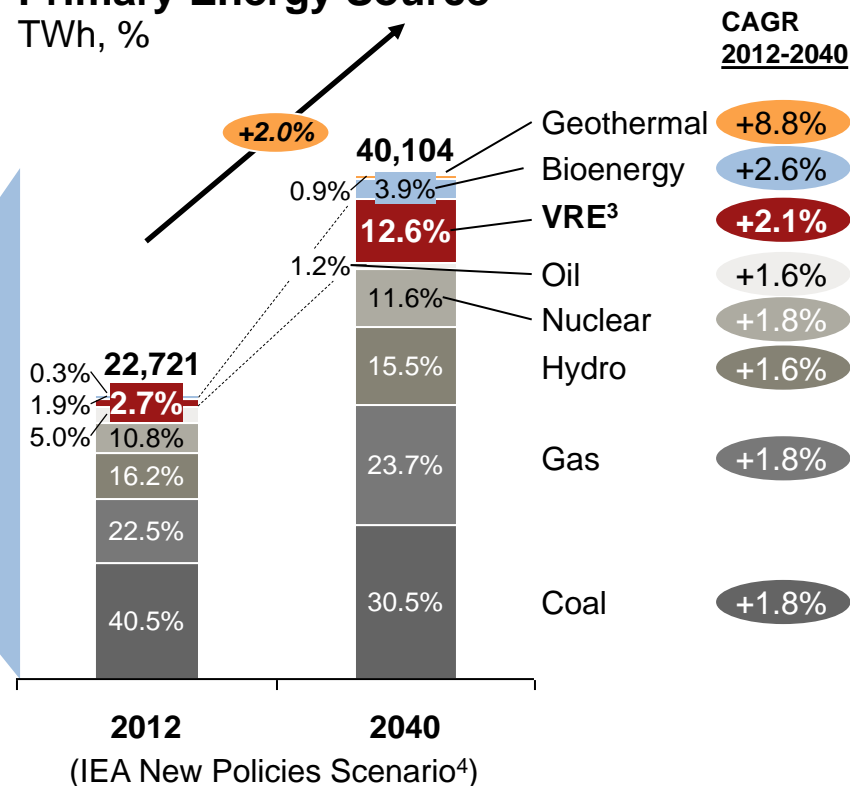


1. Final consumption exclude all production and transport losses. Discrepancy between electricity consumption and electricity production is due to electricity T&D losses 2 Direct heat from electricity co-generation, solar thermal, or geothermal; 3 VRE: Marine, CSP, Solar PV and Wind; 4 The New Policies Scenario is IEA's best case forecast given enacted and proposed government policies as of 2014.

Source: IEA (2014), "World Energy Outlook 2014"

Electricity networks are being extended around the world to reach larger customer bases and isolated power sources

1 Rising demand


Length of global transmission networks Thousands km

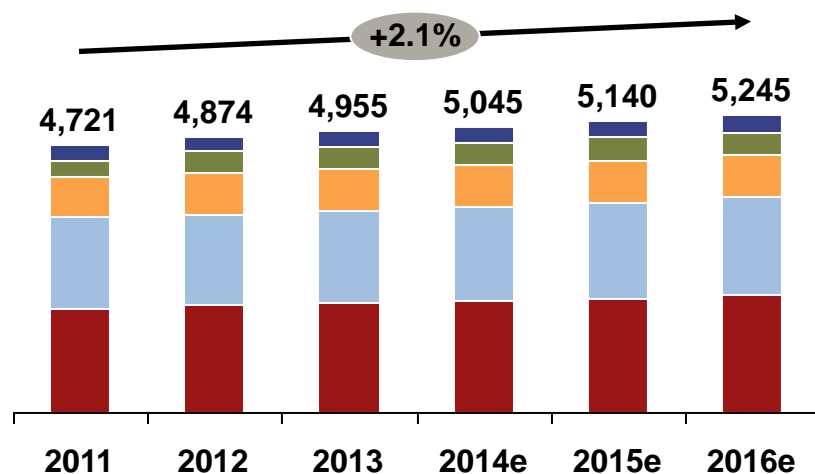

- Transmission lines are being extended by 2.1% per year globally, with most growth occurring in Asia (+2.5%), to meet growth in electricity demand.
- Distribution lines – more than 10 times longer than transmission lines – are also being added to a rate of 1.3% a year, especially in Africa, to reach an increasingly dispersed customer base.

■ Africa ■ S. America ■ Europe ■ N. America ■ Asia

German Transmission-enhancement plan

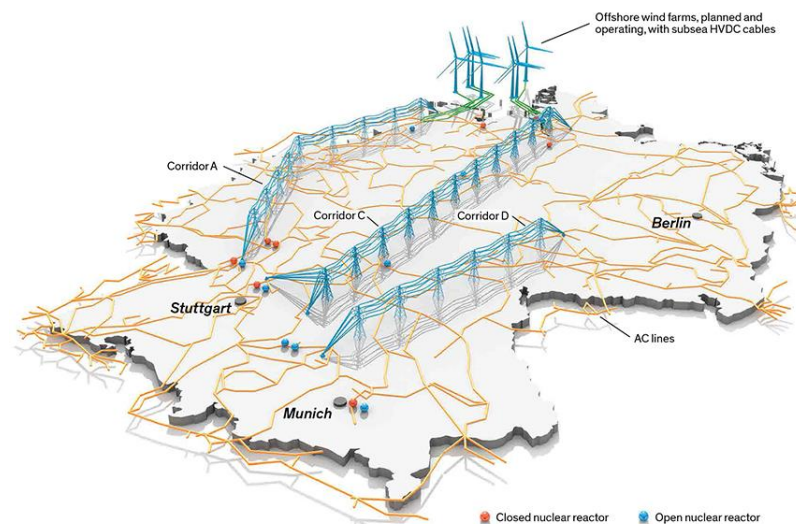


- In developed economies, grid extensions are being undertaken to improve interconnections between power grids and connect remote renewable power plants.
- In Germany, for instance, a €10 billion transmission-enhancement project is already under way to ship power from northern wind turbines to the south, which used to be more reliant on nuclear energy (picture above).

As developing economies reach an increasingly scattered customer base, the economic impact of electricity losses is worsening

Annual Electricity consumption per capita and Electricity T&D losses in 2011

2 Aging grid

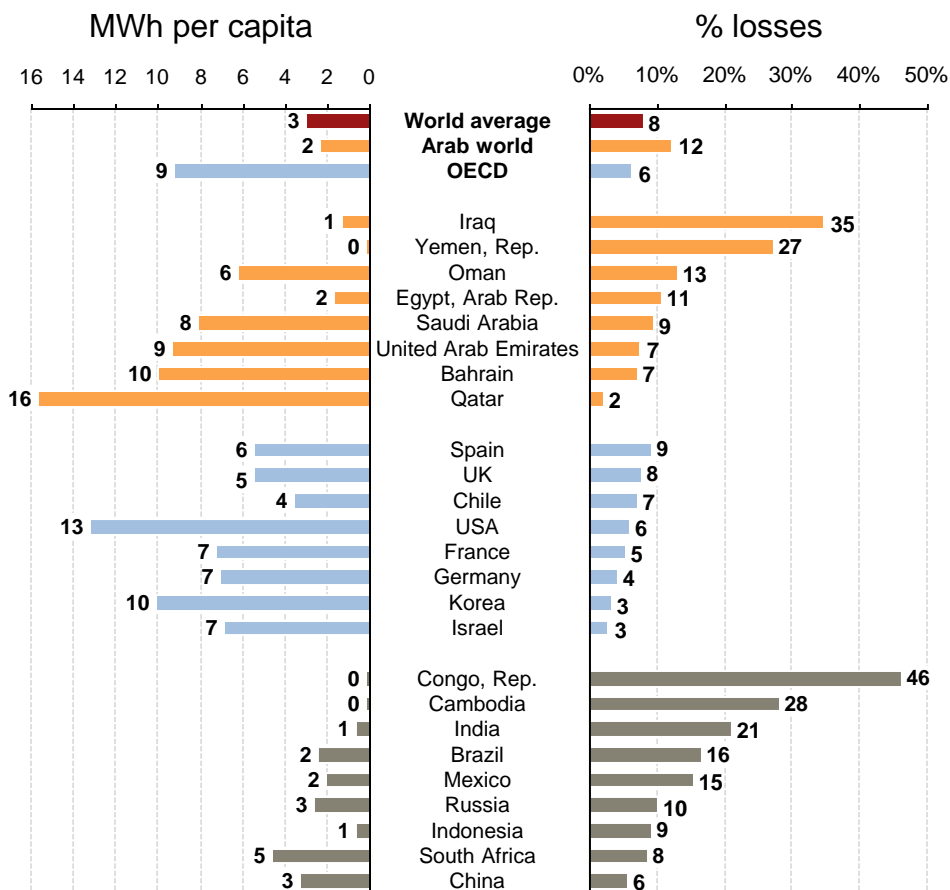


- Transmission and Distribution (T&D) losses average 8% globally, but vary extensively around the globe, largely falling in the 3-20% range, but reaching up to 50% in some regions.
- Globally, about 75% of T&D losses occur in distribution grids. This is the result of technical factors (lower voltage and longer length) and theft (mostly in developing economies):
- In India alone, about two-thirds of T&D losses are non-technical. In some regions, up to half of the electricity put into the grid is stolen. While only accounting for 4% of global electricity demand, India accounts for 18% of global revenue losses from theft – estimated at \$90 billion annually²;
- By comparison, in developed economies, non-technical losses are estimated to be below 1% of all losses incurred.
- As networks expand to reach larger and more widely dispersed customer bases in developing economies, losses are expected to continue to increase.
- Overall, the inefficiency of dilapidated or underdeveloped T&D systems incur economic losses that have an impact far beyond the power industry. These economic losses are often under-estimated.

Aging transmission infrastructure in some Western economies poses a growing threat to reliability of power supply

U.S. August 2003 blackout

NASA satellite image

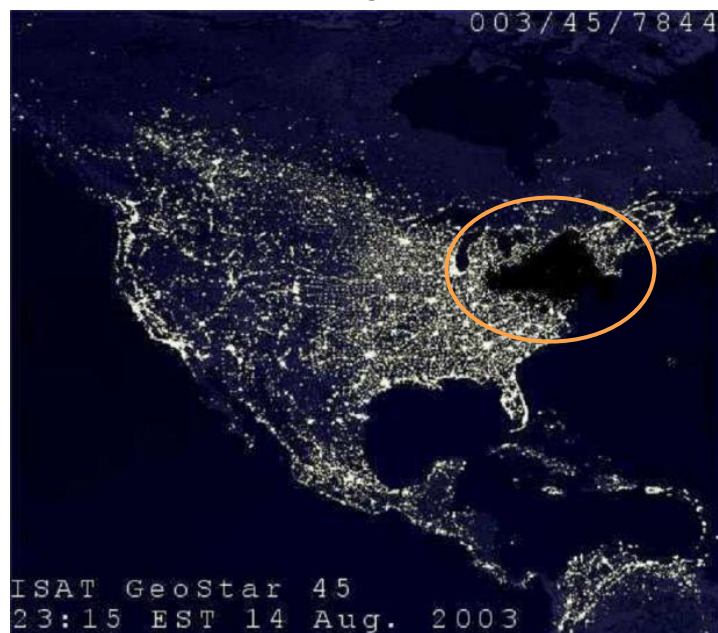


2 Aging grid

- **Power reliability measures power outages**, also called “blackouts”
 - The three most common reliability indexes focus on the frequency (F) or duration (D) of blackouts, from the point of view of the grid system (S) or for a random customer (C): SAIDI (System Average Interruption Duration Index), CAIDI and CAIFI.
- **Power reliability is declining in some Western economies**, particularly in the U.S., where blackouts are causing significant economic disruption
 - According to U.S. federal data, blackouts are costing at least \$150 billion each year (\$500 per person). Grid blackouts are approximately three times more frequent today than in 1981, and last between 92 and 214 minutes per year, depending on the state, compared with four minutes per year in Japan.
- If the direct causes of blackouts are weather, mechanical failure or human-related (attacks, mistakes), **the main root cause in the U.S. is aging power infrastructure**
 - “The power grid, which could be considered the largest machine on Earth, was built after World War II from designs dating back to Thomas Edison, using technology that primarily dates back to the '60s and '70s” (IBT, July 17 2014).
- **An aging grids is poorly adapted to:**
 - Extreme weather events, such as storms and floods;
 - Intensifying demand: growth in U.S. peak demand for electricity since 1982 has exceeded transmission-capacity growth by almost 25% a year.

The fundamental requirement of an electricity system is to ensure real-time balancing between supply and demand, at a minimal cost

Electrical Power generated and consumed in France (December 7, 2014) GW

3 Variable renewables

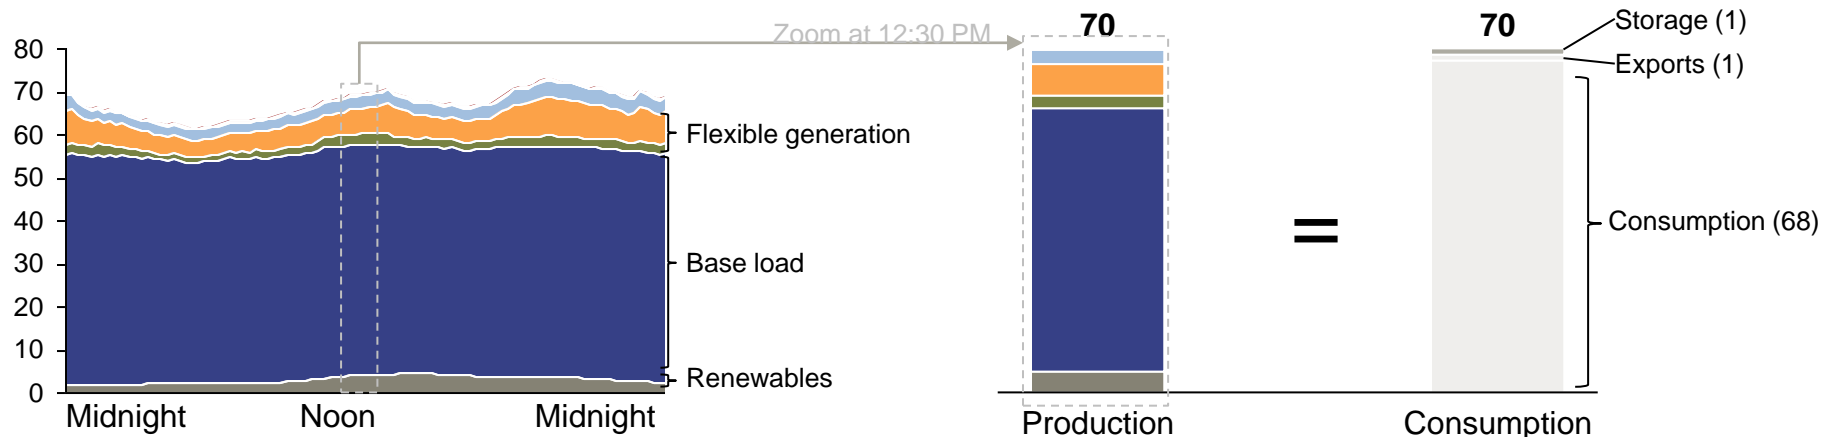

- As a just-in-time process, electrical consumption must be balanced with adequate production at all time.
- Each power-generation source has a different degree of **flexibility**, which expresses “the extent to which a power system can modify electricity production or consumption to variability, expected or otherwise” (IEA).
- However, economic considerations mean it is necessary to prioritize the use of production capacity by order of increasing operating costs (**merit order**):
 1. VRE have virtually no operating costs and almost always supply 100% of the electricity they are generating at any given moment to the grid;
 2. Baseload power plants (e.g. nuclear, coal) are highly inflexible, and usually produce the majority of electricity at low operating cost;
 3. More flexible power sources (e.g. gas turbines, hydro) are used to balance electricity supply when required;
 4. In addition to flexibility of supply, storage (usually expensive) and imports/exports (not always available) can be called upon.

Oil Gas Hydro Coal Nuclear Renewables


As the penetration of variable renewables (VRE) increases, additional flexibility sources will be needed to compensate for their unreliability

3 Variable renewables

Wind and solar PV output example

MW

Regional transmission grid operated by 50Hertz in Germany

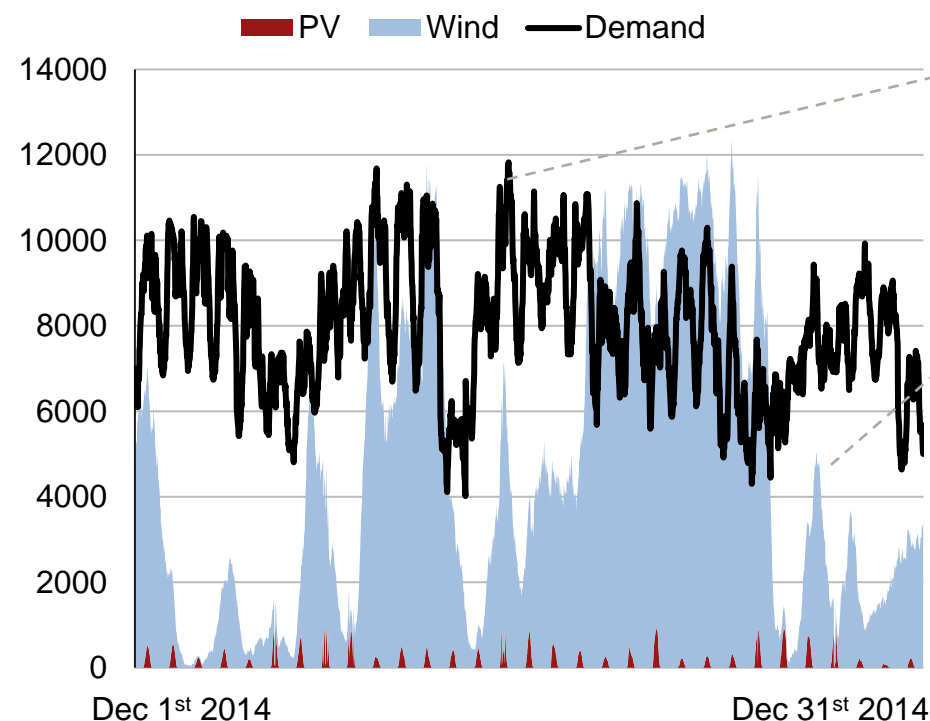


Concept of flexibility management


Flexibility Needs



Flexibility Sources

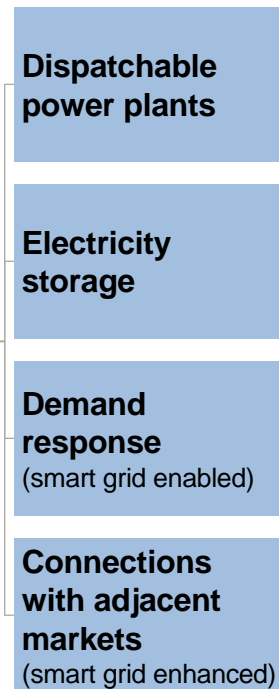




Links

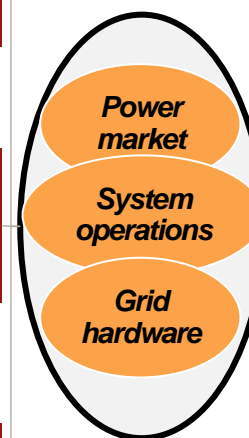

The other requirement of an electricity network is to ensure power quality is adapted to each consumer

Illustrative AC signal perturbations

4 Distributed generation

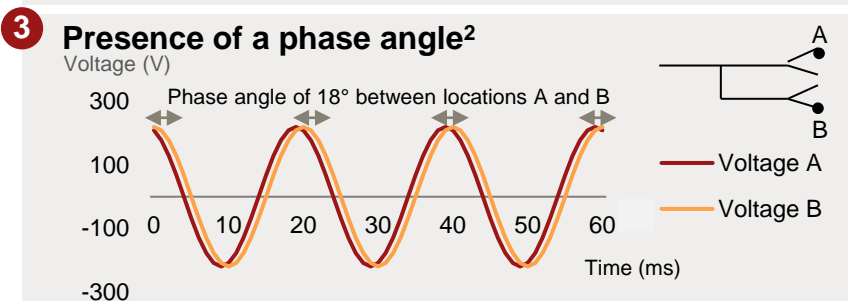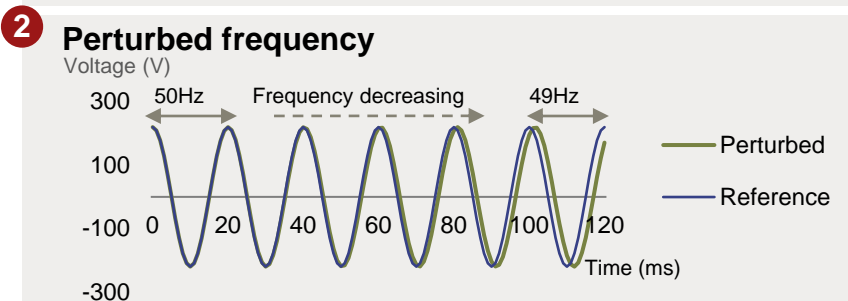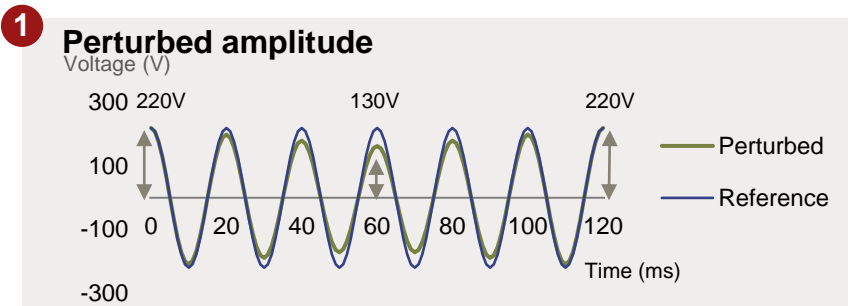

- **Power quality measures small disturbances in the voltage signal¹** (unlike power reliability, which measures complete loss of signal).
- Ideally, in a synchronous AC grid, a voltage signal consists of a pure sinusoid waveform that has:
 1. **Constant amplitude** over time, which depends on location (e.g. 220V for domestic appliances, more for industrial customers...);
 2. **Fixed frequency** throughout the whole grid (e.g. 50 Hz in Europe);
 3. **No phase angle²** between locations.
- Deviations from these conditions may cause inefficiencies in end-user devices, which are generally optimized for a nominal voltage signal².
 - Small deviations from nominal voltage are unavoidable but provide insightful operating data: a local drop in voltage indicates oversupply in the vicinity; the frequency of the whole grid decreases when total load exceeds total supply; and a phase angle appears when one part of the grid is undersupplied compared with another;
 - Larger deviations can lead to power failure and black-outs.
- Power quality must therefore be monitored and controlled dynamically to ensure both energy efficiency and power reliability.


- Not all customers require the same power quality:
The higher the power quality requested, the higher the price charged

1. Refer to appendix 6.1 slide 84 for details on voltage control; 2 The phase angle measures, between -180° and 180°, the difference in synchronization of two sinusoidal signals measured simultaneously at two locations in the grid. At 0°, signals peak or cancel at the same time. At ±180°, they are symmetrically opposite.
Source: A.T. Kearney Energy Transition Institute analysis

A high level of Distributed Generation (DG) may result in power-quality issues that cannot be properly managed by traditional grids

Danish power-plants infrastructure

4 Distributed generation

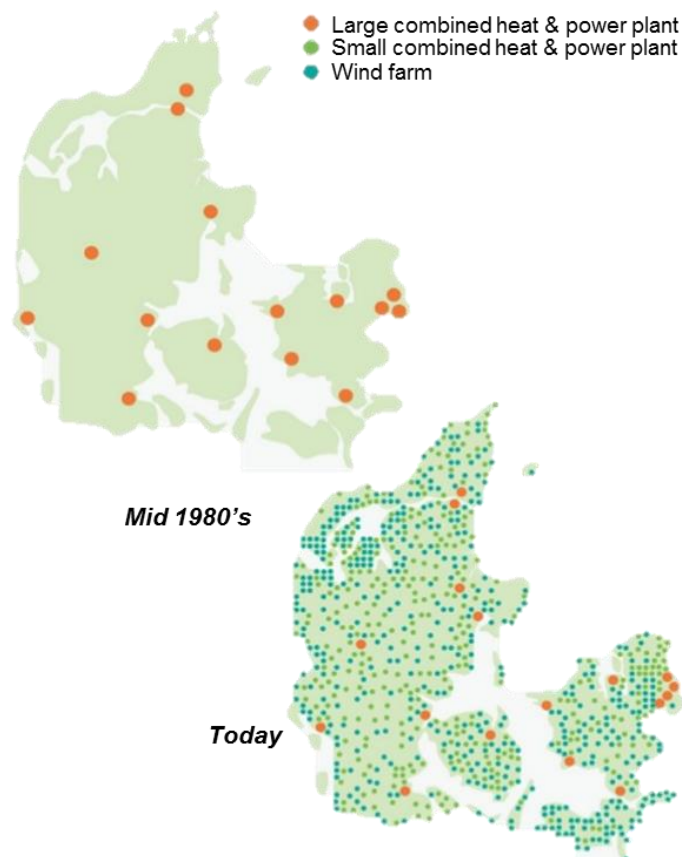


- Distributed Generation (DG) refers to small-scale generators (<10 MW) connected directly to the distribution grid, such as rooftop solar PV, individual wind turbines, diesel engines, small biomass power plants etc...
- **The rise of DG is one of the most important trends in the power industry¹**, historically led by Denmark (see image, left).
- At low levels of penetration, DG – on aggregate – simply reduces the load at individual distribution substations, which can contribute to improved power quality.
- **At high levels of penetration, however, grid-connected DG poses power-quality issues that need to be anticipated:**
- Aggregated supply can exceed the load at the substation level, causing power flow from the substation into the transmission grid, which were traditionally not designed to handle such reverse flows;
- Locally, high-voltage swings can occur, which are detrimental to end-user equipment;
- Regionally, non-rotating generators are not contributing to the stabilization of grid frequency;
- In case of temporary islanding from the grid, the micro-grid must be re-synchronized to the distribution grid before being reconnected.
- As in the case of DG, electric vehicles discharging into the distribution grid (V2G) could have a stabilizing as well as a destabilizing impact. This depends on the performance of the distribution-management system (see Appendix 6.3 slide 100)

1. Global annual additions of DG capacity is set to double between 2014 (87 GW/year) and 2023 (165 GW/year) [Navigant research].

Power-grid investments are rising, with a growing share of investment directed towards smart-grid technologies

Annual investments in Electricity networks globally

(2012-2016)

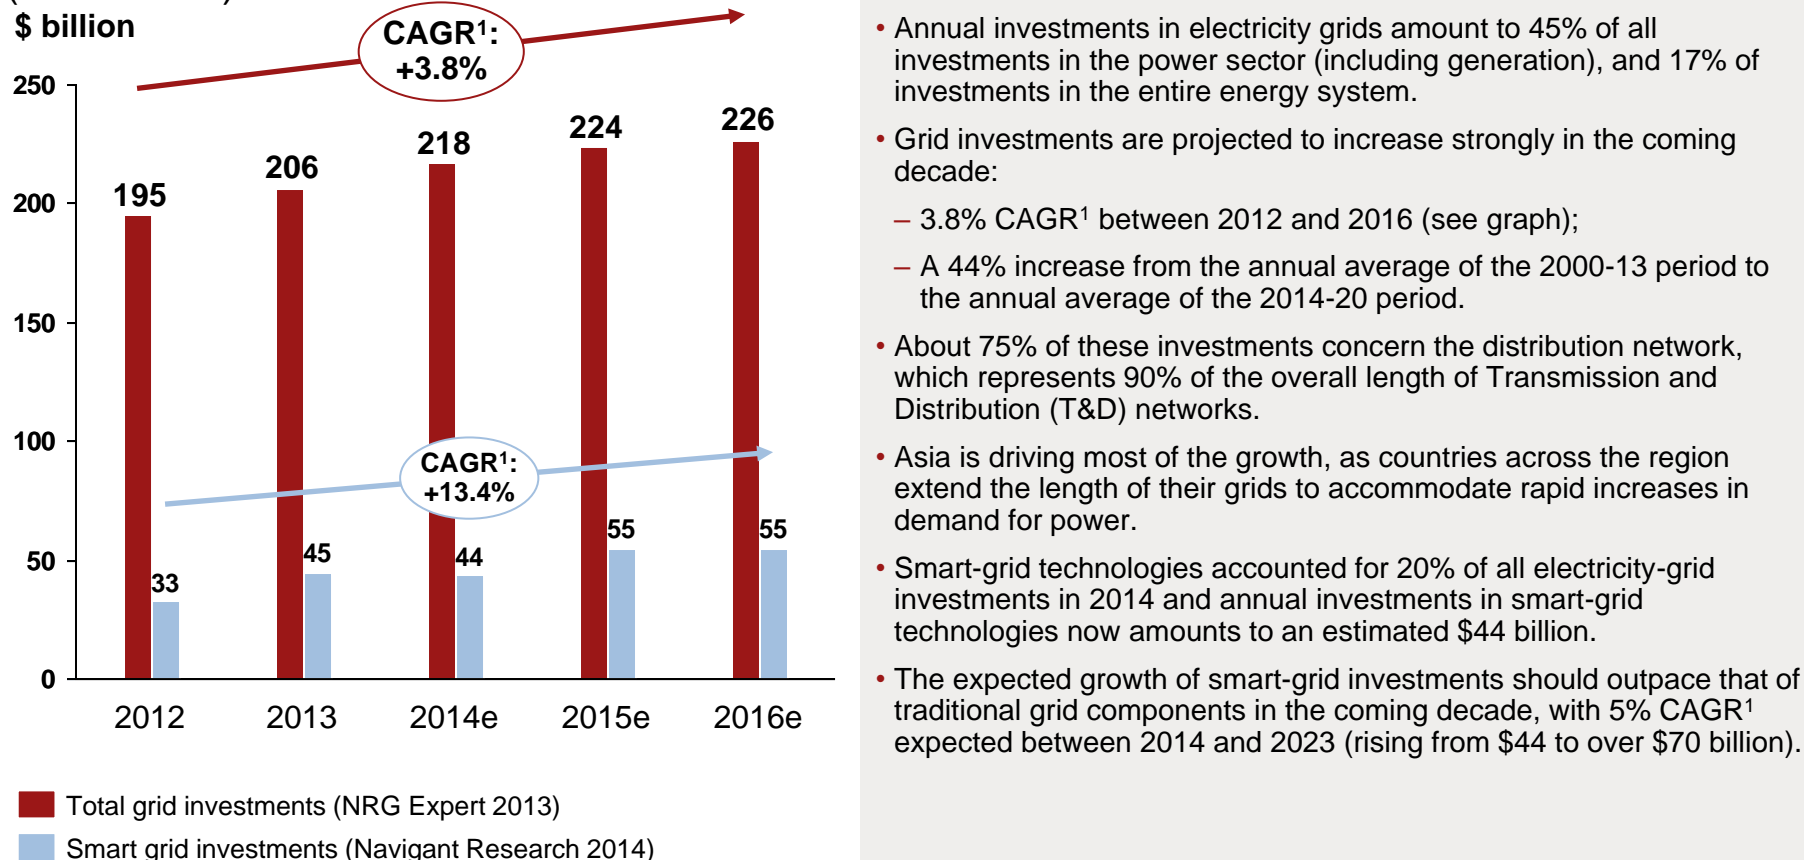

Strictly speaking, smart grid investments should be a share of total grid investments. However, figures come from two different sources, which may have slightly different scope and classification; 1 CAGR: Compound annual growth rate

Source: NRG Expert (2013), "Electricity T&D White Paper" for T&D Investments; Navigant Research (2013), "Executive Summary, Smart Grid Technologies, Global Market Analysis and Forecasts" for Smart Grid Investments; IEA (2014), "World Energy Investment Outlook"; Navigant Research (2014), "Executive Summary: Smart Grid Technologies"

2. Smart-grid concepts and solutions



Main findings

2.1 Smart grid concepts

- A traditional electricity grid is characterized by centralized power generation, a high-voltage transmission network and a low-voltage distribution network.
- The development of variable renewables, distributed generation and storage require the reconfiguring of grid architecture and control systems into smarter arrangements.
- A smart grid is a modernized electricity network that monitors, protects, and optimizes the operation of its interconnected elements. The transition to a smart grid may require the construction of new power infrastructure, along with the deployment of various kinds of devices, such as electronic sensors and computer systems, throughout the electricity network and their interconnection via high-speed communications networks using standardized protocols. This FactBook covers 20 of the most important technology solutions (detailed descriptions are in the Appendix).


2.2 Smart grid solutions

- Smart grids have three main applications:
 1. They enable active consumer contribution to grid management by virtue of end-user technologies. This is a particularly effective way to accommodate the rising share of variable and distributed generation (net metering, demand response, smart meters);
 2. They enhance the physical capacity of networks with new types of cable and power electronics that increase maximal line throughput and minimize transport losses (High Voltage Direct Current, Dynamic Line Rating);
 3. They optimize the monitoring and control of electricity flows, improving power quality and reliability within the existing grid (Wide-Area Monitoring & Control (WAMC) and Distribution Automation (DA) technologies).
- These applications address existing grid challenges, but are most effective when integrated altogether.
- Looking further ahead, the modular nature of micro-grids allows for their interconnection and, ultimately, the construction of a “super grid” on which “smart cities” function.

A smart grid is a modernized electricity network that monitors, protects, and optimizes the operation of its interconnected elements

Traditional Grid

Main characteristics of traditional grids

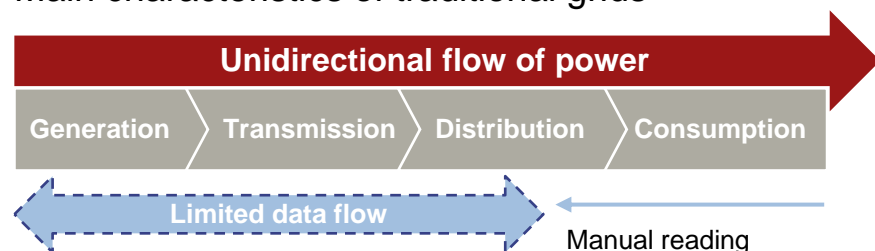


- **Manages the unidirectional flow of power**, from centralized power generation to end users.
- **Requires that electricity be consumed as it is produced** (lacking the ability to store electricity).
- **Lacks monitoring tools**, precluding the tracking of short-term consumption trends and making utilities unable to react quickly to supply outages.

Area	Traditional grid	Smart grid
Communication	Electromechanical	Digital
	One-way	Two-way
Power	Centralized	Centralized and distributed
Monitoring and control	Few sensors	Sensors throughout
	Manual monitoring	Self-monitoring
	Manual restoration	Self-healing
	Failures and blackouts	Adaptive and islanding
	Limited control	Pervasive control
Market	Few customer choices	Many customer choices

Smart Grid


Main characteristics of smart grid

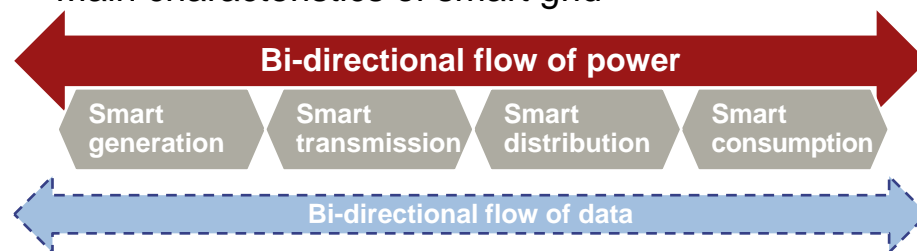

- **Accommodates all generation and storage options**, with a simplified interconnection process ("plug-and-play").
- **Enables active consumer participation**: Access to up-to-date information on electricity usage and pricing influences purchasing behavior.
- **Enables new business solutions in a more open-access electricity market**, such as demand-response programs, virtual power plants, or storage capacities allocated optimally via market forces.
- **Optimizes costs**: Operates efficiently through condition-based maintenance and maximizes asset utilization with advanced routing and operation algorithms.
- **Provides power quality for 21st century needs**, as reflected by strengthened standards for end-user electronic devices ever-more sensitive to power quality.
- **Self-heals**: Continuous self-assessments to detect, analyze, respond to, and restore grid components or network sections.
- **Resists attacks**: Reduces physical and cyber vulnerabilities, from natural as well as human causes.

A traditional electricity grid is characterized by a centralized generation delivering a large and controllable electricity flow through transmission and distribution networks

Simplified view of the traditional grid

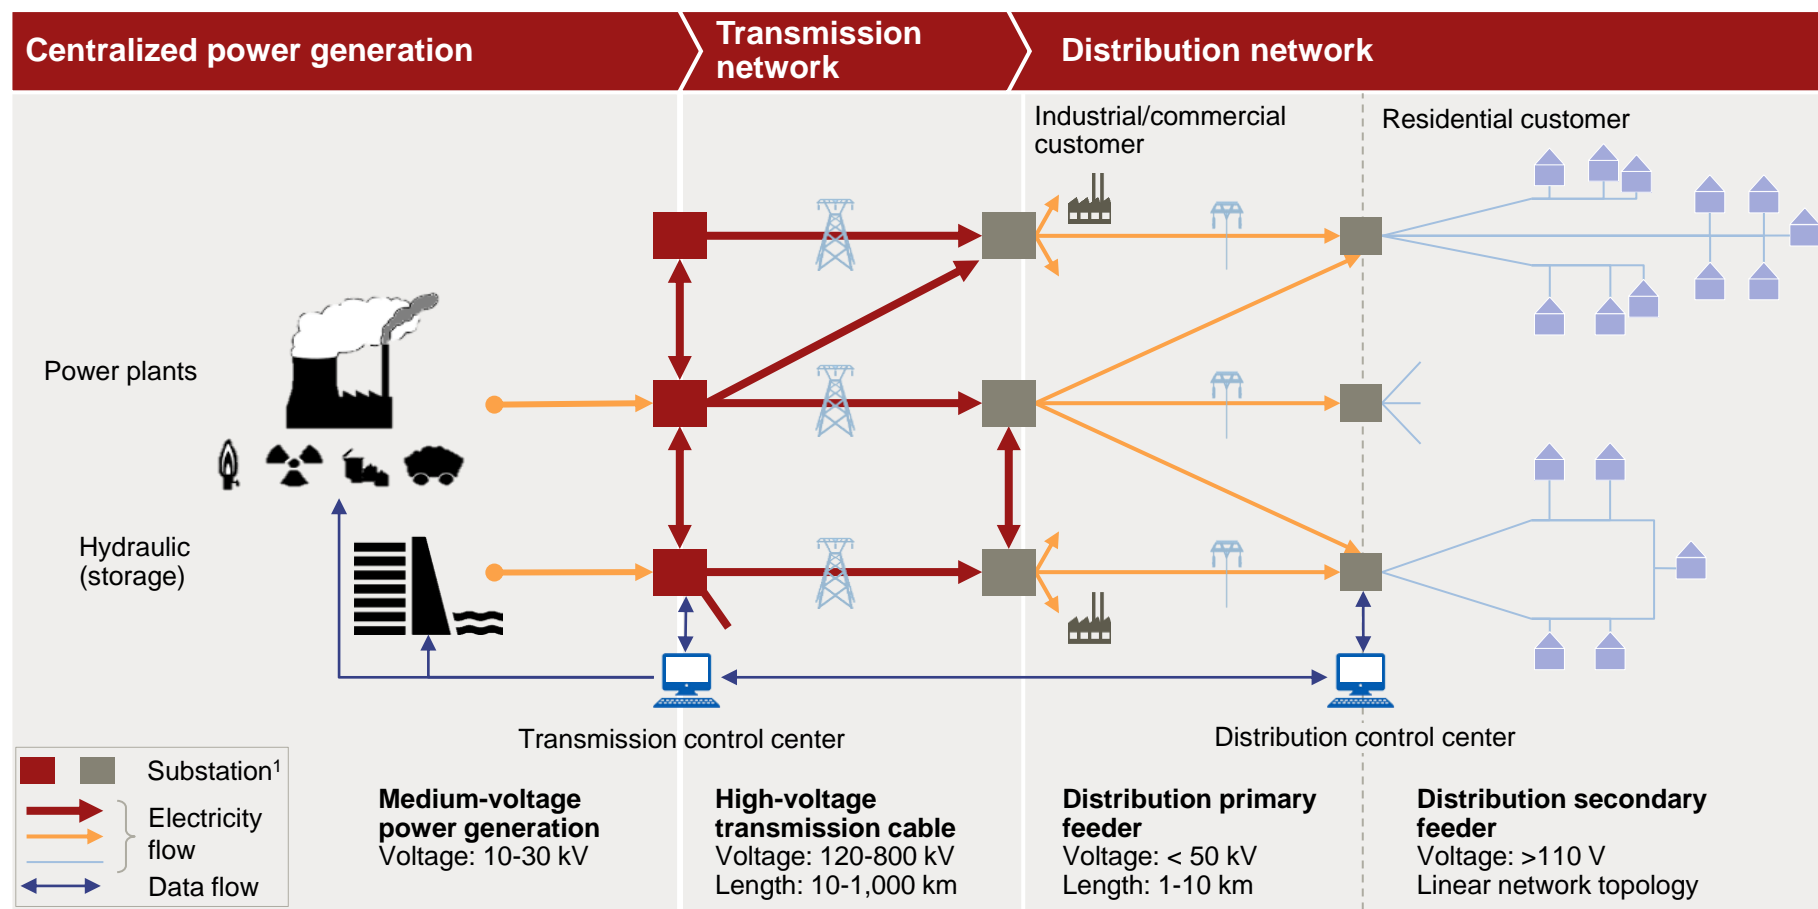


1. Substations are composed of different devices. Principally, transformers to step up or down voltage, switches (fuses, breakers, reclosers) that open or close to re-route electricity flows or activate capacitors or inductors, and sensors to measure voltage, current, frequency, power.

Source: A.T. Kearney Energy Transition Institute analysis

The introduction of renewables and distributed capacity requires the modernization of the grid such that it can handle variable and bidirectional electricity flows

Simplified view of the traditional grid with local sources of supply and storage

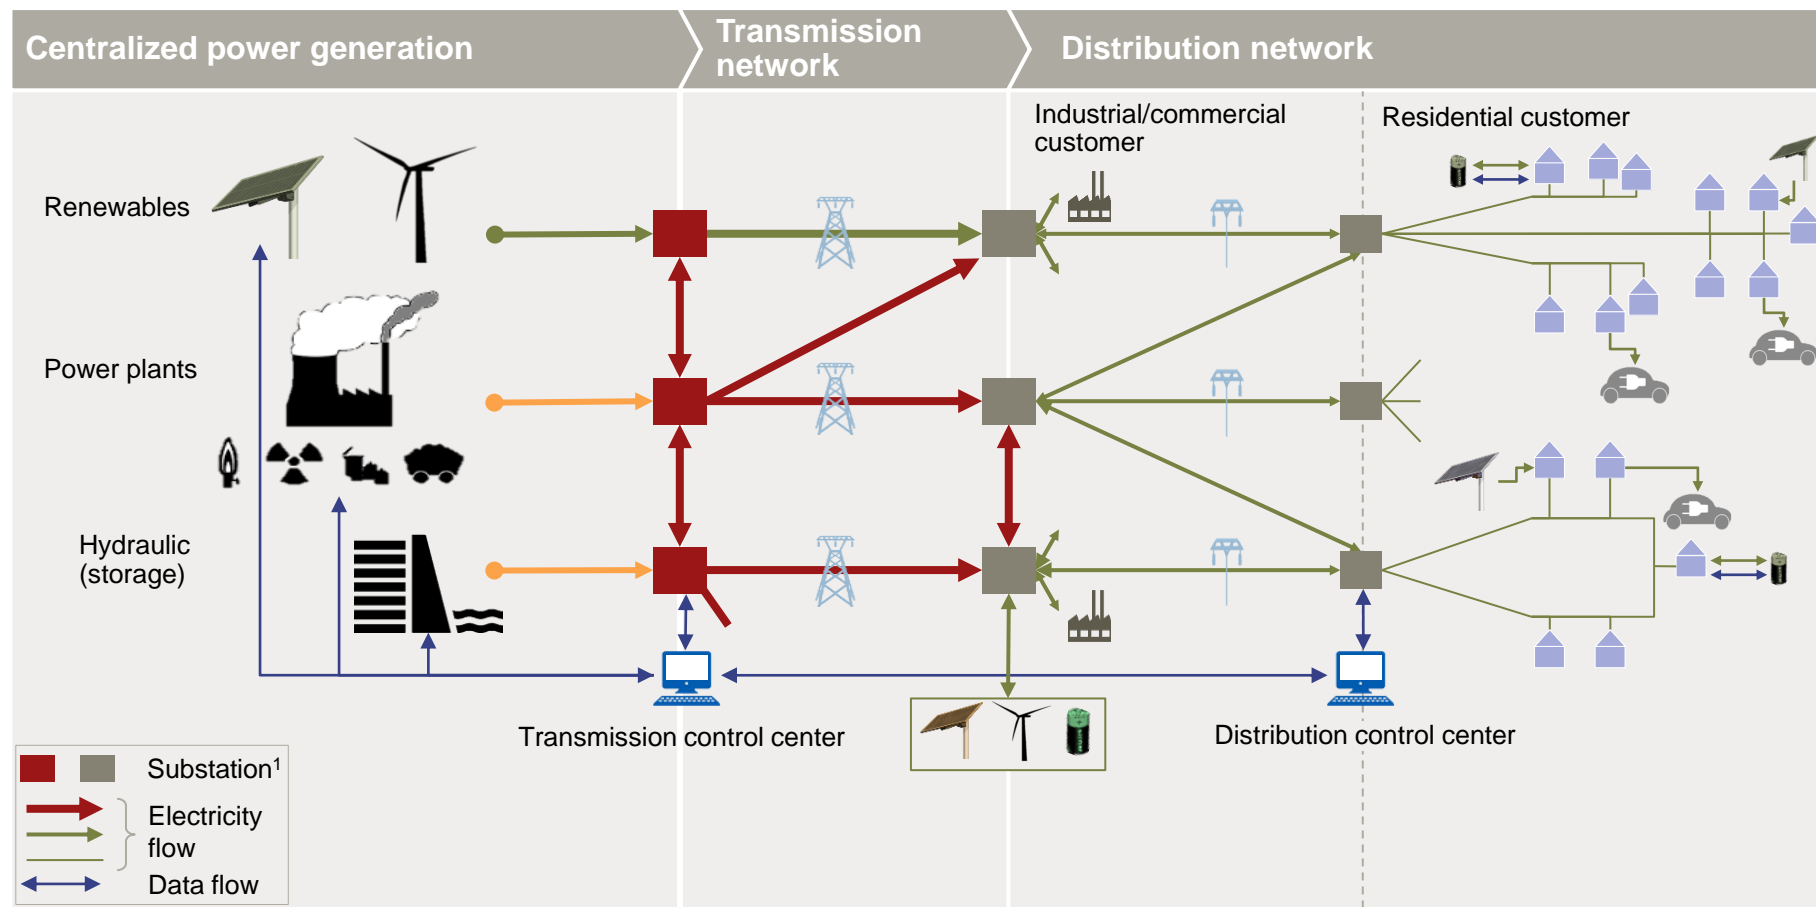


1. Substations are composed of different devices. Principally, transformers to step up or down voltage, switches (fuses, breakers, reclosers) that open or close to re-route electricity flows or activate capacitors or inductors, and sensors to measure voltage, current, frequency, power.

Source: A.T. Kearney Energy Transition Institute analysis

Smart Grids have three main applications: enabling active consumer contribution, enhancing physical networks, and optimizing grid monitoring and control

Three main applications of the Smart Grid

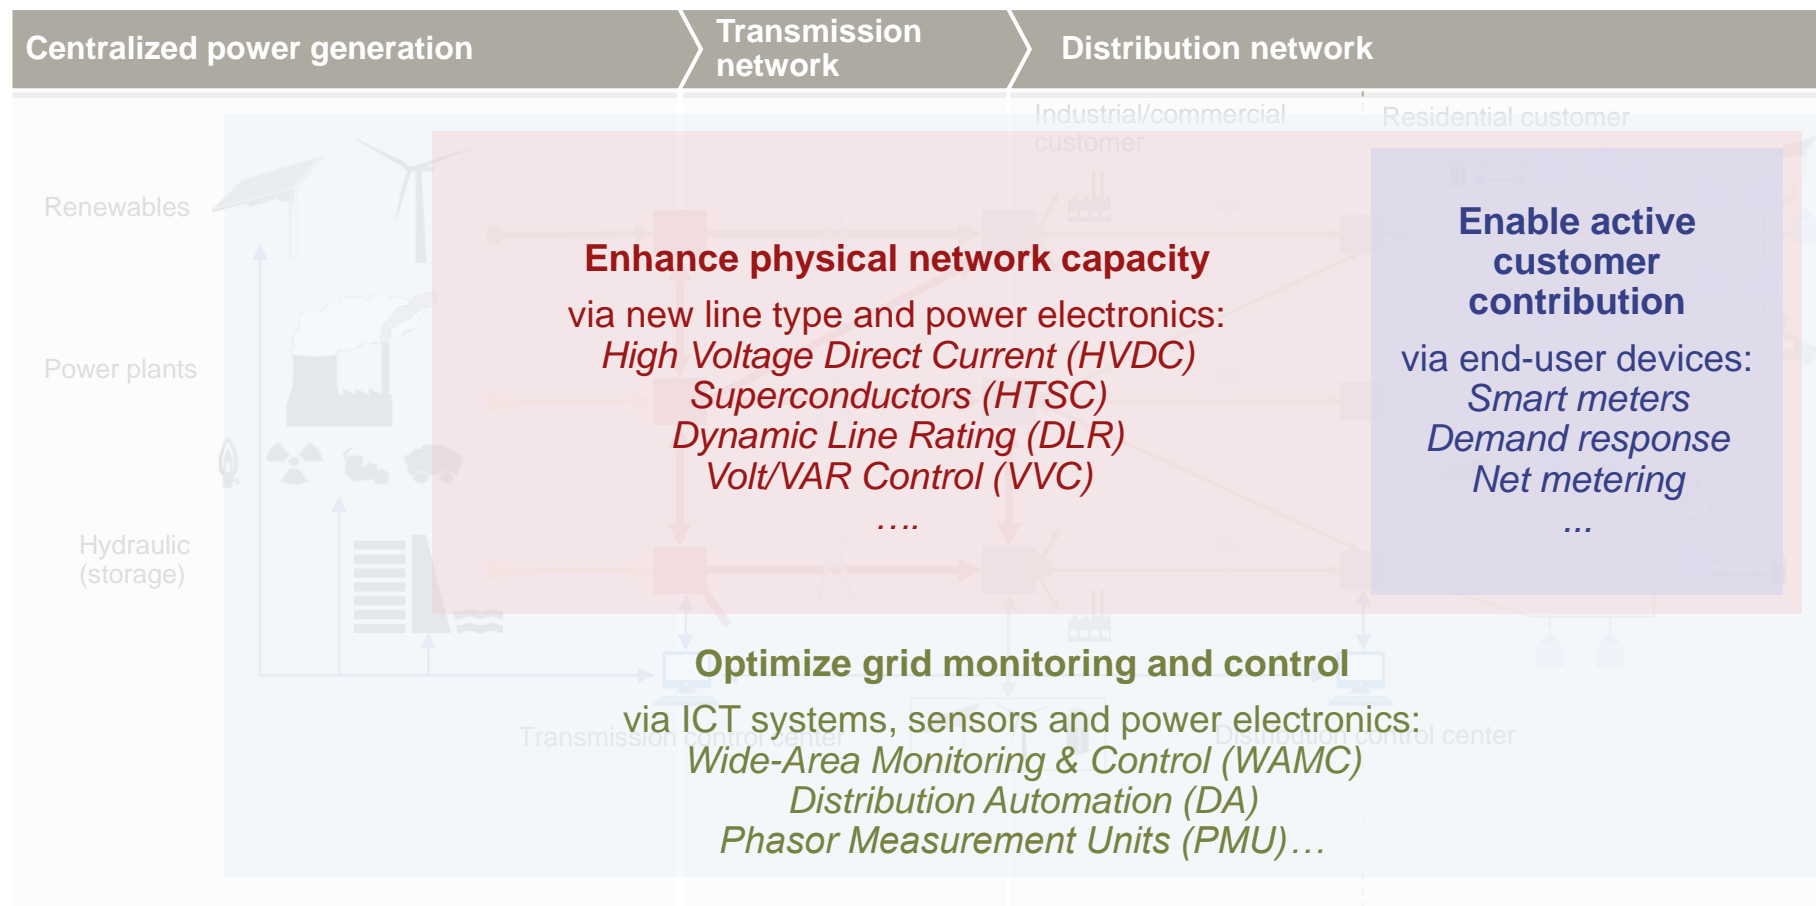

Key smart grid technologies can be classified by application and type of device

Smart Grid technologies BY application and device type

Click on each box to navigate to the associated FactCard in Appendix

Main stakeholders	Utilities, cooperatives, end-users..	Transmission System Operator (TSO)	Distribution System Operator (DSO)	End-users (residential, industrial...)
Type of device	Generation	Transmission	Distribution	Consumption
Communication networks	Micro-Grids and Smart Cities Wide Area Network (WAN)	(no transmission)	Micro-Grids and Smart Cities Field Area Network (FAN)	Home Area Network (HAN)
Electric-power infrastructure		High Voltage Direct Current (HVDC), Superconductors Flexible AC Transmission Systems (FACTS) Fault Current Limiters (FCL)	Smart Switches Capacitor Banks	Vehicle-to-Grid (V2G) Smart Inverters
Electronic devices and sensors		Dynamic Line Rating (DLR) Phasor Measurement Unit (PMU)	Advanced Metering Infrastructure (AMI, Smart meters, MDMS...)	Smart Appliances and In-Home Display (IHD)
Systems and processes	Wide-Area Measurement System (WAMS) Wide-Area Monitoring & Control (WAMC) Supervisory Control and Acquisition Data (SCADA)		Distribution Management System (DMS), Distribution Automation (DA) Volt/VAR Control (VVC), Conservation Voltage Reduction (CVR) Smart Protection: Predictive (Failure Prediction Algorithms) or Reactive (Fault Detection, Isolation and Restoration, FDIR)	Building and Home Energy Management Systems (HEMS) Demand Response (DR) Net Metering Virtual Power Plant (VPP) Demand Forecasting

Technology application: **A** Enhance physical network capacity **B** Optimize grid monitoring and control **C** Enable active customer contribution


Note: Numerous technologies have been deliberately excluded from the scope of this report for the purposes of simplification. Segmentation by application is only indicative. Overlaps exist, and smart-grid technologies only offer maximal benefits when integrated together.

Source: A.T. Kearney Energy Transition Institute analysis

Smart-grid devices are intended to be deployed throughout electricity networks

Selected smart-grid devices along the T&D value chain

Click on each icon to navigate to the associated FactCard in the Appendix

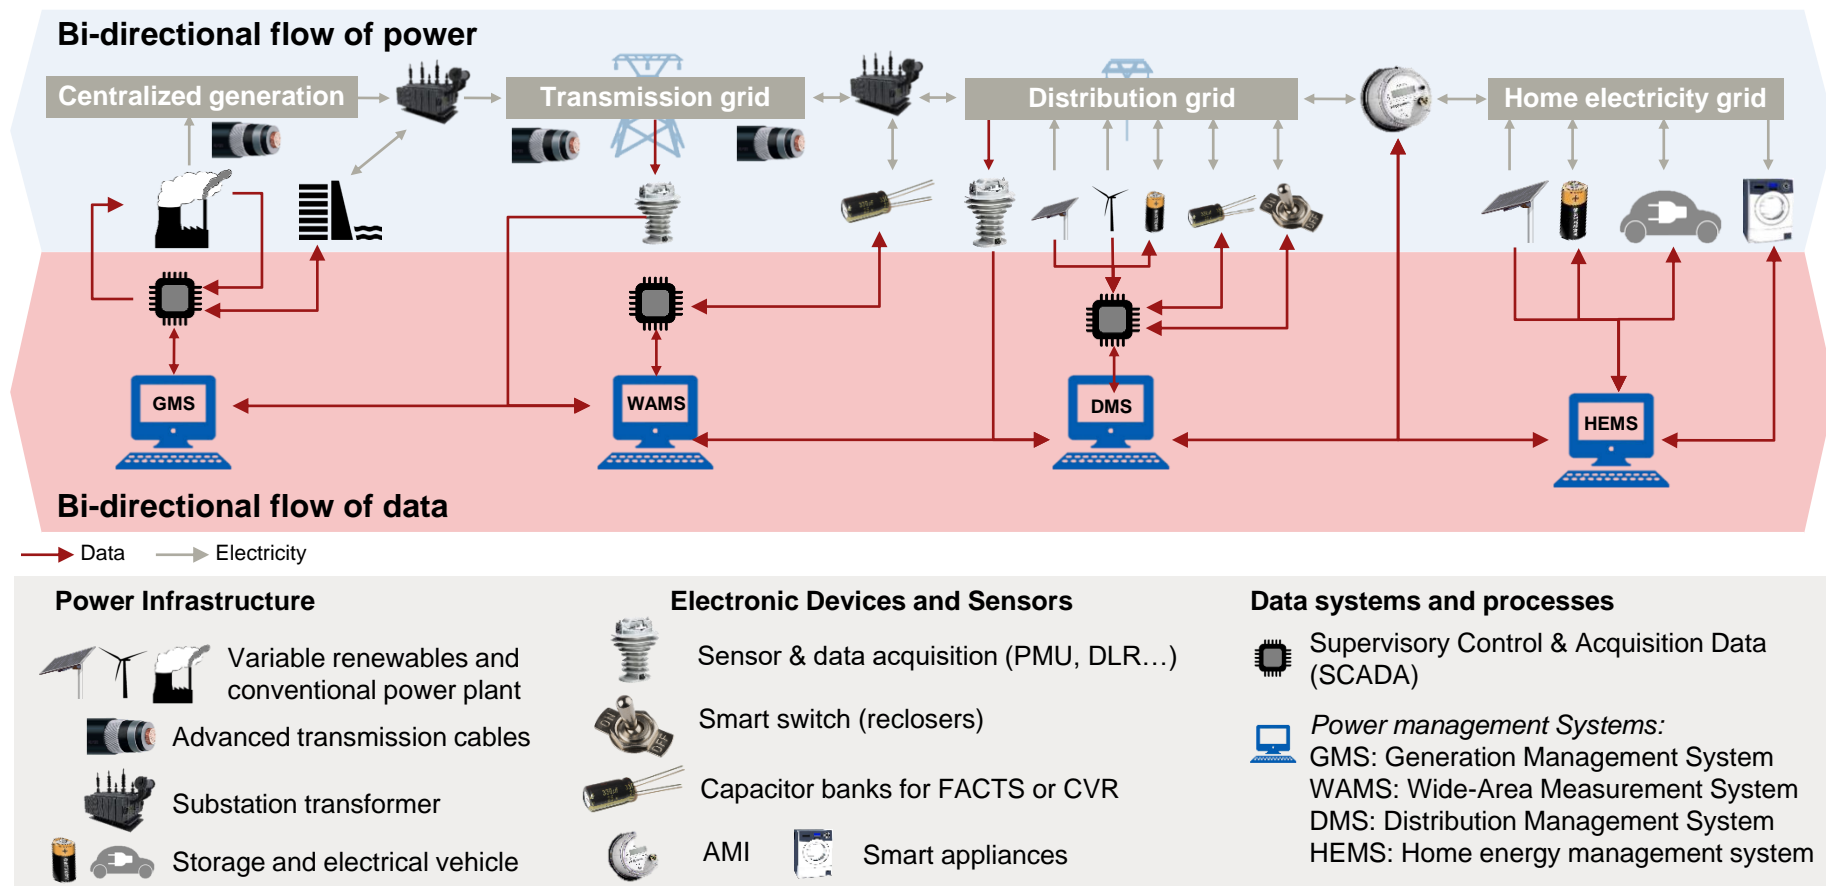


Note: Refer to the next few slides and to the Appendix for a more detailed analysis of each smart-grid device; FACTS: Flexible AC Transmission System; CVR: Conservation Voltage Reduction; PMU: Phasor Measurement Units; DLR: Dynamic Line Rating; AMI: Advanced Metering infrastructure.

Source: A.T. Kearney Energy Transition Institute analysis

Modern communication networks facilitate instantaneous network alignment, integrating all devices and network components

Selected Smart-Grid DEVICES and associated communication networks

Click on each icon to navigate to the associated FactCard in the Appendix

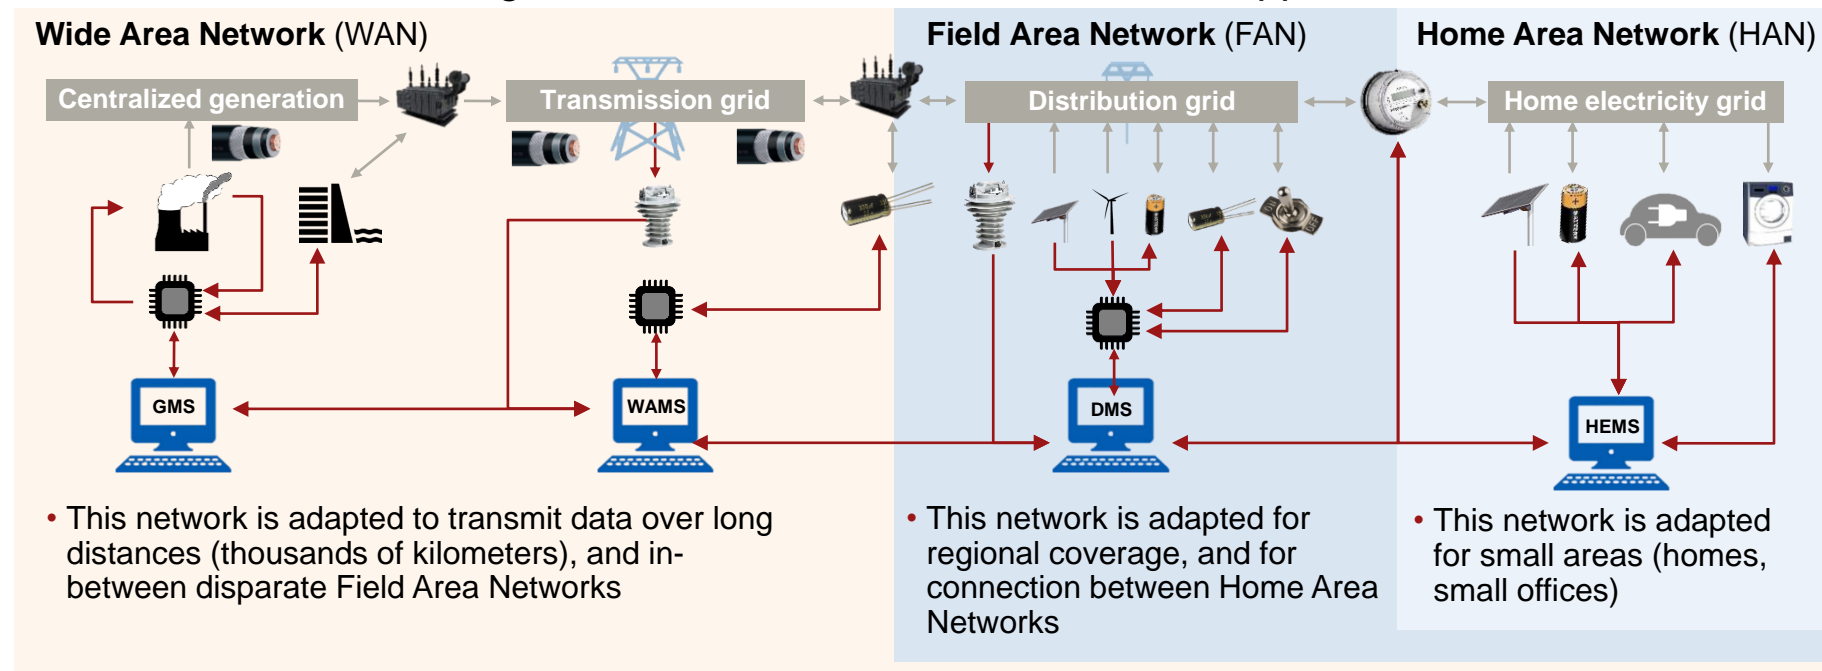

- Communication of operational measurements and control signals within each area network are relayed via either:
 - **Wired infrastructure** (e.g. Power-Line Communications (PLC) for the distribution grid, fiber-optic cables for high-voltage environments);
 - **Wireless networks** (e.g. satellite, cellular, or radio for wide-areas, wireless mesh network, or microwave for point-to-point).

Smart-grid technologies address current grid challenges


Smart-Grid benefits by technology application and related grid challenges

Existing grid challenges	Smart-grid technology applications		
	A Enhance physical network	B Optimize grid monitoring and control	C Enable active customer contribution
1 Rising and intensifying electricity demand	<ul style="list-style-type: none"> • Increase power-line capacity via electronic devices and sensors installed along the lines (DLR, FCL, FACTS, CVR...) 	<ul style="list-style-type: none"> • Predict and optimize electricity flow via new sensors and algorithms of higher spatial and temporal granularity, and Wide-Area Monitoring & Control (WAMC, PMU...) 	<ul style="list-style-type: none"> • Flatten aggregated peak demand via dynamic demand-response programs
2 Aging grid infrastructure (losses & unreliability)	<ul style="list-style-type: none"> • Reduce transport losses by using more efficient cables (HVDC, superconductors...) 	<ul style="list-style-type: none"> • Improve power reliability via smart protection systems, both in anticipation (failure prediction algorithms and condition-based maintenance), and in reaction (distribution automation, self-healing grid, FDIR) 	<ul style="list-style-type: none"> • Track down thefts via advanced metering infrastructure
3 Increasing share of Variable Renewable (VRE)	<ul style="list-style-type: none"> • Connect offshore wind-farms via subsea HVDC cables. 	<ul style="list-style-type: none"> • Smooth variability of VRE output by enlarging grid interconnections via Wide-Area Monitoring & Control 	<ul style="list-style-type: none"> • Provide additional flexibility means by pooling of customers into virtual power plants that can store or supply large amounts of electricity in a dispatchable manner
4 Increasing share of Distributed Generation (DG) & Electric Vehicles (EV)	<ul style="list-style-type: none"> • Achieve customer energy savings by stabilizing voltage delivered to end-users as closely as possible above nominal values, optimizing appliance efficiency (CVR) 	<ul style="list-style-type: none"> • Preserve power quality by absorbing voltage instability caused by back-flows of electricity or re-synchronization of islanded micro-grids thanks to voltage control (VVC, capacitor banks, PMU...) 	<ul style="list-style-type: none"> • Incentivize DG and EV deployment via net metering programs and vehicle-to-grid technologies, which turn individual customers into local suppliers of electricity

Enhancing physical network with new types of cable and power electronics increases maximal grid throughput and minimizes transport losses

Maximum power through transmission line

Length of Line

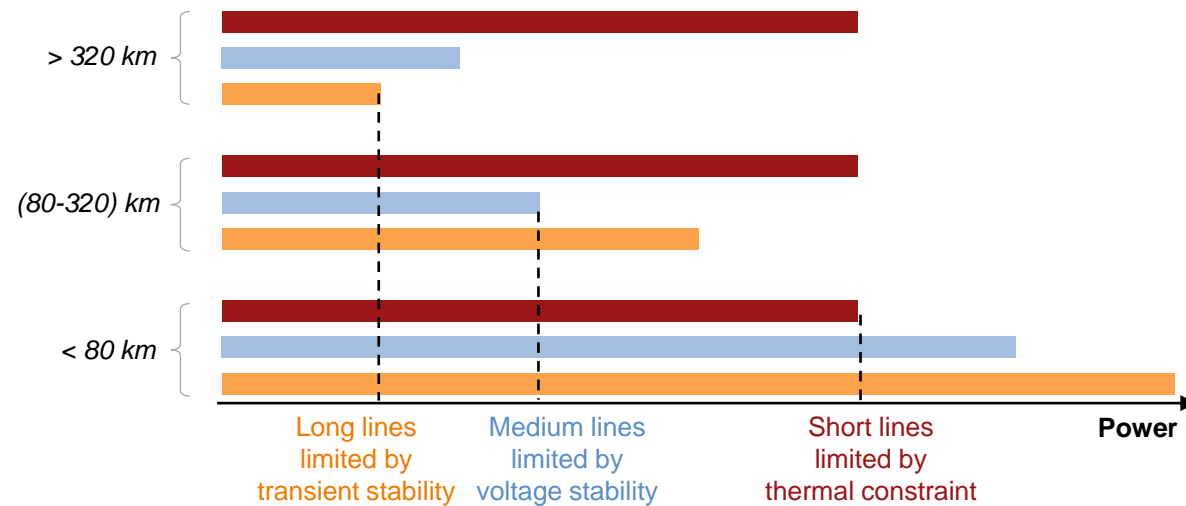

Transient stability refers to the ability of a transmission line to accept a transient increase in power flow exceeding the maximum safe voltage angle between two ends of the line

Voltage stability refers to the ability of a power system to maintain steady voltage after a disturbance (e.g. lightning)¹

Thermal constraints refers to heat losses dissipated along the cable in proportion to power throughput. When overheating, cables loosen, touch the ground and break

Limiting factors: ■ Thermal constraint ■ Voltage stability ■ Transient stability

A Enhance physical network capacity


- **Electricity lines have limited power throughput**, which decreases with line length, because of three main constraints: Thermal, Voltage and Transient stability (see figure).
- **Power-line capacity-enhancement technologies alleviate one of these constraints**, raising max. throughput per cable:
 - *Higher voltage technologies* (HVDC and superconductors) alleviate thermal constraints by reducing thermal transmission losses;
 - *Direct current (DC)* transmission removes transient-stability constraints;
 - *Dynamic Line Rating (DLR)* measures weather conditions to allow real-time modulation of maximal thermal constraints;
 - *Fault Current Limiter (FCL)* actively absorbs current faults to improve voltage stability;
 - *Volt/VAR Control* improve transient stability of AC transmission (via FACTS) and distribution lines (via CVR).
- **Benefits:**
 - Increase power-line capacity;
 - Reduce T&D losses;
 - Connect remote supply.

1. Disturbances can be caused by any unexpected external action (e.g. lightning strikes, storms, and loss of transmission lines or generation capacity), creating an imbalance between the mechanical power input to the generator and its electrical power output. As a result, the generator's rotation speed will be affected, leading to changes in voltage frequency.

Source: MIT (2011), "The future of Electric Grid"; Brown and Sedano (2004), "A primer on electric transmission", National Council on Electric Policy; Taylor (2008), "Voltage Stability for undergraduates", University of Minnesota Power Group; Vittal (2003), "Transient Stability and control of large scale power system", Iowa State University

Grid monitoring and control technologies optimize the routing of electricity flows and power quality within existing grid infrastructure

Simplified grid monitoring and control processes and associated Smart-Grid devices

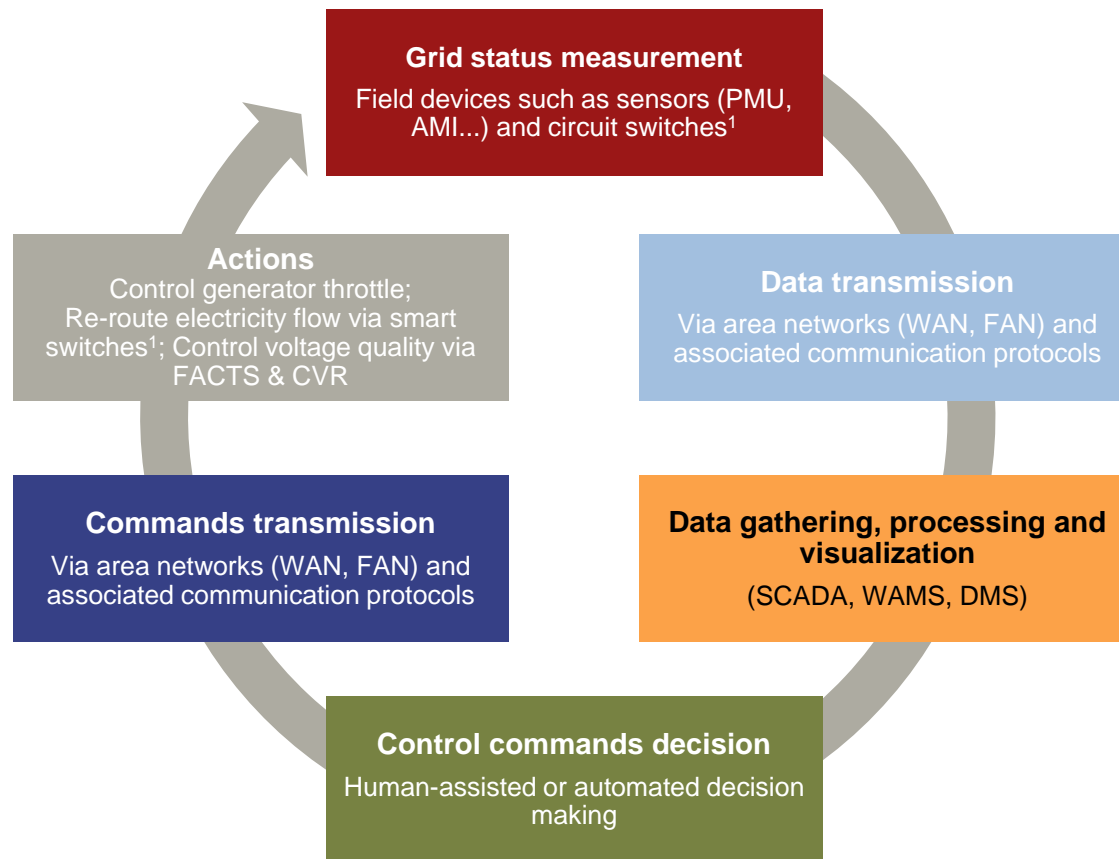


B Optimize grid monitoring and control

- **Definition:** *Advanced grid monitoring and control* refers to the improvement in the chain of command needed to operate the grid (left picture). It can be segmented along the T&D value chain:
 - *Wide Area Monitoring & Control (WAMC)* refers to a real-time country-scale vision and control of the transmission grid;
 - *Distribution Automation (DA)* refers to intelligent and partially automated distribution management.
- **Benefits:**
 - Utilization of existing lines is maximized: Smart routing of electricity allows power to flow up to a line's dynamic limit instead of its worst-case limit²;
 - Power quality is improved via Volt/VAR control, especially in the presence of VRE and DG;
 - Power reliability is improved via automated healing and predictive algorithms;
 - Losses can be precisely tracked down via advanced field sensors and visualization software.

1. Throughout this report, "switch" refers to any electric power device that can be open or closed (breakers, reclosers, fuses, jumpers, line cut), as opposed to potentiometers that can be gradually adjusted between an "on" and "off" position; 2. Refers to appendix 6.1 slide 8
Source: A.T. Kearney Energy Transition Institute analysis

Customer contribution to supply/demand balancing is enabled by *Demand-Response (DR)* programs

Aggregate demand from a regional grid (illustrative grid)

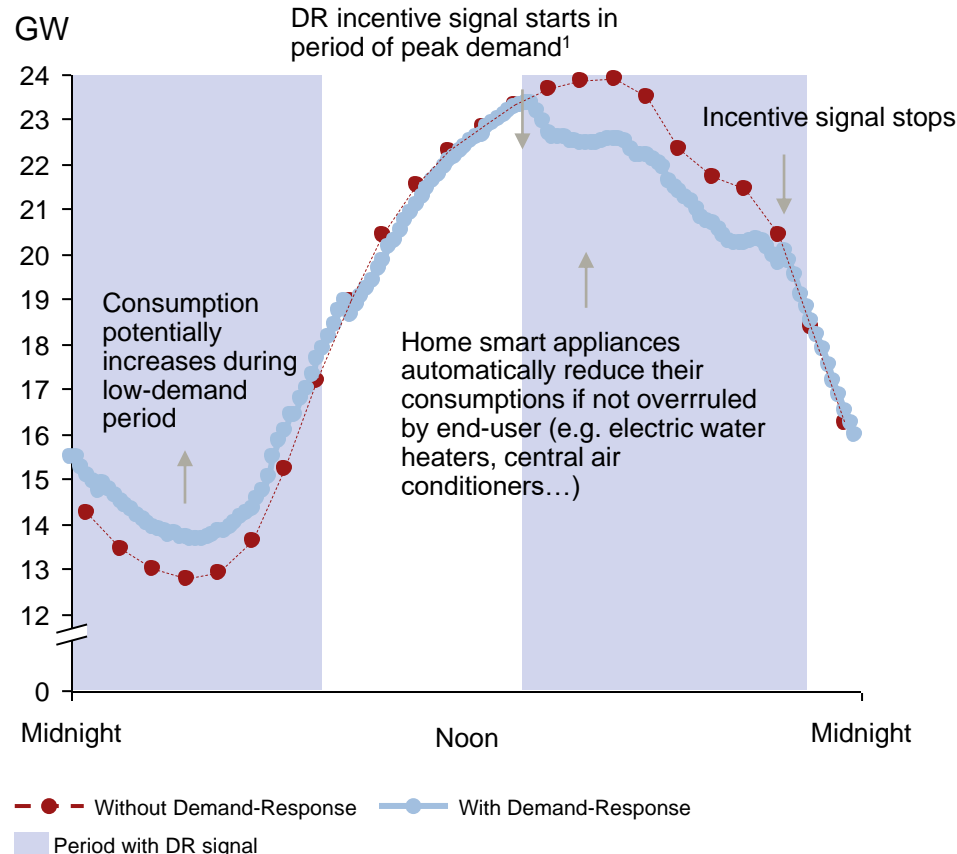

Enable active customer contribution

- **Definition of demand-response** by the Federal Energy Regulatory Commission (FERC): “Changes in electric use by demand-side resources from their normal consumption patterns in response to changes in the price of electricity, or to incentive payments designed to induce lower electricity use at times of high wholesale market prices or when system reliability is jeopardized”.
- **Key smart-grid technologies involved:** Unlike demand-side management – a mature technology that forces targeted load reductions at participating industrial end-users – DR has only become available recently. It is made possible by the use of smart meters and smart appliances, but they can only have a meaningful impact when a large number of them are aggregated (see Appendix 6.3, slide 96).
- **DR’s main benefits are:**
 - For end-users: lower bills and electricity consumption, the capability to participate in capacity-reserve markets;
 - For DSO: improved control over electricity demand (which reduces the need for flexibility sources such as peaking plants and centralized storage systems), flattened peak loads aggregated at substation level, improved demand predictability and consumption data.


1. Peak-demand period: As standards of living reach higher levels, countries generally experience faster growth in daily peak demand than in daily average demand, as house size increases, as well as the use of heating, air-conditioning, TVs, computers and EV-charging, often at the same time of the day; refers to Appendix 6.3.

Source: Illustrative example adapted from EIA (US Energy Information Administration), Example ISO-NE electric load, June 24, 2010; MIT (2011) “The Future of Electric Grids”; FERC, “Assessment of Demand Response and Advanced Metering”; Paul L. Joskow et al. (2012) “Dynamic Pricing of Electricity”

Customer contribution to decentralized power generation can be incentivized by *Net Metering programs*

How net metering works

C Enable active customer contribution

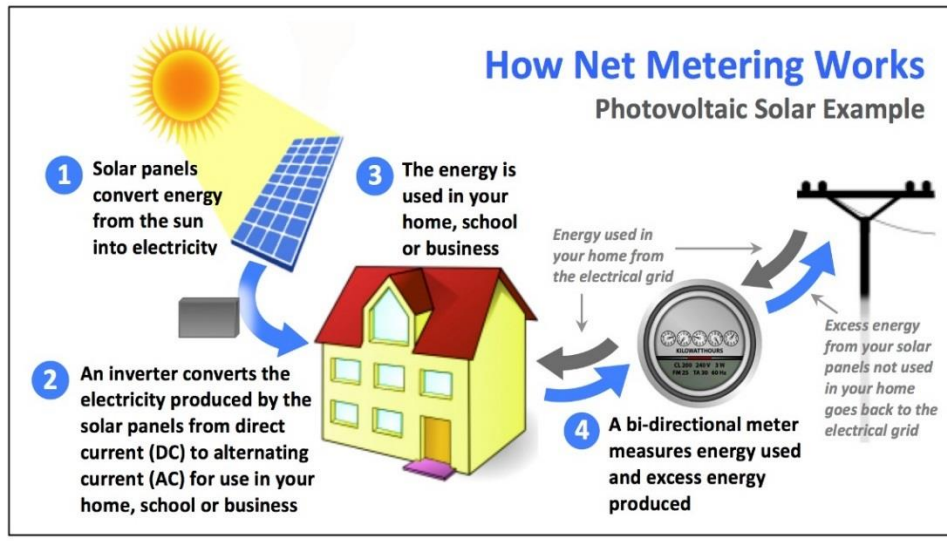


- **Definition:** Net-metering refers to an incentive program that allows residential and commercial customers who generate their own electricity to be only charged for net power withdrawn from the grid, and to feed their excess electricity back into the grid, in return for financial or electricity credits (see slide 98).
- **Applications:** Distributed generation (see picture) vehicles-to-grid (V2G).
- **Benefits:**
 - For end-users: allows local power producers to become local suppliers;
 - For grid operators: integrates DG and EV as a source of flexible generation capacity, operated as virtual power plants (see slide 99).

- **Unintended economic consequences** may arise if the feed-in tariff given to the local producer includes the cost of grid services (the guarantee that producers will be able to withdraw or supply power at any time). For instance, if feed-in-tariffs equal end-user electricity prices, T&D costs will increasingly be borne by grid users not enrolled in net-metering programs
- **Technical issues** arise when the penetration of grid-connected DG reaches sufficiently high levels to affect voltage quality (slide 19).
- **Key smart-grid technologies involved:**
 - To enable net-metering accounting: AMI, Smart meters and DMS;
 - To maintain power quality in case of high DG penetration: PMU and smart switches in the distribution grid to re-connect in a synchronous manner a portion of the grid that has been islanded; Volt/VAR control in the distribution grid, and smart inverters connected to the distributed generator to automatically and progressively reduce output in cases of over-voltage or over-frequency.

Looking further ahead, the modular nature of micro-grids allows for their interconnection and, ultimately, the construction of smart cities and super-grids

Micro-Grids, Smart Cities and super-grids

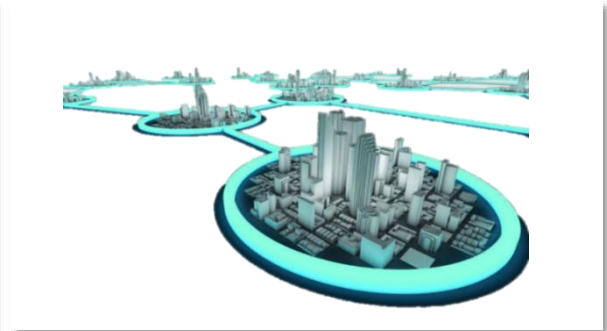


- **A micro-grid** is a localized and autonomous energy system, consisting of distributed energy resources, consumers and, ideally, storage capacity.
- It has the capability to isolate itself from the main grid during power-system disruptions and blackouts, referred to as “islanding”. The grid connection is a back-up solution for situations in which one or more on-site generators have to be disconnected.
- Micro-grids also offer the prospects of stable electricity supply to communities in the developing world that do not currently have it.

- **A smart city** is a wider community composed of autonomous but interconnected micro-grid systems that use information and communication technologies to integrate a number of civic services. The main aims are to optimize the efficiency of power supply and maximize integration of renewable resources for sustainable living.
- A new kind of governance, incorporating genuine citizen involvement, is required to integrate various civic services, such as administration, education, healthcare, public safety, real estate, transportation, and power utilities/energy utilization.

- **A super-grid** is a regional power system consisting of several micro-grids connected via transmission networks. These are virtually unaffected by severe supply shortfalls because individual micro-grids are able to disconnect from the grid.

3. Benefits and challenges of smart-grid roll-out

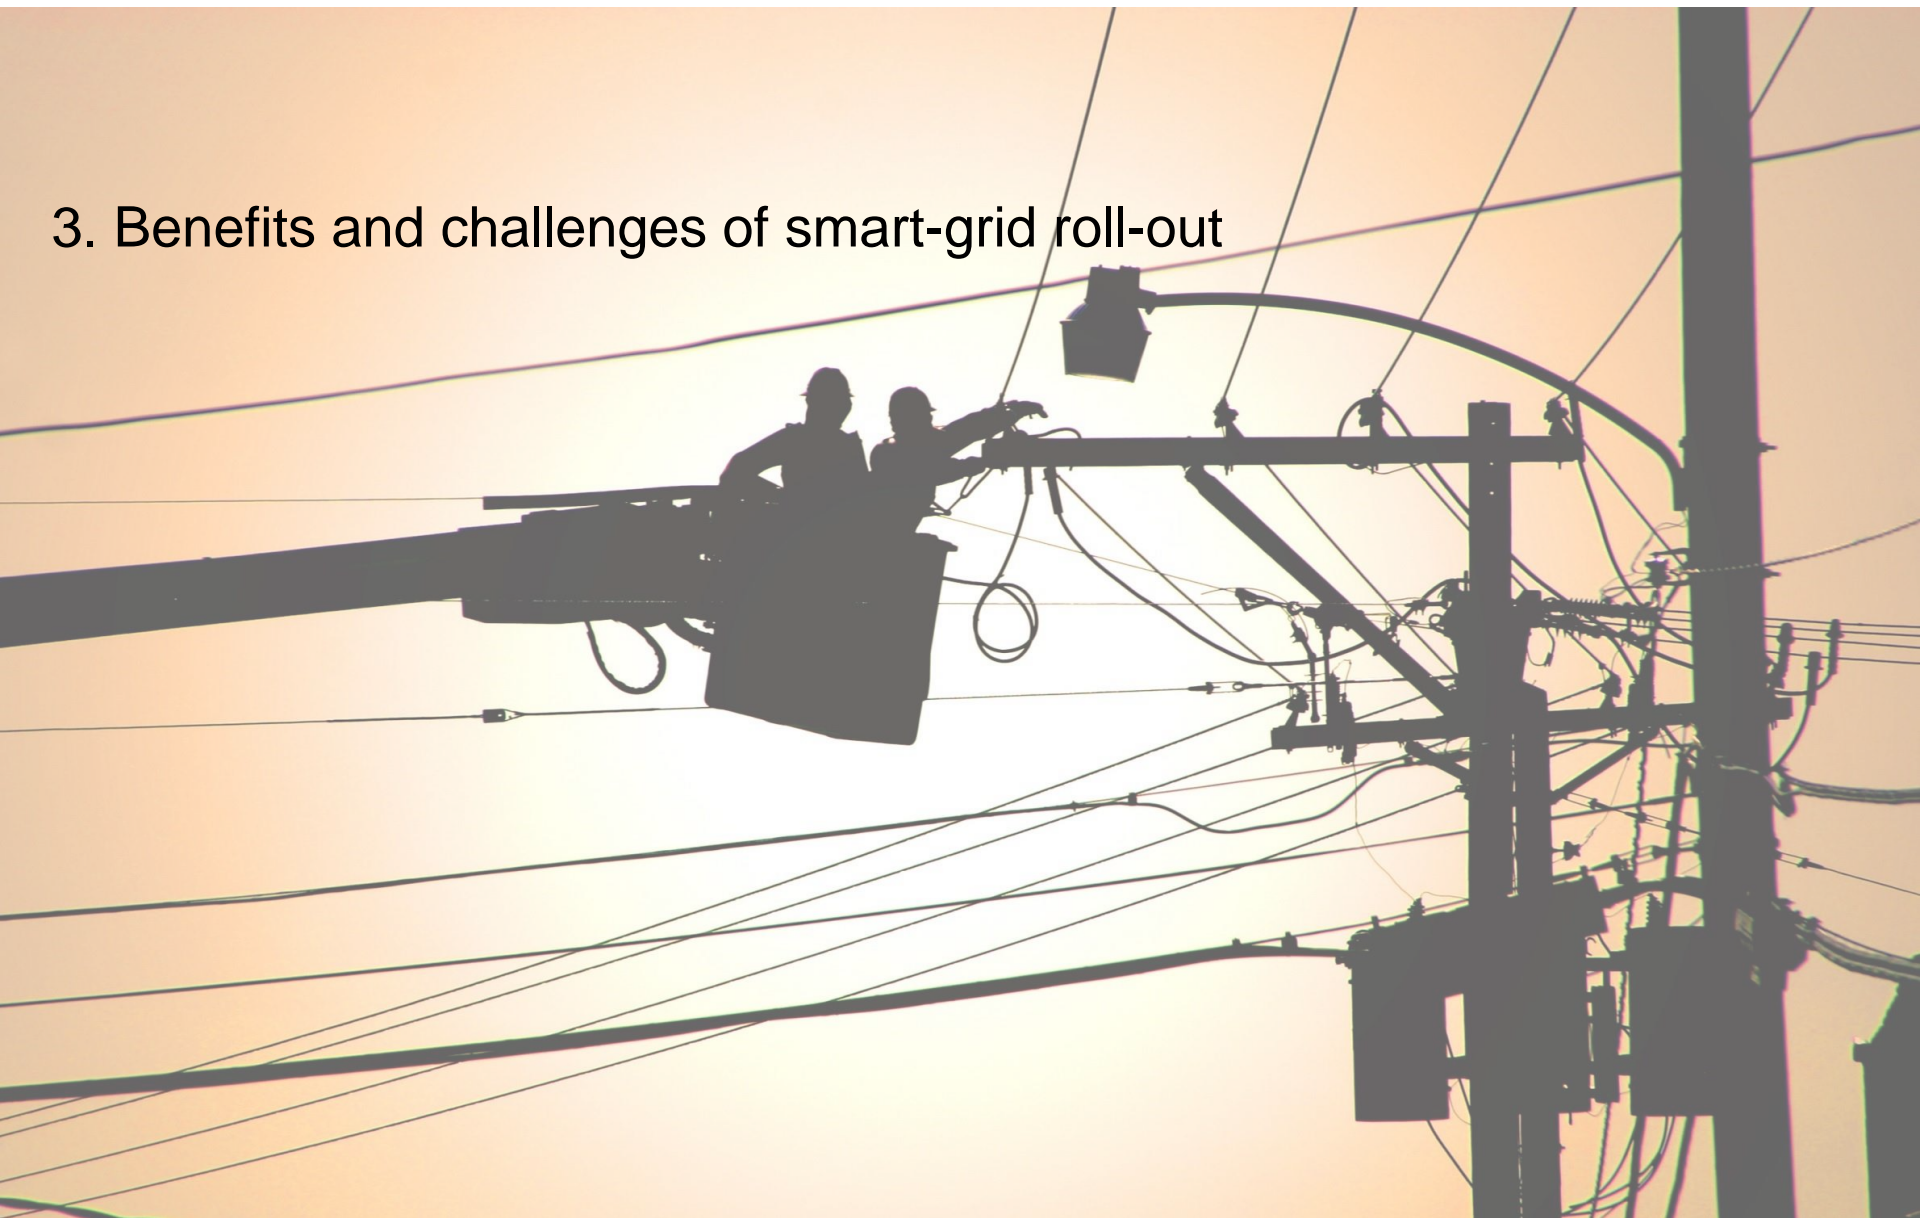

Main findings

3.1 Economics and Environmental Benefits

- Although impacts are difficult to quantify, a smart-grid roll-out is believed to provide net economic and environmental benefits in all regions where studies have been undertaken.
- For U.S. society as a whole, the direct and indirect benefits of a full roll-out outweigh their costs by a factor of between 2.7 and 6. Restricting the scope to electricity-grid stakeholders, the direct benefits/cost factor is between 2 and 4 in OECD countries, and 3 and 4.5 in China.
- However, if smart-grid investments are mostly borne by the system operators, the benefits are spread among many groups: producers, T&D operators, customers, and the public at large, as a result of environmental benefits.
- Although environmental sustainability is not the primary driver of smart-grid adoption, smart grids contribute to limiting greenhouse gases emission both directly (through energy savings) and indirectly (by encouraging the development of electric vehicles and renewables). Overall, smart grids could contribute to 4% of cumulated CO₂-emissions reduction efforts until 2030 in the lowest-cost pathway towards limiting to 2°C any rise in the average global atmospheric temperature.

3.2 Social Acceptance and Cybersecurity

- Social acceptance of smart grids is a prerequisite for active consumer participation in grid management.
- Clarity in relation to data privacy, sharing and protection will be essential in securing consumer acceptance and grid security. Cybersecurity must be developed to protect technology, processes and people from deliberate attacks and accidents.

Costs and benefits related to smart grids are difficult to quantify

Potential costs and potential benefits of smart-grid roll-out

Uncertain costs

- Digital technologies have inherent weaknesses and have a limited life expectancy.
- Difficulties in determining obsolescence of technology:
 - Estimates of reasonable replacement costs;
 - Projections of technological evolution and progress.
- Forecasts in cost savings:
 - Cost of electrical components is decreasing;
 - Marginal costs are decreasing because of growth in production;
 - Indirect efficiency gains or lack of compatibility can greatly alter cost recovery.

How to define boundaries: What do costs include?

- Integration of variable renewables and distributed generation.
- Diversity of smart appliances at the consumer.
- New power generation technology.

Uncertain benefits

- Benefits are often long-term:
 - High upfront capital costs;
 - Long lead times can face changes in exogenous variables during construction (e.g. input costs, regulation).
- Different types of functions or technology may generate individual benefits, while others provide benefits that mutually reinforce those of related technologies (e.g. HVDC and FACTS).
- The role played by consumers in the market is still uncertain:
 - Detailed consumption data still not ubiquitous;
 - The extent to which customers are willing to participate is uncertain.


How to monetize a physical technology? (three main challenges)

- Technological diversity
- Large-scale of technology
- Market size and number of market participants




Net economic benefits are calculated as the difference between the business-as-usual scenario and one in which significant smart-grid technologies are deployed

Definition of cost/benefit analysis

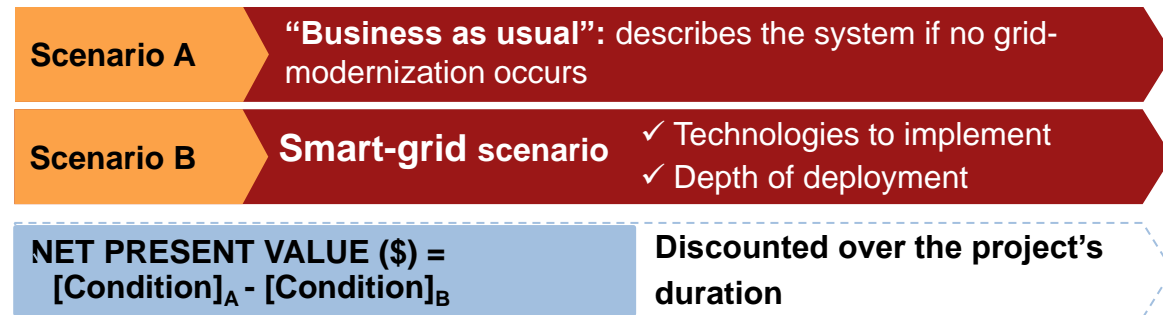


- The objective is to define the baseline scenario (A) against which various smart grid roll-out scenarios (B) are compared.
- Assumptions regarding external factors not related to smart grids, such as population growth, regulatory framework and evolutions of costs must be standardized for both scenarios.
- Several variants of scenario B can then be analyzed relative to scenario A, with variations in terms of the technologies to be implemented, and the extent of their deployment (full or partial roll-out).
- The net present value must be estimated for any given scope:
 - For the purposes of the calculations of grid stakeholders, the private-sector discount rate is generally preferred.
 - For the purposes of government calculations, a discount rate tied to government bonds is generally preferred.

Scope of cost/benefit analysis

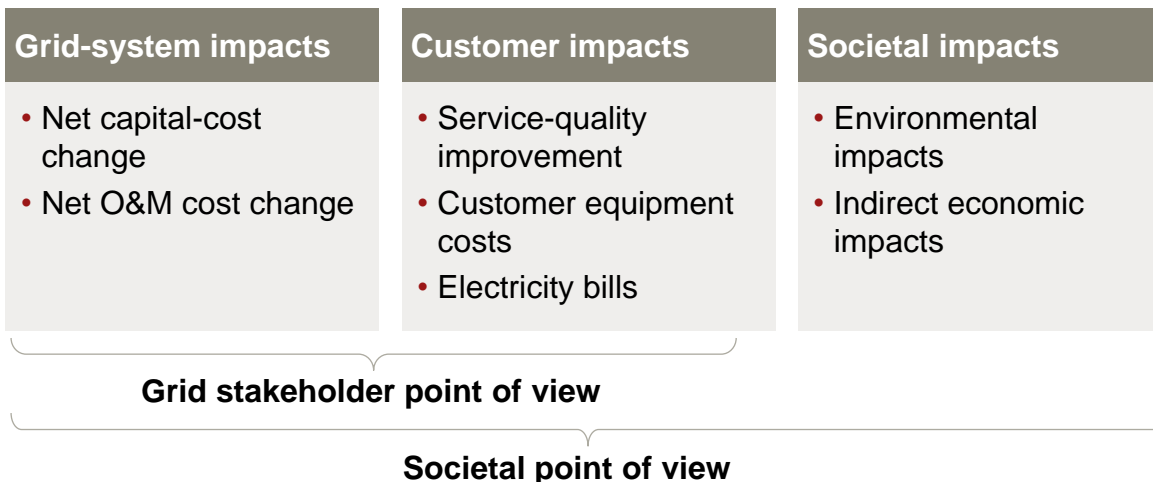

The IEA estimates that, from the viewpoint of grid stakeholders, the direct benefits of smart grids outweigh their costs in all regions studied

Cost and benefits of smart-grid roll-out up to 2050, in IEA 2DS scenario¹

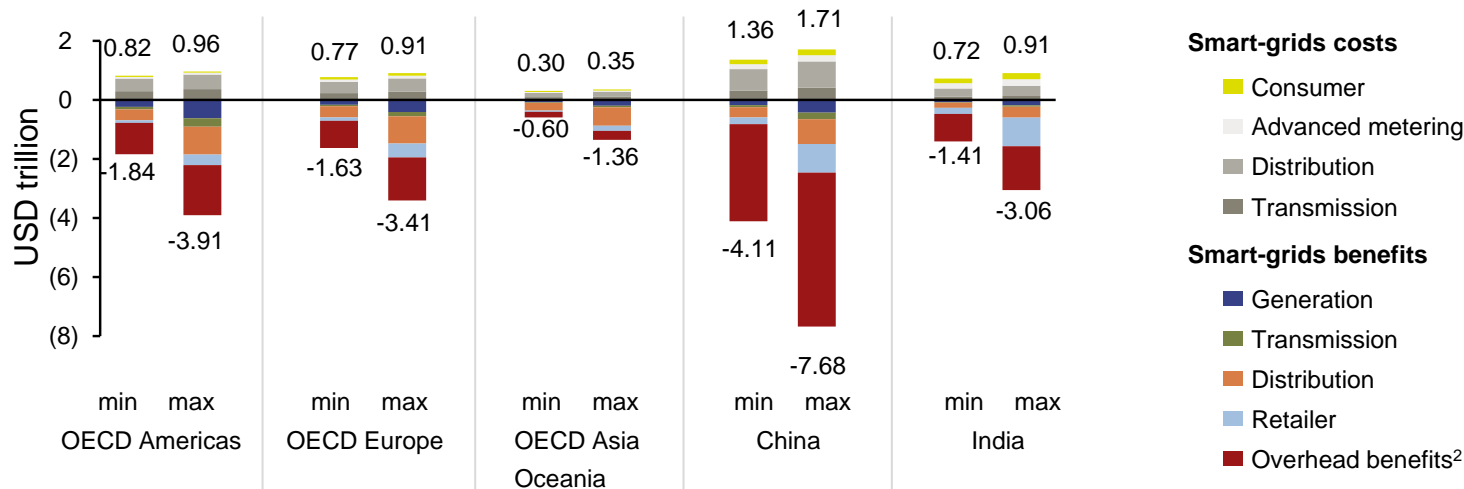


- Investment costs are entirely borne by system operators, who may raise electricity prices to achieve an acceptable return on investment, especially after demand optimization and reduction. Technical solutions and regulatory changes are needed to address this barrier (e.g. who should pay for smart meters?).
- It is more difficult to place a monetary value on benefits than on costs. While some benefits specifically apply to a single stakeholder (e.g. a reduced need for physical meter-reading because of smart meters), the largest benefits are shared among all grid stakeholders, shown as “overhead benefits” (e.g. overall reduction in electricity demand leading to deferred grid extension plans).
- Finally, smart grids also facilitate the use of other technologies (e.g. electric vehicles, distributed generation). Such indirect benefits, along with environmental ones, are not included in this analysis, even though they may be important.

1. The 2DS Scenario is IEA's lowest-cost pathway for mitigating greenhouse gas emissions and limiting the average increase in global temperature to below 2°C. The smart grid roll-out plan includes the full participation of residential customers in generation and demand-side flexibility services, and technology options that increase existing power-line capacities to alleviate congestion and enable maximum utilization of existing and new systems; 2. Overall direct benefits spread between all grid stakeholders.
Source: IEA (2012), “ETP 2012”

U.S. Case (1/2): EPRI estimated the costs and benefits of a complete modernization of the U.S. Grid by 2030, from a societal point of view¹

Quantification of the costs and benefits for a complete modernization of the U.S. Grid

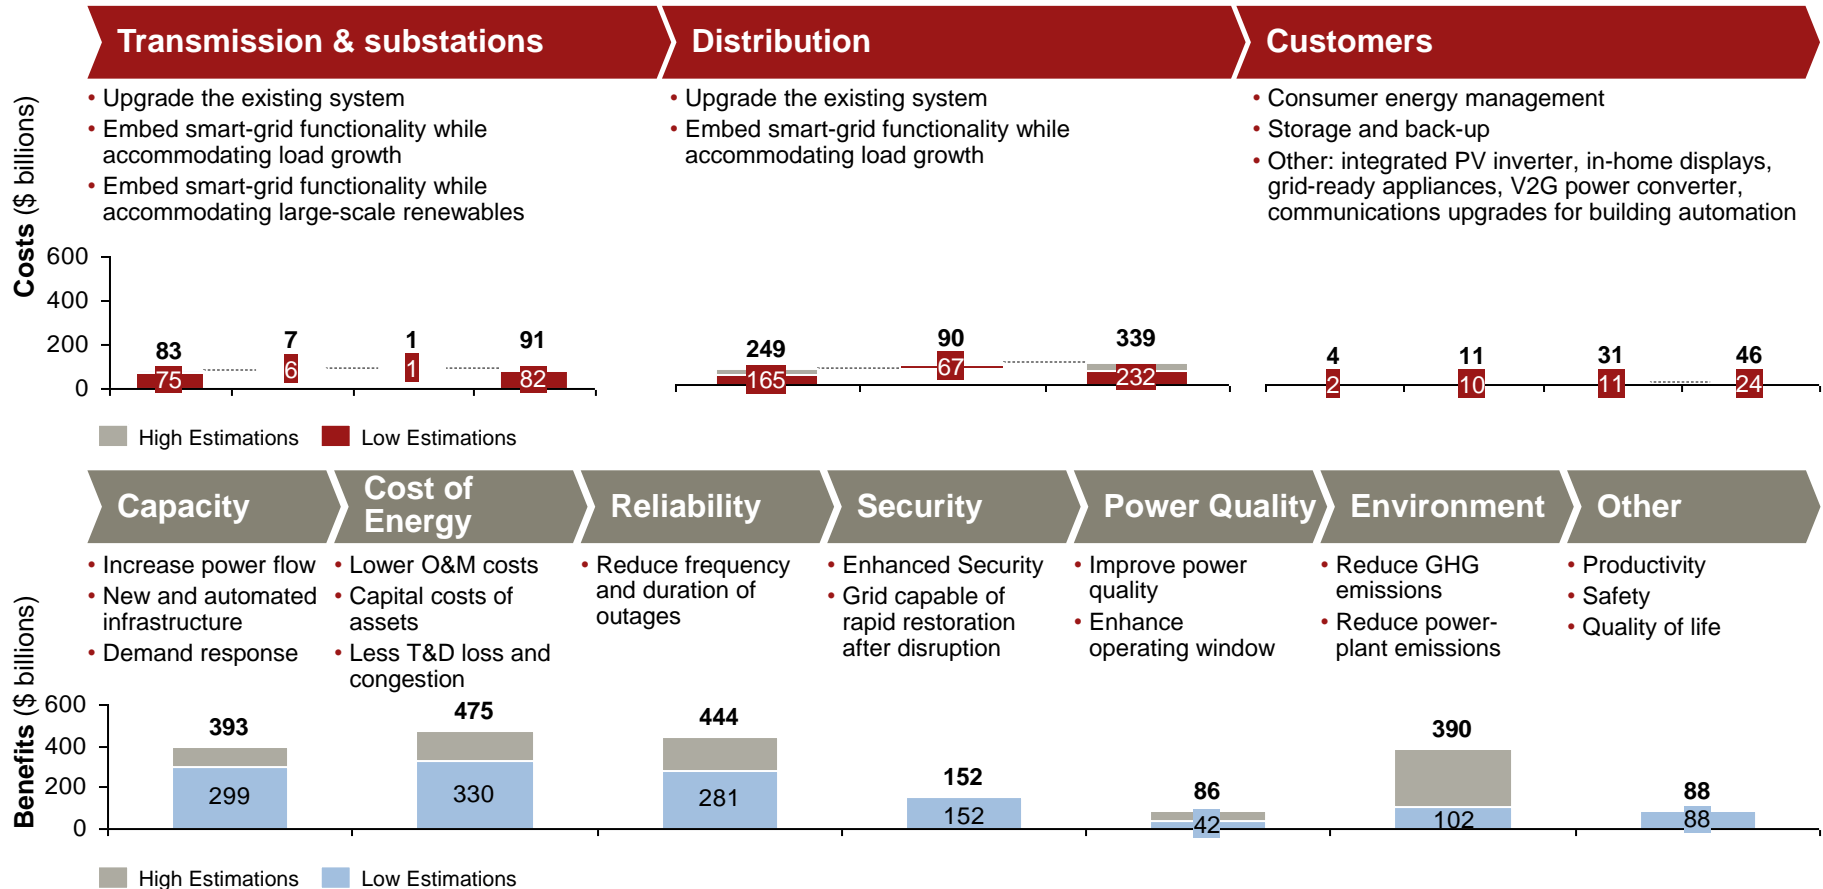



1. The scope of this analysis extends to U.S. society in its entirety, including externalities such as environmental impacts. Indirect benefits of smart grids are also taken into account (e.g. V2G). Returns on investments are discounted, with societal rates of return closer to those of U.S. Treasury bonds than of private-sector investments.

Source: Adapted from Electric Power Research Institute - EPRI (2011), "Estimating the costs and the benefits of the Smart Grid"

U.S. Case (2/2): Overall, the benefits of a smarter grid are 2.7 to 6 times greater than the associated costs of modernization

Total costs and benefits from the U.S. case (2010-2030)

\$ billions

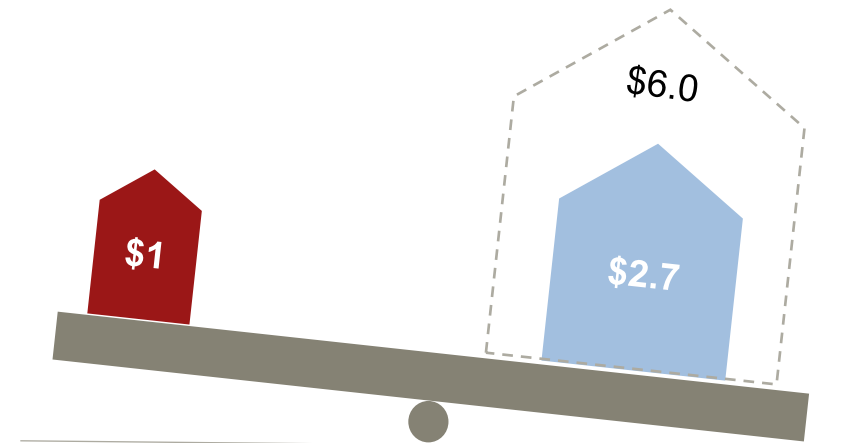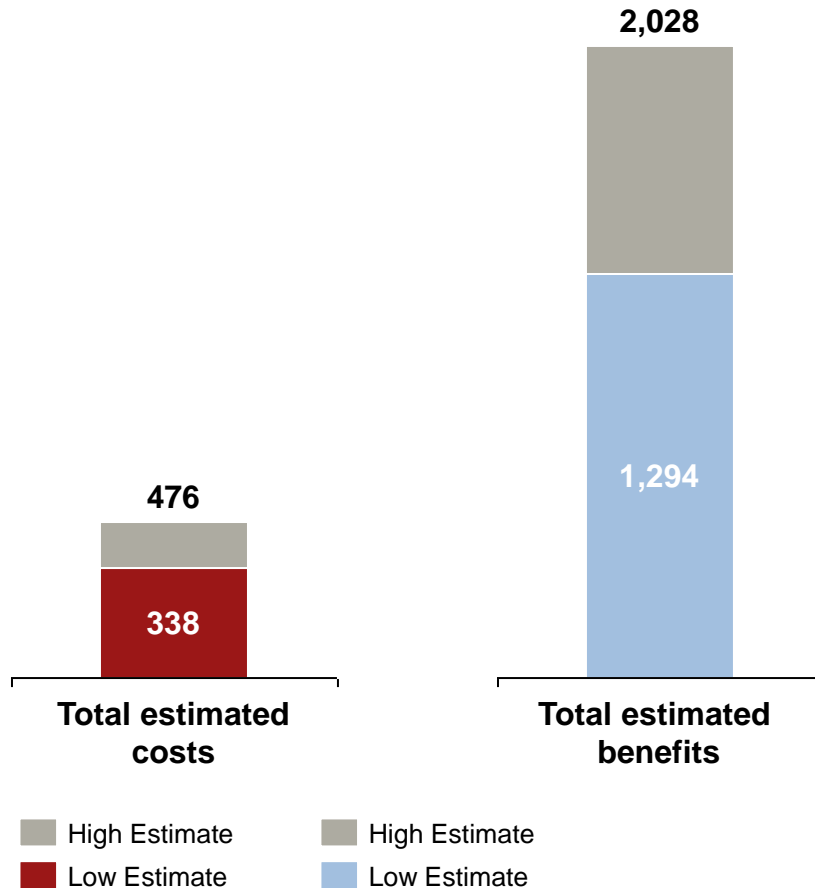

- The **benefit/cost ratio is estimated to be between 2.7 and 6** in the U.S. for the 2010-2030 period.
- Deployment of smart-grid technologies can provide direct and indirect benefits by avoiding new investments in generation infrastructure:
 - For example, EPRI estimated the potential benefits from energy efficiency and demand response at \$192-242 billion in the U.S. in the 2010-2030 period.

Smart grids contribute to limiting greenhouse gas emissions directly (via energy savings) and indirectly (enabling clean practices)

Smart Grid fulfills Needs for emission

Reduction targets

- **Direct reductions** from smart grids come from energy savings derived from reduced T&D losses, reduced electricity consumption, and reduced utilization of peaking plants, which are generally carbon-intensive. The size of these energy savings depends on the relative composition of supply sources and their average emissions levels.
- **Indirect reductions** enabled by smart grid are:
 - Greater penetration of **variable renewables**, supported by various smart-grid technologies;
 - Increased **distributed generation**, which is generally clean, and may reduce the average power-transmission distance, potentially curbing T&D losses;
 - Reduced fuel and emissions arising from smart charging of additional **electric vehicles**.

Direct reductions

Energy savings¹:
2%-9%

Support EVs

Enabled reductions¹:
0.5%-3%

Support renewables

Enabled reductions¹:
1%-12%

EU and U.S. climate policies

EU policy



	2030 target	2050 target
GHG emissions-reduction target²	40%	80-95%
Renewable energy (% of total energy production)	30%	-
Energy savings (% of primary energy)	20%	-

U.S. Policy



	2020 target	2050 target
GHG emissions-reduction target³	17%	83%
Renewable energy (% of total energy production)	20%	-
Energy savings (% of primary energy)	5%	-


1. A.T. Kearney Energy Transition Institute reclassification and range compilation from EPRI, Hlekik, ClimateGroup and U.S. DOE; 2. % reduction compared with EU 1990 levels; 3. % reduction compared with U.S. 2005 levels.

Source: Pratt et al. (2010), "The Smart Grid: An Estimation of the Energy and CO2 Benefits". PNNL, U.S. Department Of Energy; European Commission (2013), "Green Paper, A 2030 framework for climate and energy policies";

Smart grids should ideally contribute to 4% our cumulated CO₂ emissions-reduction efforts in the lowest-cost pathway towards climate stabilization

ESTIMATED ANNUAL CO₂ emissions reductions from Smart-Grid deployment

Gigatonne (Gt), in IEA's lowest-cost pathway towards 2°C limit

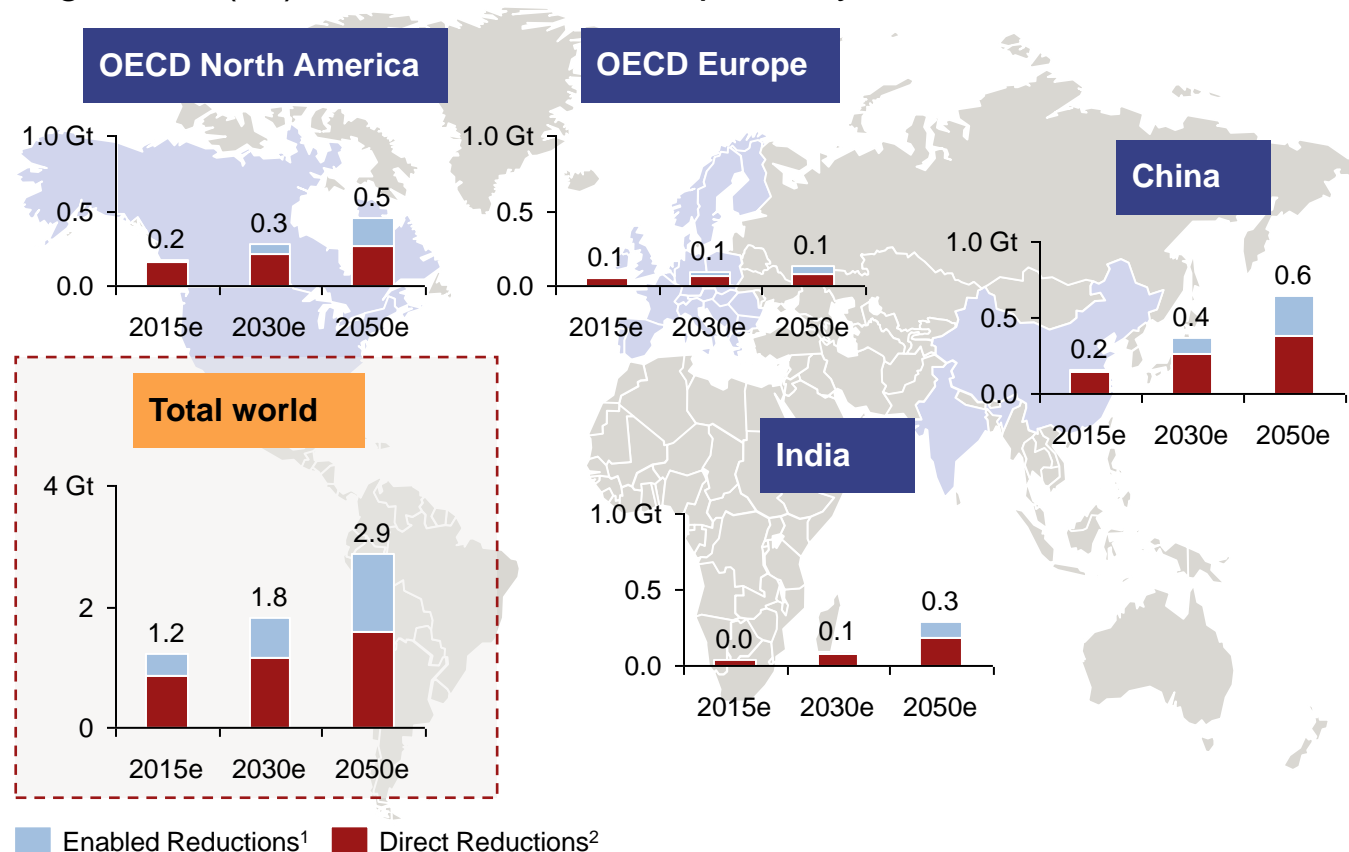

- Although electricity consumption only represents 17% of final energy use today, it accounts for 40% of global CO₂ emissions, largely because almost 70% of electricity is produced from thermal power plants with limited energy-conversion efficiency.
- The IEA estimated in 2011 that smart grids offered the potential to achieve net annual emissions reductions of 1.2 Gt of CO₂ by 2015 and reductions of up to 2.9 Gt in 2050. In 2014, it estimated that smart-grid contributions should ultimately represent 4% of cumulated abatement efforts by 2050.

1. Enabled reduction refers to a greater integration of renewables and facilitation of electric vehicles deployment; 2. Direct reduction refers to energy savings from peak-load management, continuous commissioning of service-sector loads, accelerated deployment of energy-efficiency programs, and reduced transmission losses.

Source: IEA (2011), "Technology Roadmap, Smart Grids"; IEA (2012), "ETP 2012"; The World Bank, Statistical Database, extracted June 2013

Social acceptance is a prerequisite for grid-extension plans and active consumer contribution to grid management


Protests against new overhead Transmission lines



- Smart-grid technologies will strongly impact the consumer's day-to-day behavior. Lack of public awareness limits public support.
- Of energy and utilities chief executives interviewed in 2012, 67% identified the customer as the most critical area for investment.
- There are, for example, growing public objections to overhead power lines, particularly in Europe.

Electro-magnetic fields created by transmission lines

micro Tesla (Y), meter (X)

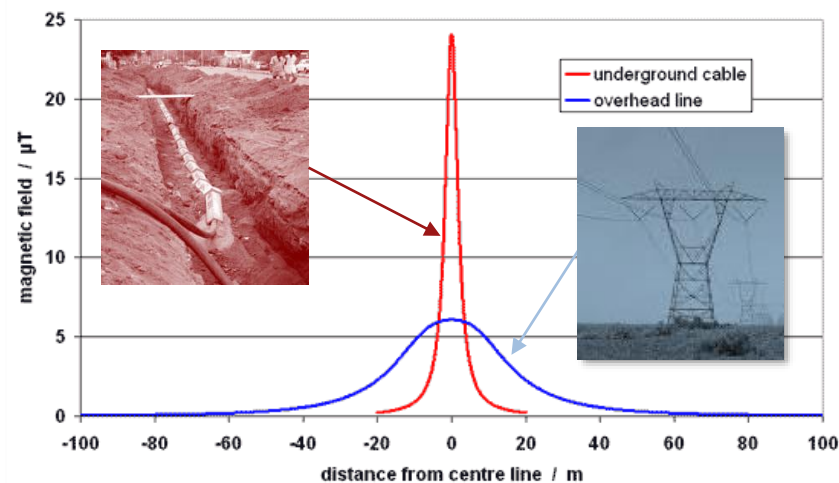

- Underground cabling, which today represents 4% of the total transmission network in Europe, is becoming an increasingly compelling alternative, mainly for environmental and political reasons.
- There are some concerns about the impact on health of long-term exposure to Electro-Magnetic Fields (EMF) caused by high-voltage power lines. Underground cables restrict EMF to the close vicinity of power lines and avoids the exposure of people to EMF.

Data-protection and -sharing issues will arise as the future electricity grid collects, communicates and stores operational and private consumer data


About data privacy

- **Grid operational data** are information concerning electricity generation, transmission and distribution, which can be aggregated from, but are not available at, the individual customer level. The protection of grid information is treated as a security issue (competitive harms, and physical or cyberattacks).
- **Privacy and security of consumers' data** raise many questions:
 - Which data are we concerned about?
 - Who should access these data?
 - How do we balance privacy concerns with the business and societal benefits of making these data available?
- Electricity customers will demand, and should have, significant control over access to data about their electricity usage.

Data Privacy Survey

- 46% of customers believe it is “very important” that their electricity usage be kept confidential.
- 29% believe it is “somewhat important”.
- 79% believe only customers and utilities should have access to smart-meter information.

Consumer electric usage data flow

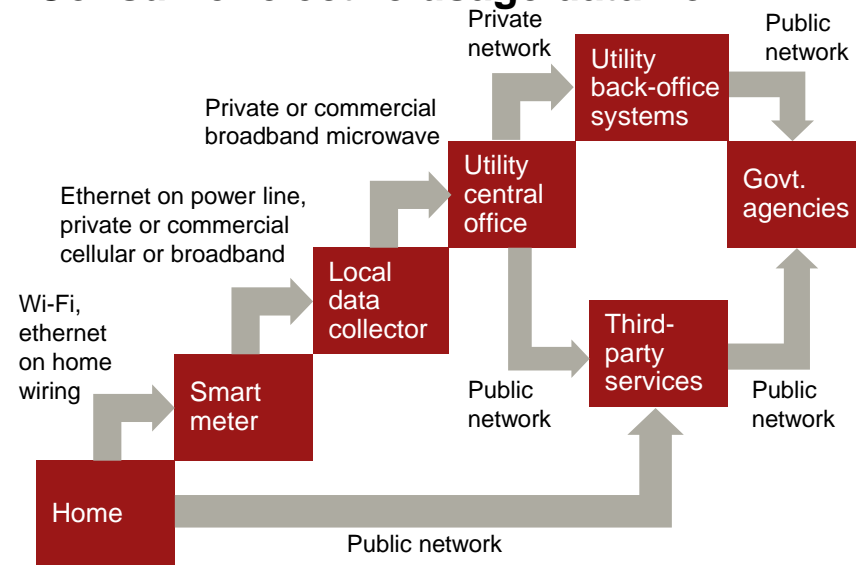


- Because data flow across the whole electricity-grid communication network, access and ownership are issues that need to be controlled and monitored:
 - The European Commission is establishing a smart-grid task force on regulatory recommendations for data safety, handling and protection (since 2009, expert group 2);
 - The Office of Gas and Electricity Market (Ofgem, UK) has recently created an independent organization to safeguard against abuses of its privileged position: The Data Communication Company (DCC, open in 2013).

Note: The MIT study only assesses the U.S.

Source: Edison Electric Institute (2010), "RE: Addressing Policy and Logistical Challenges to Smart Grid Implementation"; MIT (2011), "The Future of the Electric Grid"; Wright (2012), "Ofgem's response to DECC's Consultation on the Draft DCC Licence and Licence Application Regulations", Ofgem

Cybersecurity systems for protecting data and networks from deliberate attacks and accidental security breaches must be developed

Cybersecurity vulnerabilities

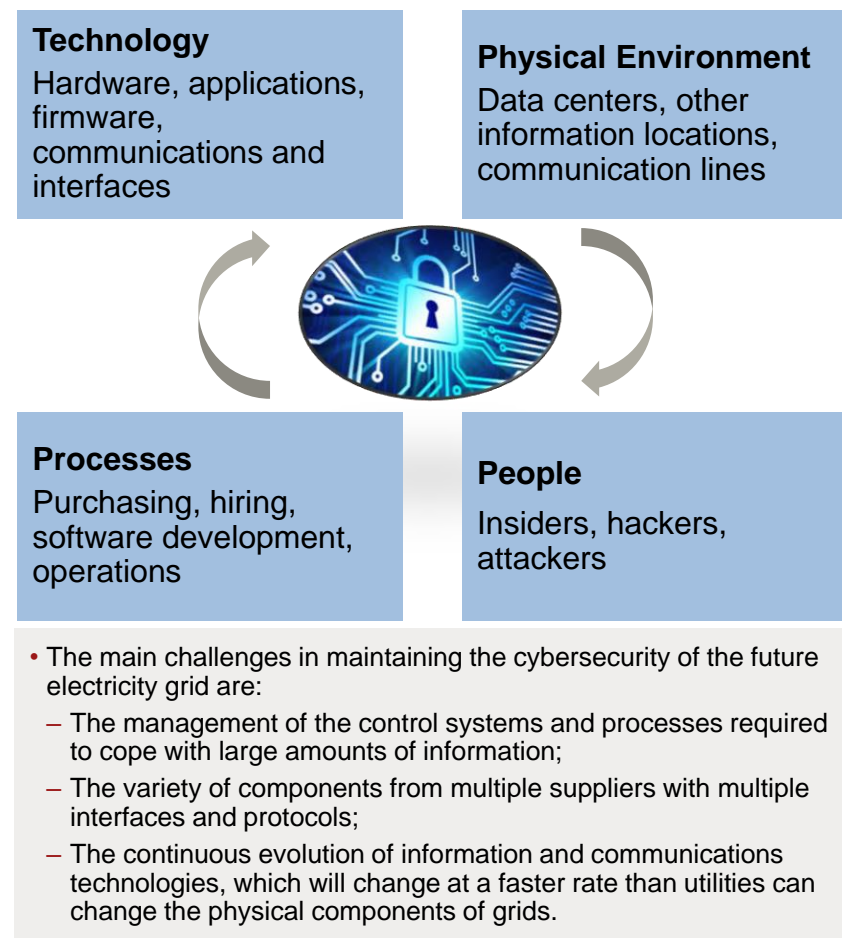

Impacts of possible Attacks on AMI

Attack Vector	Impact	Possible solutions
Physical attack on Meter	<ul style="list-style-type: none"> • Energy theft • Incorrect energy-usage data sent • Theft of energy-usage data • Disruption of electric supply 	<ul style="list-style-type: none"> • Physical locks • Detection mechanisms • Regular updates to security certificates • Encryption, keys
Denial-of-service attack on meter data collection point	<ul style="list-style-type: none"> • Denial of service to connected meters • Upstream cascading effects on utility data due to missing data 	<ul style="list-style-type: none"> • Detection mechanisms • Automated-system protection
Software attack on utility meter data management system	<ul style="list-style-type: none"> • Widespread theft of energy-usage data • Disruption of electricity supply • Disconnection of meters 	<ul style="list-style-type: none"> • Security policies to prevent unauthorized access • Detection methods

4. Status of smart-grid deployment



Main findings

4.1 Private investments

- The smart-grid market is sizeable: investment amounted to \$44 billion in 2014, with \$16 billion in digital-energy technologies alone.
- Government support kick-started investment in 2009, resulting in a flurry of investment. Since 2011, growth rates have stabilized, and investment has focused on smart meters and distribution automation.
- In the next five years, a forecast annual investment growth rate of 5% (10% in digital-energy) will be fueled by the roll-out of smart meters: 100 million were installed in 2014, and the global penetration rate is due to increase from 22% to 40% in 2020.
- Solid funding from venture capital and private equity highlight the emergence of smart grids as an essential area of clean technology.
- Major smart-grid companies are located in the U.S. and Europe.

4.2 Public initiatives

- The U.S kick-started smart-grid investments in 2009 with \$4.5 billion of public-funding commitments.
- In Europe, €3 billion of public funds have been allocated since 2006 to help companies invest in smart-grid projects.
- Smart-grid initiatives continue to expand globally, with increasing momentum all around the world.


4.3 RD&D landscape

- The number of smart-grid patents filed increased by 17% a year between 2000 and 2010.
- Most smart-grid technologies are in the demonstration and deployment stages, further highlighting the dynamism of this growing sector.

Global smart-grid revenue is estimated to grow by 5.3% a year until 2023

Smart-Grid Revenue by region, world markets

\$ billion

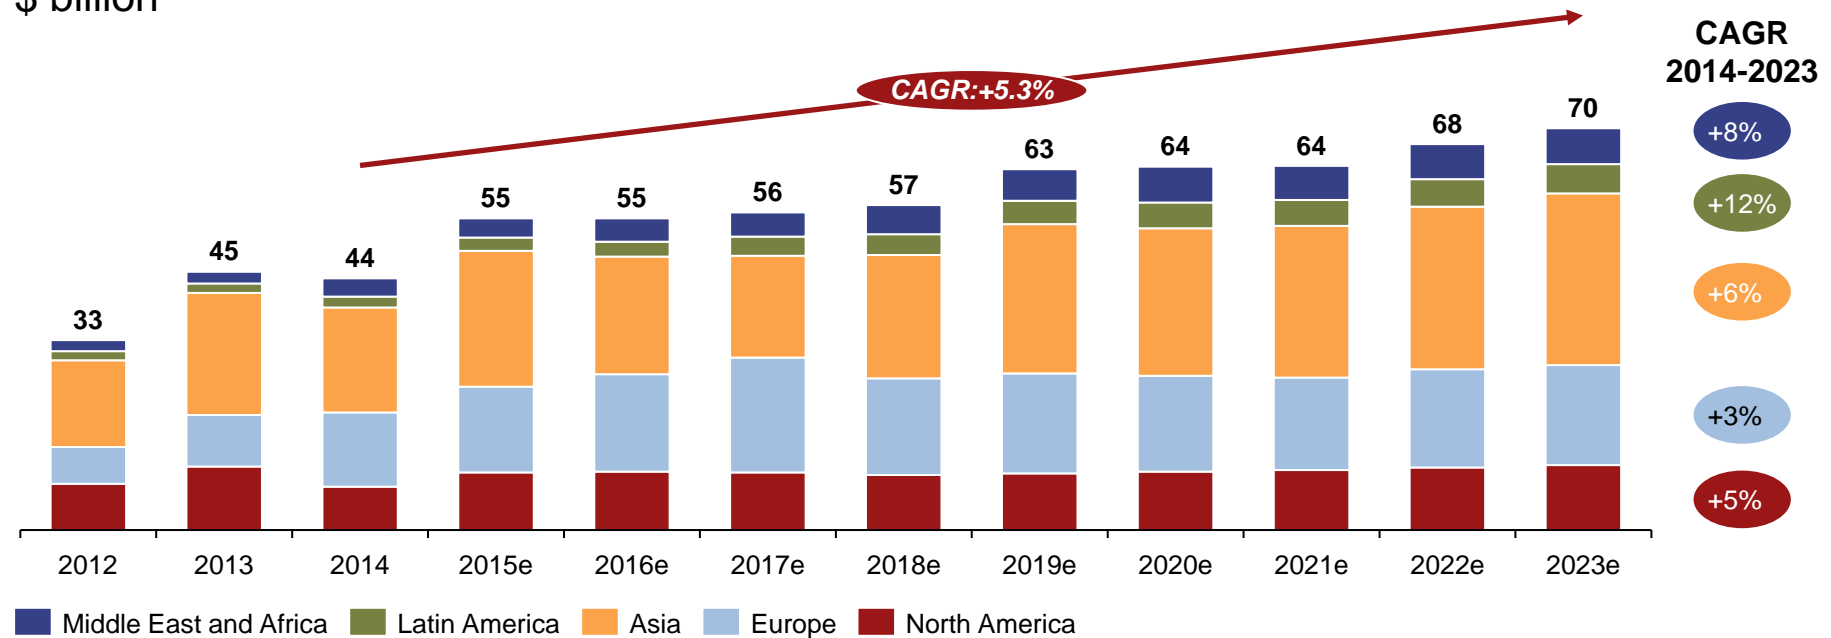


- Global smart-grid revenue¹ is expected to rise from \$44 billion in 2014 to an expected \$70 billion in 2023, with average annual growth of 5.3% over this nine-year period.
- Africa as a whole, and many nations in other parts of the world with populations exceeding 100 million, will be virtually absent from the market until 2020.
- According to Navigant Research, the market is likely to maintain robust growth beyond 2020.

1. Smart-grid revenue includes sales from: transmission upgrades, substation automation, distribution automation, smart-grid information and communication technology, smart metering.


Source: Navigant Research (2014), "Executive Summary: Smart Grid Technologies"

Digital energy is seeing the fastest growth, despite false starts and cost overruns in demonstration projects

Digital Energy Annual Asset finance by sector

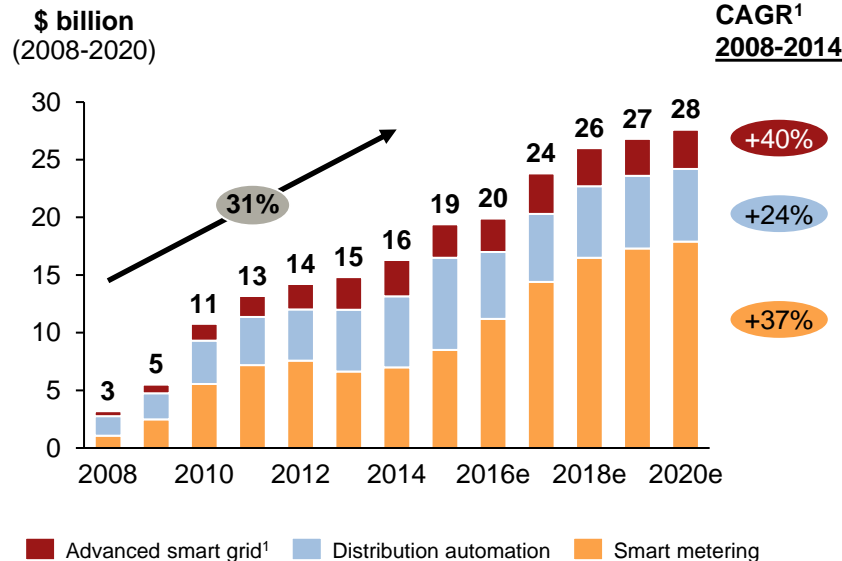

Digital Energy Annual Asset finance by region

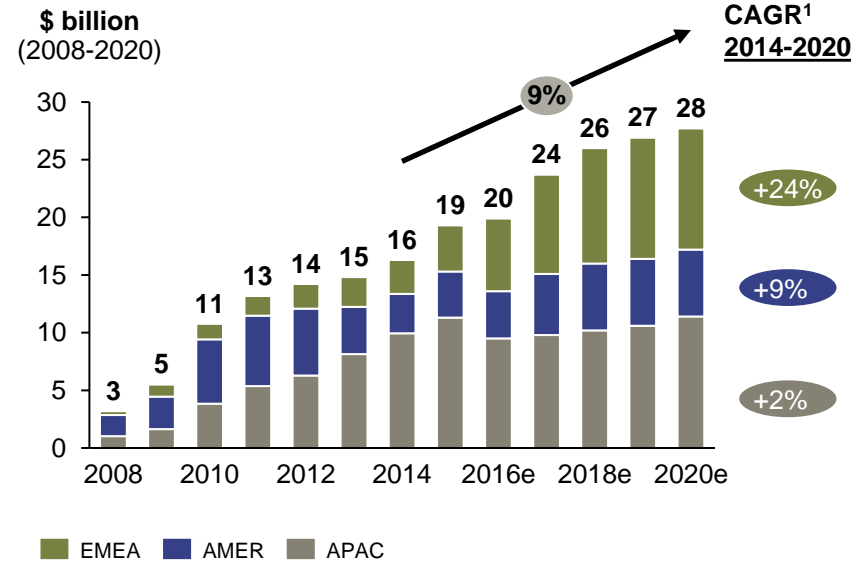


- Digital energy represents a sub-segment of the overall scope of smart grids as defined in this FactBook. It excludes capital-intensive power infrastructure for transmission-network enhancements, such as new HVDC lines and FACTS, etc..).
- The 2009 American Recovery Act in the U.S. kick-started asset finance. A smart-metering roll-out program in China has rapidly caught up, while Europe is expected to step up digital energy investments in the second half of the decade.
- According to IEA (2015), “Despite false starts and cost overruns deployment of some sub-categories of smart-grid technologies has grown quickly in early adopter markets. However, regulatory bottlenecks, and unrealistic expectations are preventing smart-grid technologies from reaching the required levels. (...) Overall, evidence that some expectations were unrealistic has tempered initial enthusiasm surrounding smart grids – and yet benefits have been realised from advanced metering infrastructure and distribution automation.”


1. Advanced smart grid refers to cross-sector projects; EMEA: Europe, Middle East and Africa; AMER: North, South Americas; APAC: Asia and Pacific.
Source: BNEF, Committed funding, database extraction (may 2015); BNEF (2015), “Q1 2015 Global Digital Energy Outlook”; IEA (2015), “Energy Technology Perspectives”

One-third of existing electricity meters should be smart by end-2018, representing over 800 million devices

Annual deployment of Smart Meters

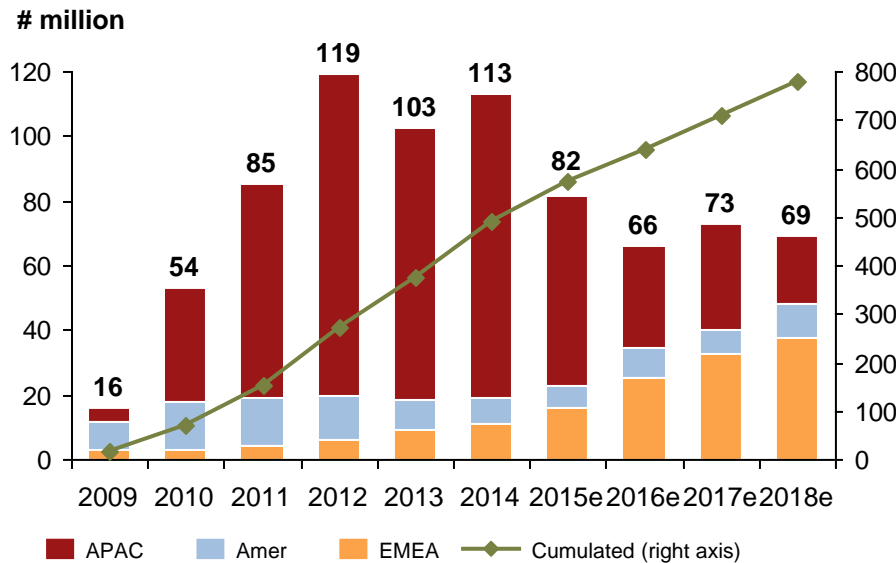

Smart-meter Penetration 2013-2023

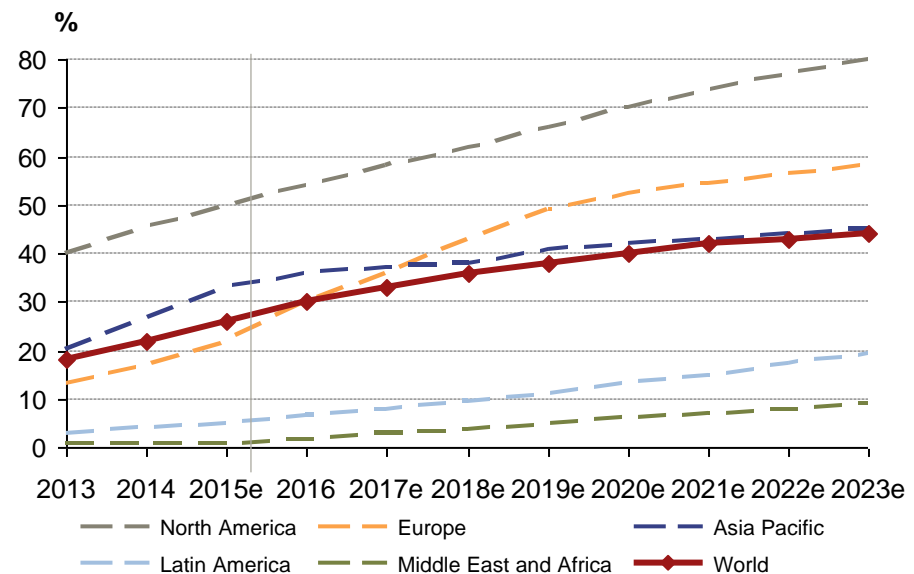


- The U.S. pioneered deployment of smart meters – motivated by the individual economic choices of regional utilities, with half of consumers equipped with smart meters in 2015, compared with 26% globally.
- Since 2010, Asia-Pacific countries, especially China, have shown particular interest in this technology and installed more than 75 million units per year between 2010 and 2014.
- Europe is set to catch up by the end of the decade in order to comply with the European mandate on smart-meter penetration.
- By 2018, more than one meter out of three should be smart globally, representing almost 800 million devices, mainly deployed in China, the U.S. and Europe.


The interest of private investors in digital-energy technologies intensified after 2008 but have eased since 2011

Private sector deals in digital energy¹ technologies during 2008-2014

\$ million (2008 – 2014)

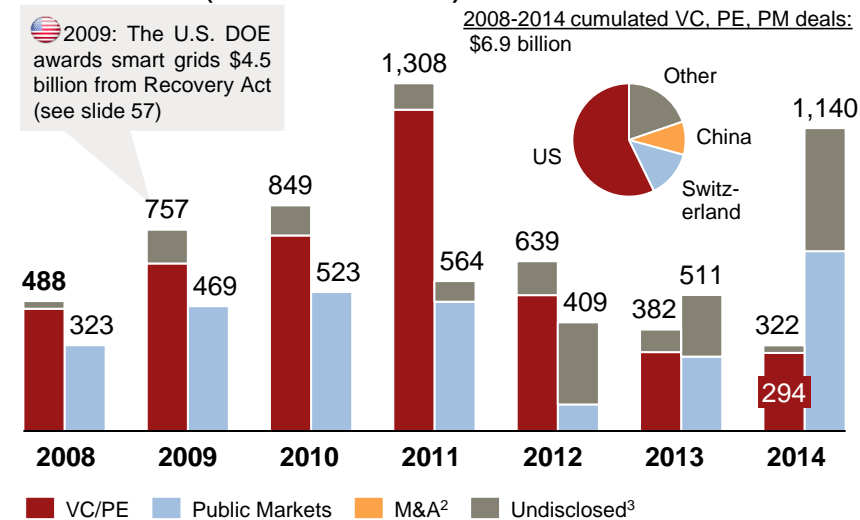

deals (2008 – 2014)

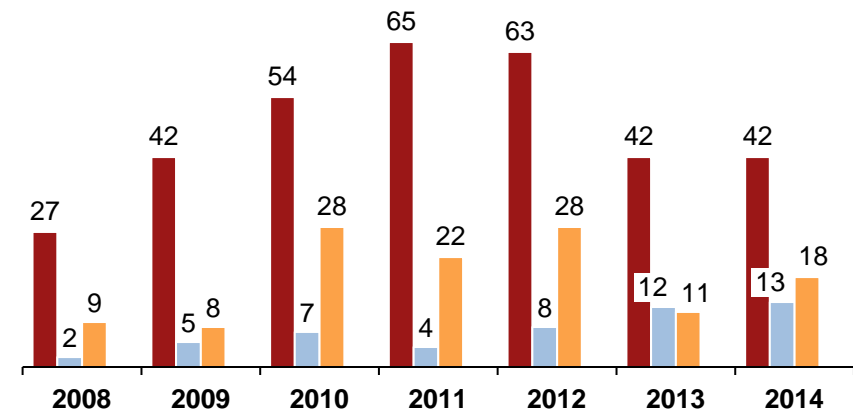

- Early money raised by venture capitalists and private equity funds for new digital-energy technologies intensified after 2008, principally in the U.S., in parallel with the announcement by the U.S. Department of Energy of a \$4.5 billion commitment to smart grids. Since 2011, however, committed funds and numbers of deals seem to have returned to pre-2009 levels.
- By contrast, new equity raised through public markets in the later stages of development has grown more steadily, which is indicative of a maturing technology trend.
- The increase in mergers and acquisition deals since 2010 is evidence of the private sector's dynamism in digital energy.


1. VC: Venture Capital; PE: Private Equity; M&A: Merger and Acquisition; 1 Digital energy includes: demand response, home energy management, micro-grid, smart grid, smart metering, smart T&D and software; 2 M&A funding was not included in the left-hand graph for improved readability; 3 Undisclosed figures were calculated as the sum of products of undisclosed deals by the average price of a deal over the seven-year period.

Source: Bloomberg New Energy Finance database (April 2015)


Venture capitalists remain highly interested in digital-energy technologies, which are among the hottest clean-energy investments

Funds raised via venture capital and private equity for clean technologies in 2014

\$ million (2014)

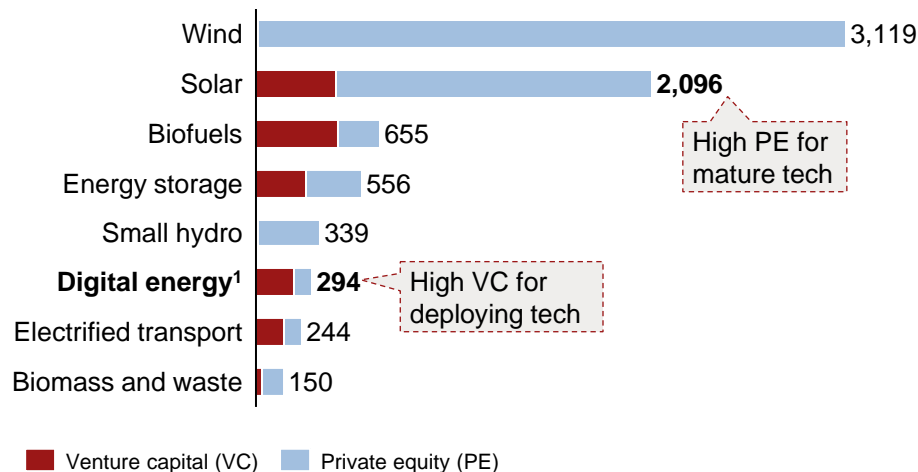

deals (2014)

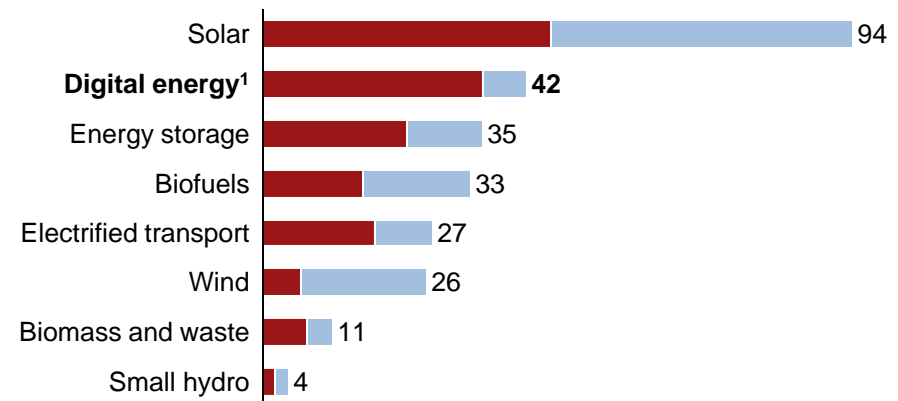





































- Solar and wind are mature technologies, with much bigger markets than the other technologies listed above. The considerable involvement of private-equity funding in these two segments of the renewable-energy business further underlines their maturity.
- Venture-capital funding, by contrast, tends to indicate emerging technologies and start-ups in emerging business areas.
- Digital energy¹ accounts for the second-highest number of venture-capital deals and the third-largest amount raised, of all new energy technologies. When energy storage is also considered, these two grid-related technologies comprised the hottest clean-energy start-up investments in 2014.

1. Digital energy includes: demand response, home-energy management, micro-grids, smart grids, smart metering, smart T&D and software.
Source: Bloomberg New Energy Finance, Committed funding, database extraction (2015)

The smart-grid market is currently dominated by American and European companies










Main players in Smart-Grid monitoring and control

Grid automation	Smart metering components	Smart meters	Communications	Data management	Smart-grid software	Installation and system integration
Alstom Grid SAS/OLD 	Ember Corp 	Landis + Gyr SAS 	Alstom Grid SAS/OLD 	Landis + Gyr SAS 	Alstom Grid SAS/OLD 	
Smart Grid Solutions Ltd 	Advanced Digital design SA 	Utilitywise Plc 	Advanced Digital design SA 	Engage Networks Inc 		Engage Networks Inc 
Current Group LLC 		Elster Medicao de Energia Ltda 				Smart Grid Solutions Ltd 
BPL Global Ltd 		Landis & Gyr Holdings Pty Ltd 				Utility Integration Solutions Inc 
		ZIV aplicaciones y tecnologias SL 	CURRENT Group LLC 			
		GE Fuji Electric Meter Co Ltd 	BPL Global Ltd 	Metor A S 		
		Itron Inc 				
		EMH Metering GmbH & Co KG 	Electralink Ltd 			
		Wasion Group Holdings Ltd	Silver Spring Networks Inc 			
			Nuri Telecom Co Ltd 	Prime Alliance 		
			Ambient Corp 	Ecologic Analytics LLC 		
			Tantalus Systems Corp 	Lodestar Corp 		
			Power Plus Communications AgG 	eMeter Corp 		
			SmartSynch Inc 			




















American companies are especially dominant in end-user solutions

Main players in demand response and Home Energy Management

Demand response

Service providers	Technology providers
Entelios 	Utility Integration Solution Inc 
Constellation Energy 	Powerit Solutions LLC 
EnergyConnect Inc 	BPL Global Ltd 
EnerNOC Inc 	Cooper Power Systems LLC 
Comverge Inc 	EnergyICT NV 
Flexitricity Ltd 	
Groom energy solutions LLC 	
Honeywell Building SolutionsGmbH 	
Schneider Electric SE 	
Applied Energy Group 	
Global Energy Partners LLC 	


Home energy management

Smart appliances	In-home displays	Communications components
Comverge Inc 	Intamac Systems Ltd 	Coronis SAS 
EcoFactor Inc 	Passiv Systems Ltd 	Zensys 
	Energate Inc 	ZigBee Alliance 
	EnergyHub Inc 	Ember Corp 
	Tendril Networks Inc 	Watteco SAS 
	Comverge Inc 	EnOcean GmbH 
	Green Energy Option Ltda 	
	Advanced Telemetry LLCa 	
	AlertMe Ltd 	
	Onzo Ltd 	
	Blue Line innovations Inca 	

Large public-funding commitments kick-started smart-grid investments in 2009

American Recovery and Reinvestment Act

- The **American Recovery and Reinvestment Act of 2009 (ARRA)** created an economic stimulus package that aimed to generate jobs through investments in infrastructure (\$105 billion), education (\$100 billion), health (\$155 billion), energy efficiency and renewable energy research (\$27 billion).
- Of the \$105 billion investment in infrastructure, \$21 billion are dedicated to energy infrastructure:

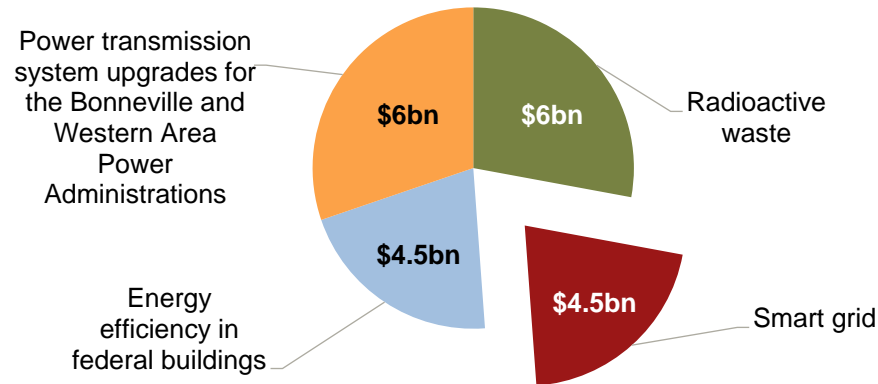


- The \$4.5 billion U.S. fund for smart grids includes two key programs:
 - **Smart Grid Demonstration Program (SGDP)**, designed to encourage smart-grid R&D (\$600 million, 32 R&D projects);
 - **Smart Grid Investment Grant (SGIG)**, designed to support commercial-scale smart-grid projects (\$3.5 billion, 99 projects);
 - A further \$400 million has been set aside for projects such as workforce development and interconnection transmission planning.

The U.S.DOE initiative is the world's largest public smart-grid-funding plan, with \$4.5 billion committed for RDD&D projects since 2009

U.S. public expenses in Smart Grid R&D under the SGDP program \$ millions

Total cumulated¹

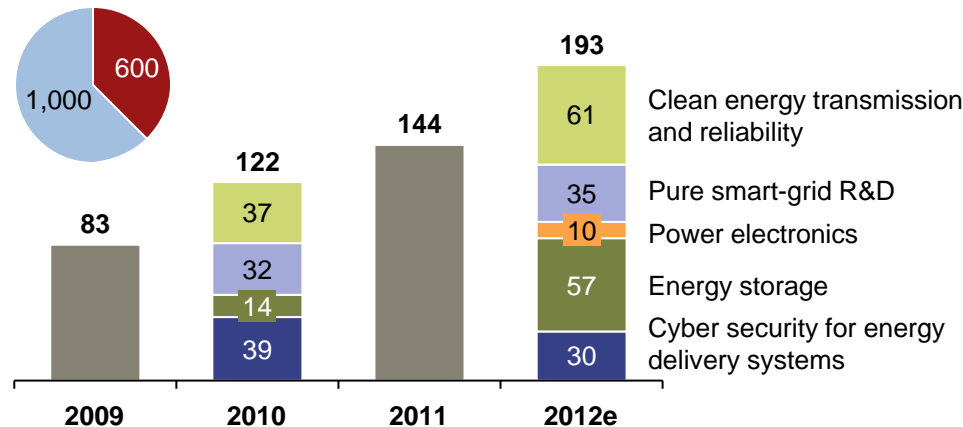


Public Private

- **The Smart Grid Demonstration Program (SGDP)** demonstrates how a suite of existing and emerging smart-grid concepts can be innovatively applied and integrated to prove technical, operational, and business-model feasibility. The program consists of 32 projects.

U.S. expenses in Smart Grid D&D under the SGIG program (private + public)

Total cumulated¹

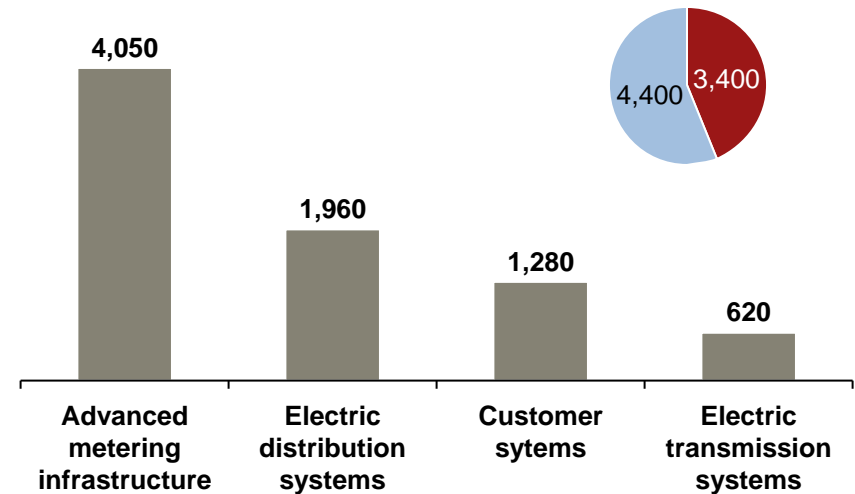


- **The Smart Grid Investment Grant Program (SGIG)** is one of the largest federal investments in new technologies for electric power delivery since the Rural Electrification Act of 1935. It aims to achieve, by 2030:
 - 20% reduction in the nation's peak energy demand;
 - 100% availability to serve all critical loads at all times;
 - 40% improvement in system efficiency and asset utilization;
 - 20% of electricity capacity from renewable energy sources.


1. RDD&D: Research Development Demonstration & Deployment; 1 Cumulated funding expected over the program duration.

In Europe, €3 billion have been allocated so far to foster investment in smart-grid projects

Annual investments in EU Smart-Grid RDD&D projects € million

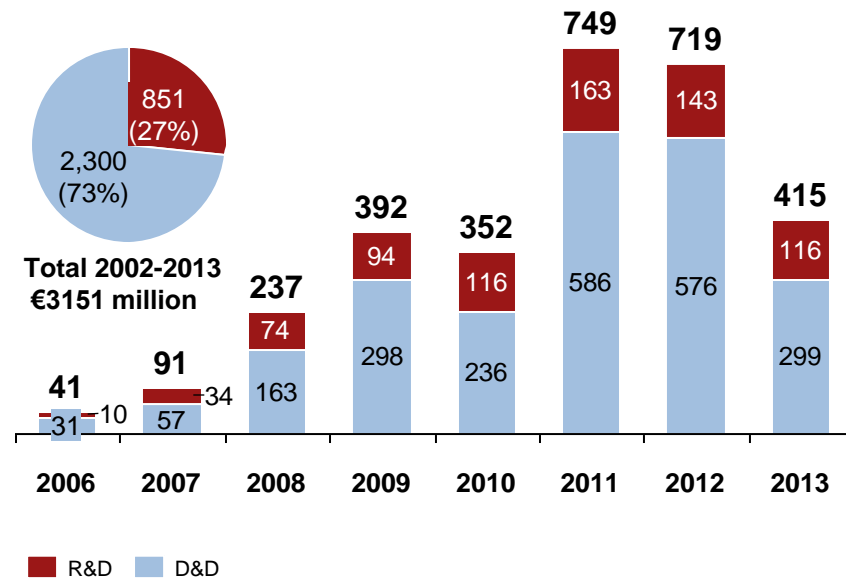

Source of funding of EU Smart-Grid RDD&D projects (2002-2013 cumulated) € million

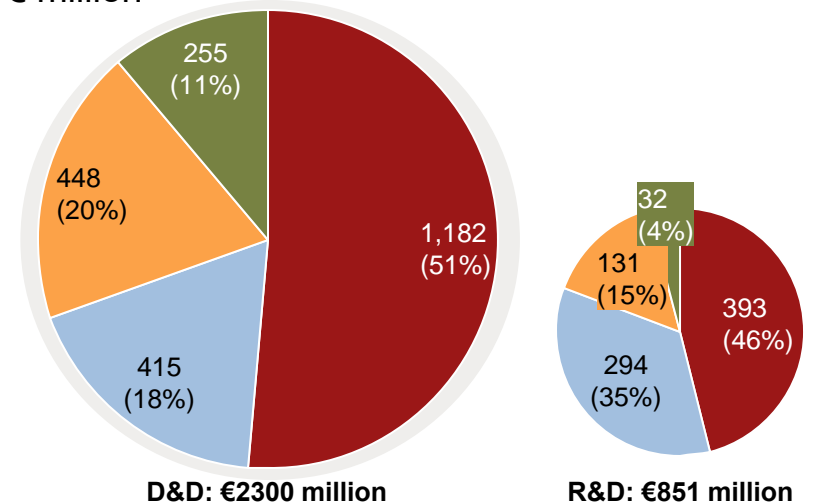


- Smart-grid investments have increased in Europe in the past five years, fuelled on average by 50% public funding.
- The increase in D&D investment compared with R&D indicates that firms are confident certain innovations are reaching commercialization.

1. RDD&D: Research Development Demonstration & Deployment; 1 Cumulated funding expected over the program duration.


European RDD&D provides a test bed for cross-border research initiatives that will prove integral in the selection of successful smart-grid technologies

Origin of funding for smart-grid rdd&d, top-10 EU countries (2002-2014 cumulated)
€ million

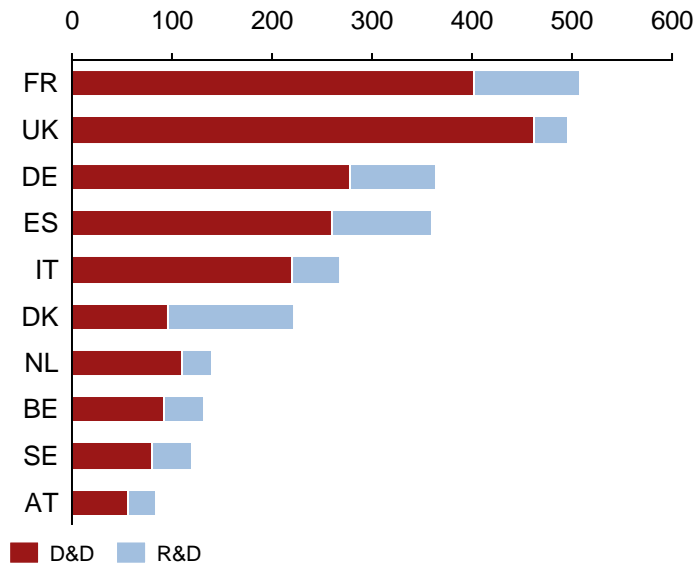

- RDD&D investments in Europe are concentrated in the EU15 nations, which are those with electricity grids in the greatest need of renovation.


Technology choice for EU Smart-Grid RDD&D (2002-2013 cumulated)
€ million

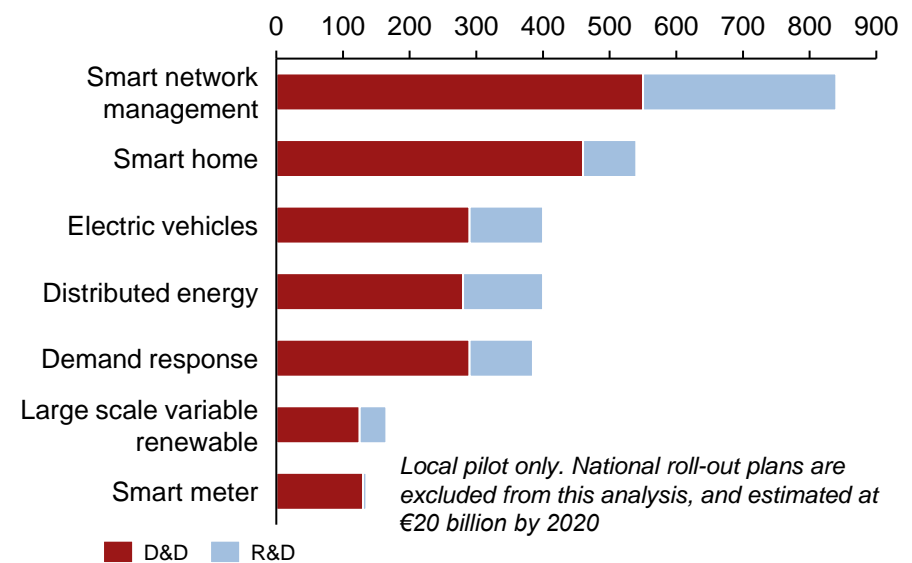

- Network-management systems, aiming at improving the operational flexibility of the large, interconnected European electricity grid receive the most investment.
- The forecast roll-out of nearly 200 million smart meters by 2020 should also drive very large investments in the near future.

The expansion of smart-grid initiatives globally is continuing and gathering momentum

Selected Smart-Grid Initiatives

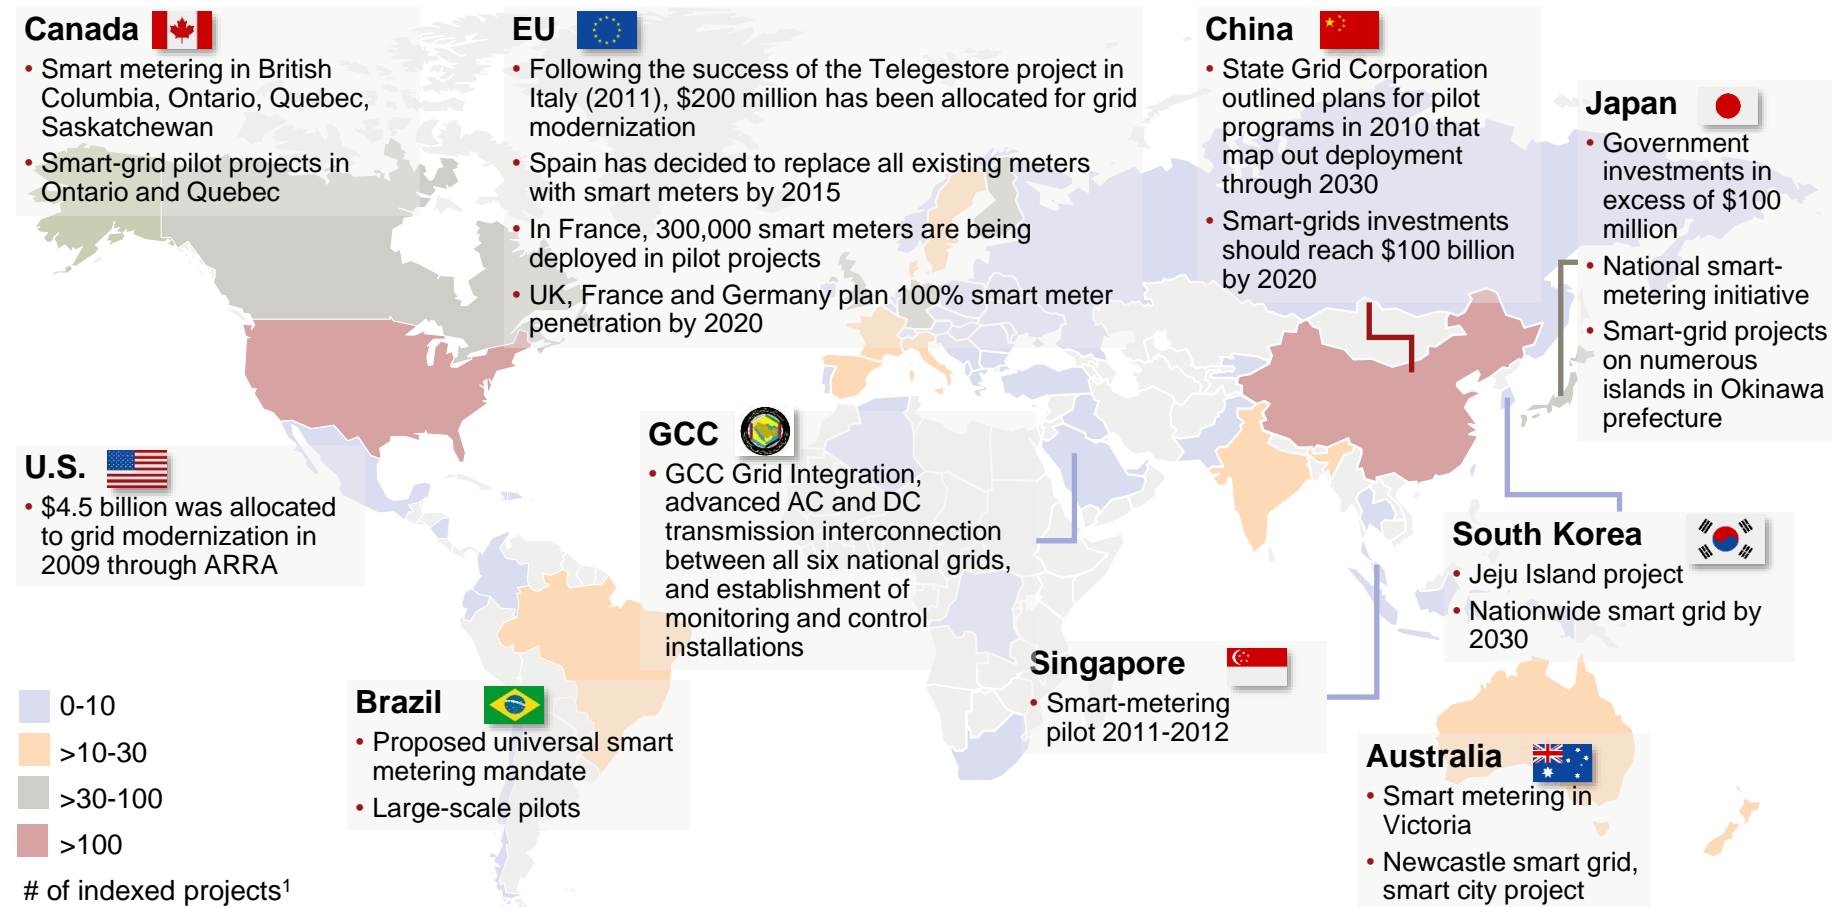


1. Adapted from Bloomberg New Energy Finance (2013).

Source: Bloomberg New Energy Finance (2013), "Smart Grid Projects" (planned or commissioned); IEA (2011), "Technology Roadmap, Smart Grids"

ISGAN network has listed 98 smart-grid demonstration projects globally, mostly targeting end-user technologies

Smart-grid demonstration projects by country and category

Number of Projects¹

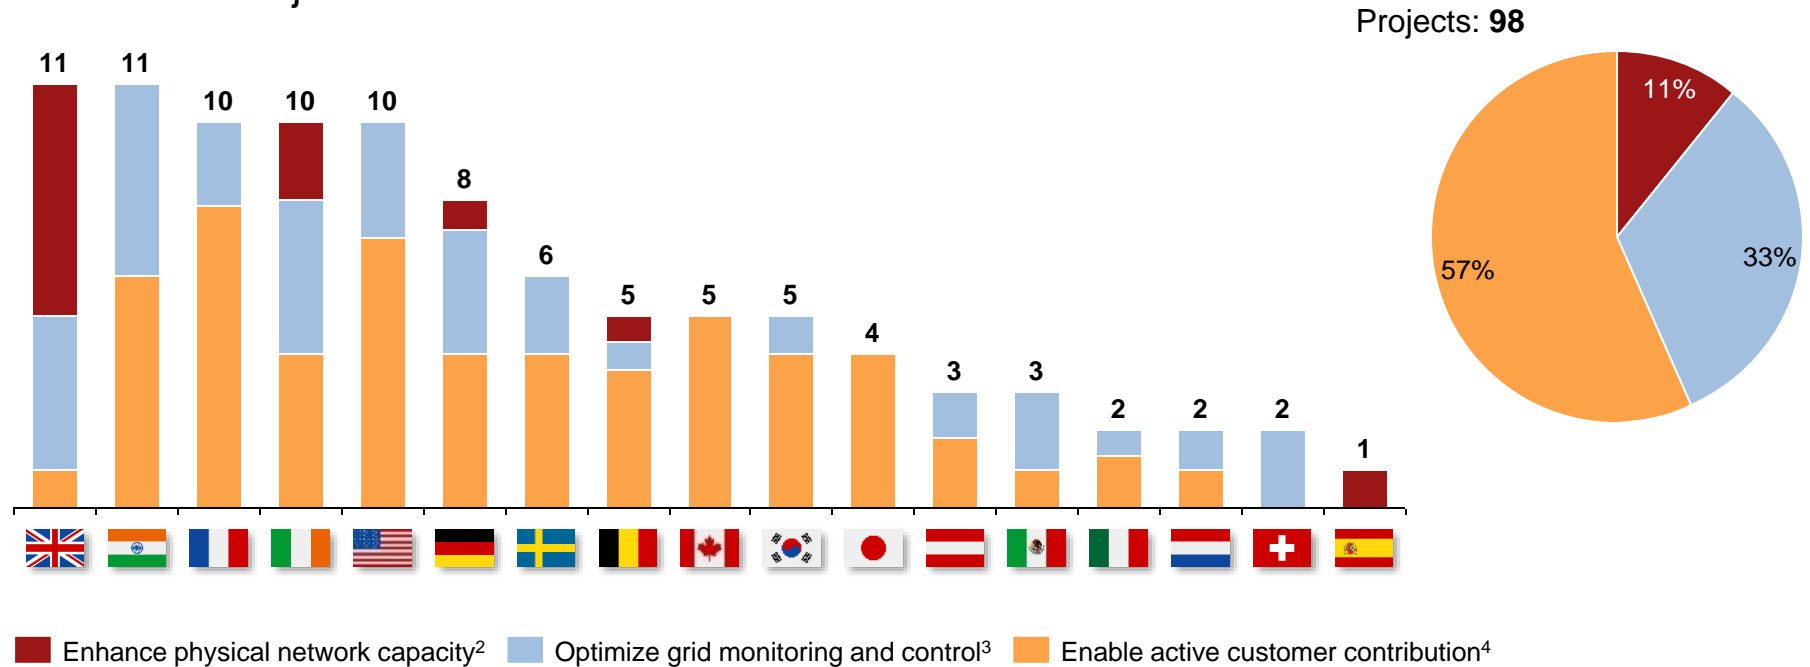


- The Implementing Agreement for a Cooperative Program on Smart Grids resulted in the creation of the International Smart Grid Action Network (ISGAN) at the first Clean Energy Ministerial, in 2010. ISGAN was set up in order to establish a platform for the coordination and collaboration of projects in smart-grid technologies.

1. Some projects have more than one application. For example, Italy has two projects but they relate to three different applications: each contribution, therefore, is calculated as one-third of two; 2 Enhance physical network capacity: integration of large scale VRE; 3 Optimize grid monitoring and control: smart network management; 4 Enable active customer contribution: smart metering, integration of DG, smart customer/home, demand response, virtual power plant, electrical vehicle (EV), vehicle to grid (V2G).
Source: ISGAN (2013), "Smart Grid project catalogue: part 2, by contribution to policy goal"; IEA (2015), "ETP 2015"

The number of patents covering smart grid innovations has grown precipitously since 2000, with filings predominantly located in the U.S.

Smart-Grid patents filed by year


Thousands of documents per year¹

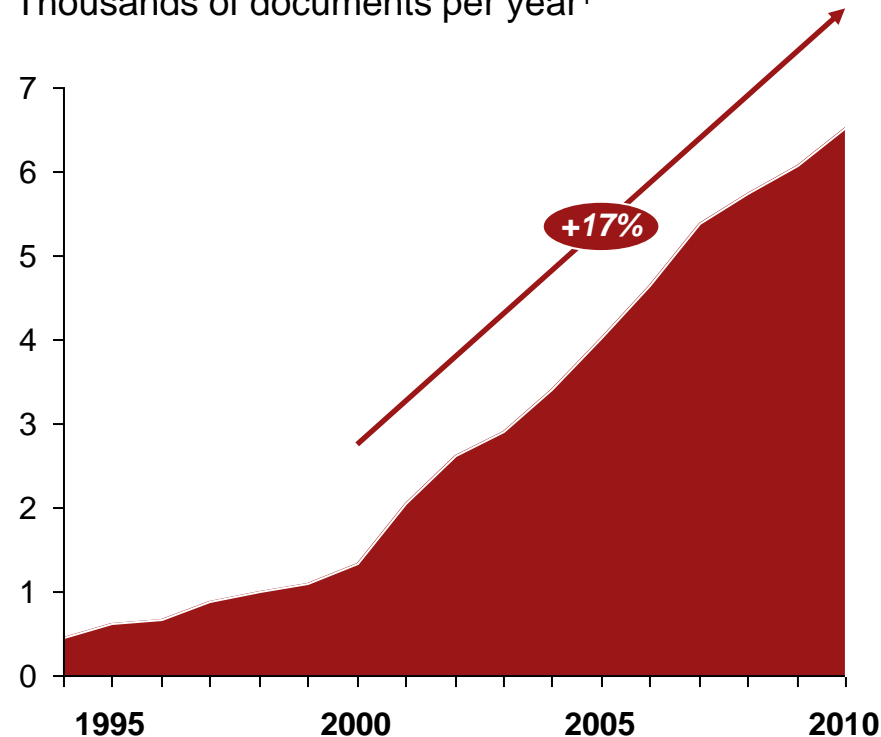

- Since 2000, the number of filed patents has grown by approximately 17% annually.

Patent filing location

Cumulative patent filing registered² (1994-2012)

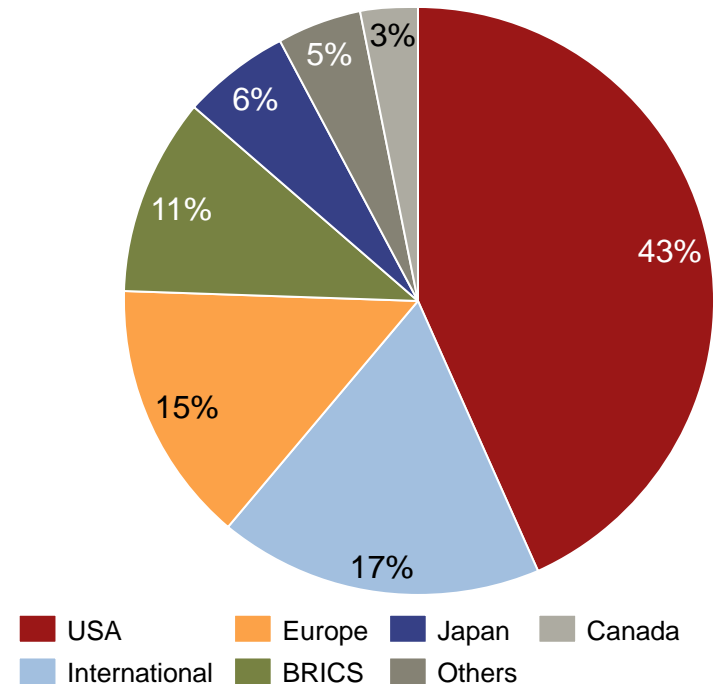

- Over 60,000 patents for smart-grid technologies have been filed.
- The most common patent types involve transmission and distribution components, and information systems.


1. Post-2010 applications have not yet been published in their entirety; 2. Cumulative applications and grants per location of filing: International represents the World Intellectual Property Organization (WIPO), a United Nations agency; European filing location: European Patent Office & UK Intellectual Property Office.

Source: Relecura (2013), "Smart Grid Patent Analysis"

Smart-grid technologies display highly variable levels of maturity

Smart-Grid Technology maturity curve

Click on each icon to navigate to the associated FactCard in Appendix

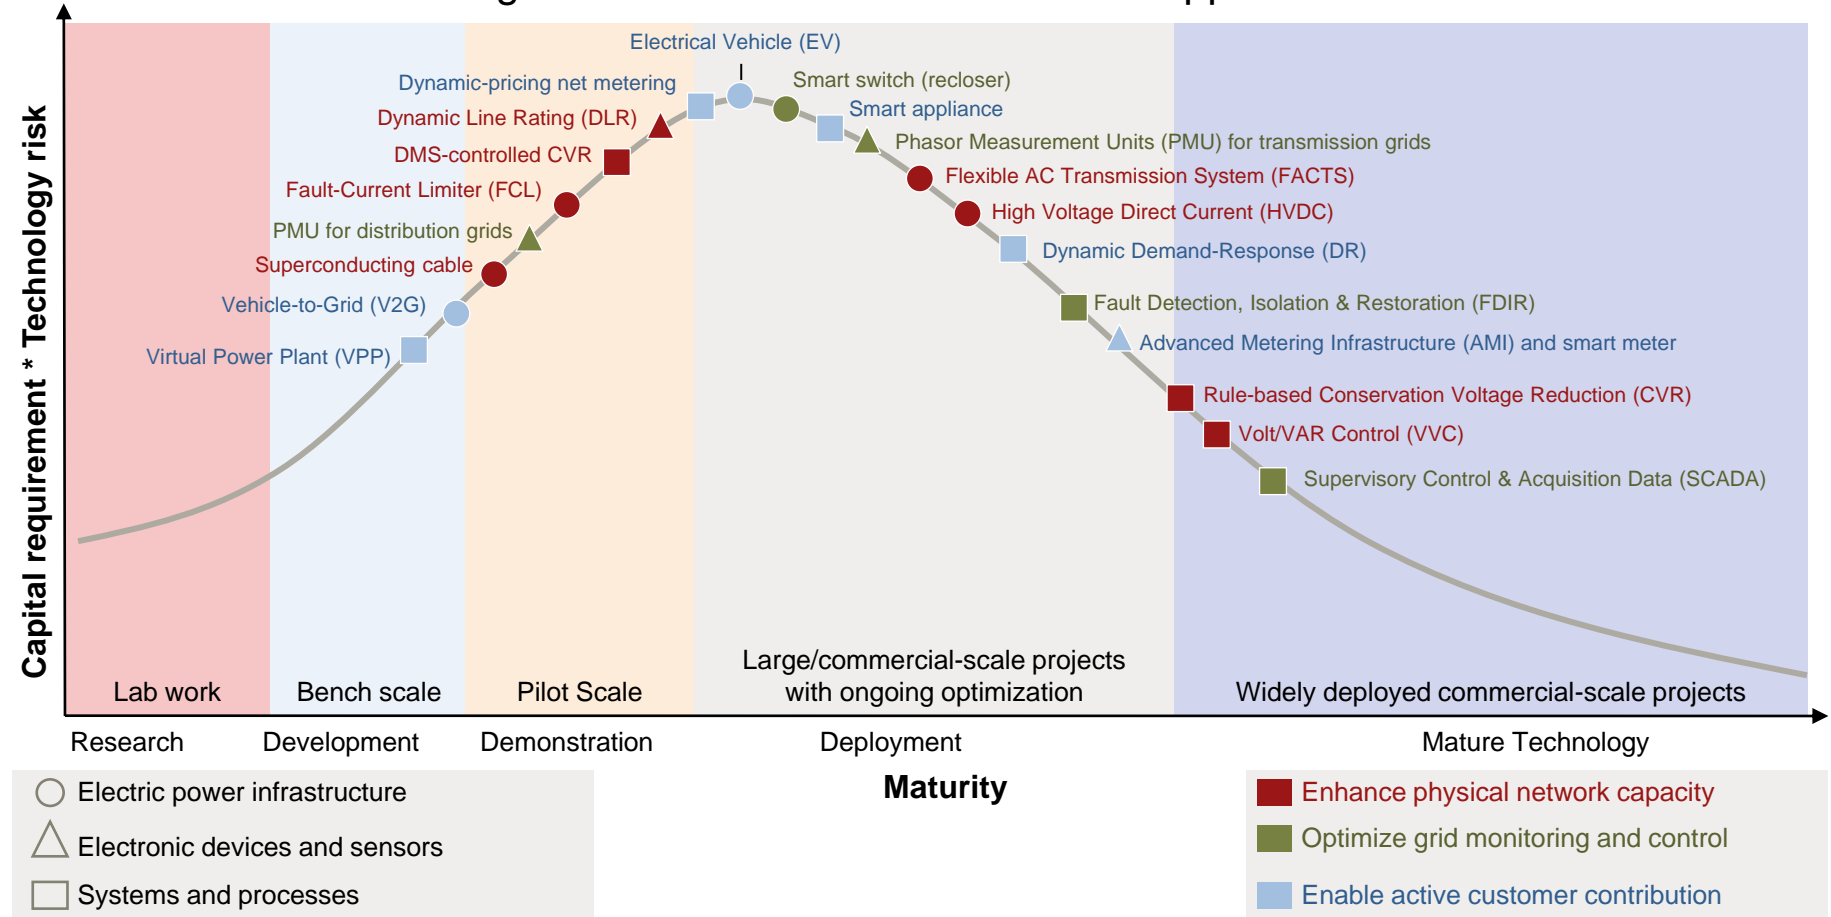

Note: DMS: Distribution Management System.
Source: A.T. Kearney Energy Transition Institute analysis

5. Regulation and policy



Main findings

5.1 Evolution of grid regulations

- Grid regulation is moving away from the traditional natural monopoly and vertically integrated structure, and new entrants are transforming the competitive landscape.
- Electricity markets are starting to unbundle, making smart-grid business models more complex to design.
- T&D utilities' profit margins are still regulated locally, so smart-grid business models must be tailored to each country's regulatory framework. Remuneration models, regulation incentives, revenue structures for utilities might differ from one country to another, depending on national regulations.

5.2 Best practices

- Governance and international institutions have an essential role in limiting certain types of risks in the financing of smart-grid projects. For instance, Public Finance Mechanisms (PFMs) support stakeholders, investors and the viability of energy projects.
- Collaboration among industries, regions and technologies in standardization and best practices are vital to smart-grid deployment.



The history of the 20th century electricity grid has resulted in a market dominated by the concept of the “natural monopoly” and increasing economies of scale

Market structure and the traditional electricity grid in Europe and in the U.S

Natural monopoly theory in practice


- The capital requirements of the expansion of the electricity industry were substantial. However:
 - Economies of scale were significant: a continued trend saw costs drop from \$5 per kWh to \$0.05 per kWh between the 1880s and the 1970s;
 - The customer base was expanding exponentially;
 - Electrification of various domestic and professional devices only intensified demand growth.
- Executives persuaded law-makers and regulators that allowing competition would create redundancies and drive electricity prices below the level needed to cover long-term costs, arguing in favour of a “natural monopoly”.
- Without competition eroding revenue, vertically integrated utilities could now set rates that would guarantee the recuperation of costs and establish a profit margin, which created a cycle of lower costs to lower prices to higher demand.

Benefits of monopolistic market structure

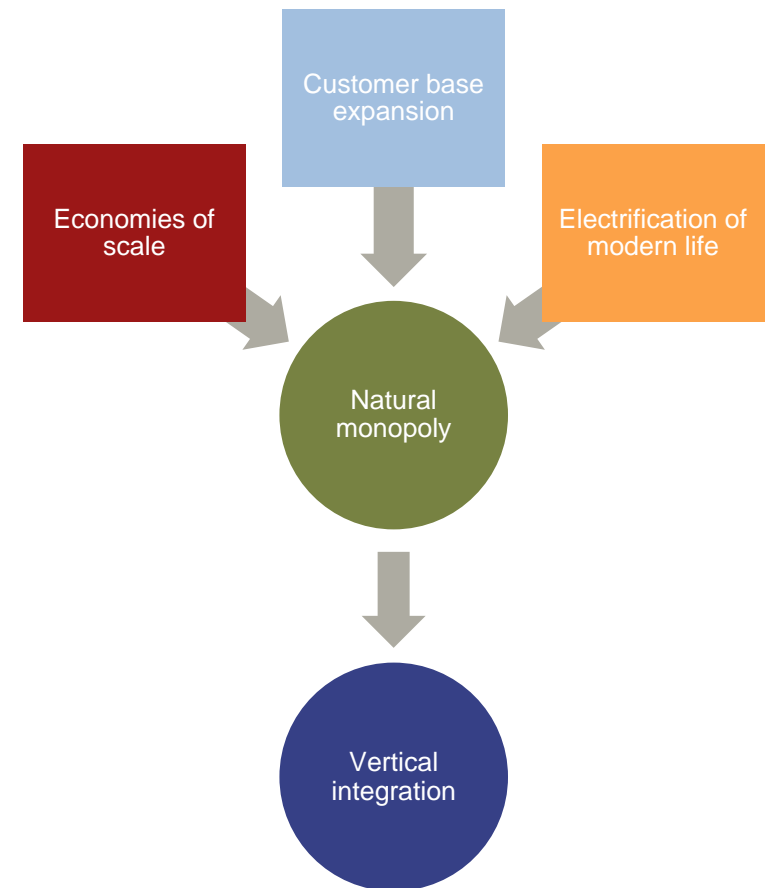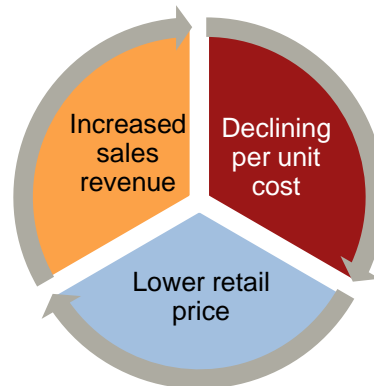

Networks have become more regulated and complex, as domestic grids become interconnected internally and externally


A short history of electricity networks

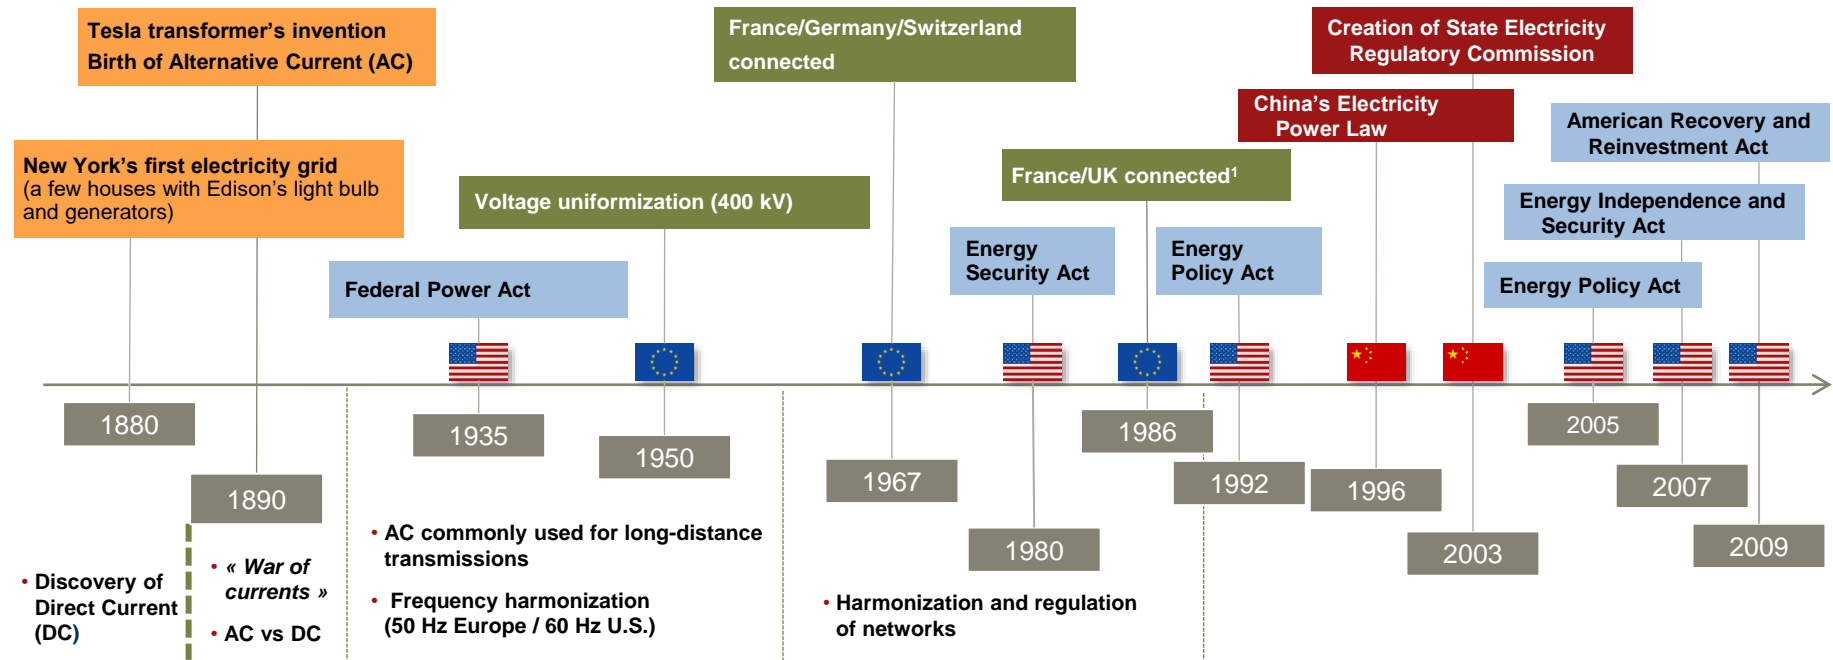

1. First cross channel link completed in 1961 but decommissioned in 1984 (160 MW), 2GW since 1986 and still today.
Source: Institute for energy research - IER, (online), "History of electricity"; Official governments announcements (online)

As electricity markets are unbundling, competition puts downward pressure on prices, but makes smart-grid business models more complex to design

Evolution of the electricity market structure

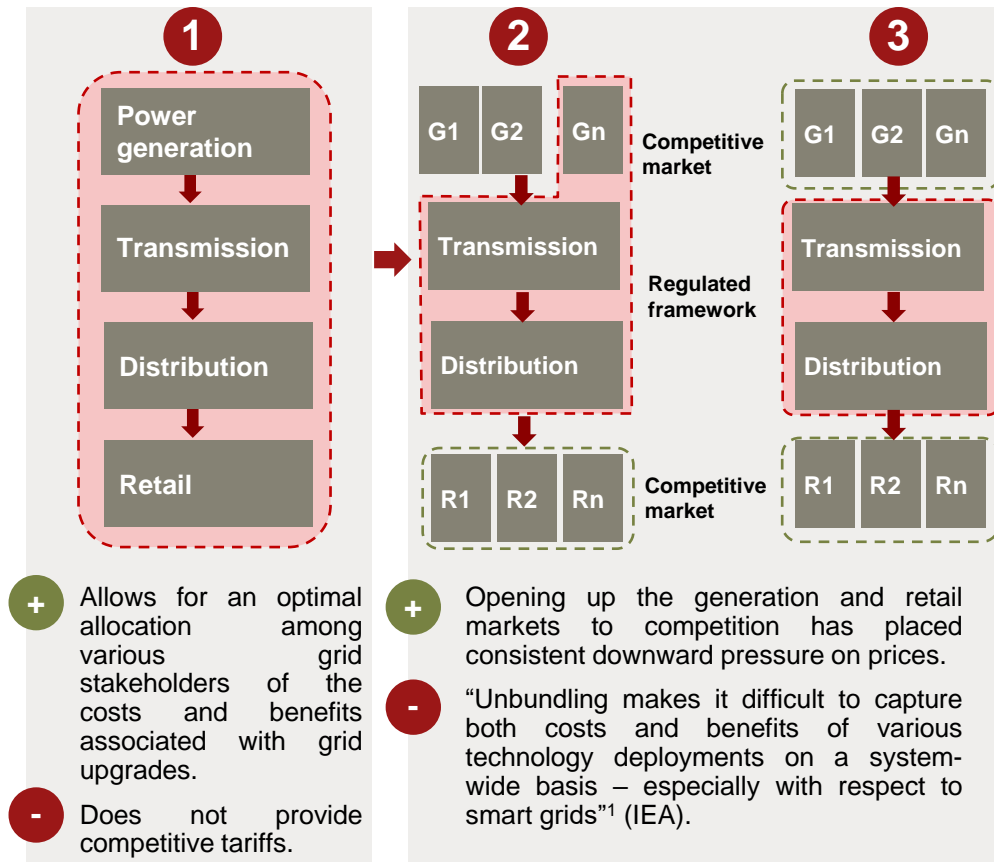

1 Vertically integrated market

- The utility in charge of the power generation and supply owns the transmission lines.

2 Independent Transmission Operator (ITO):

- Previous monopolies retain ownership of the transmission network, but legally independent transmission subsidiaries are created to open up transport networks to competition.


3 Ownership unbundling:

- Total separation between the supply/generation and transmission owner.
- One of the key aims of the EU's "3rd Energy Package" (legislative package to open up the gas and electricity markets in the EU, adopted in 2009) is to ensure that transmission is unbundled or independent from generation, production and supply interests and that this is certified as having been done. Thus the aim of the European Commission is to increase the numbers of competing generation and retailing firms in each national market and to reduce the market shares of former monopoly incumbents

1. "Smart-grid investments are likely to be deployed more rapidly in vertically integrated utilities where the business case can more easily be made. In the many areas where this is not possible, more strategic co-operation between distribution-system operators and transmission-system operators is needed. The unbundling of electricity markets has introduced benefits and complexity to the electricity sector." (IEA).

New players are entering electricity-grid businesses, as the market's structure changes, integrating more digital-technology providers



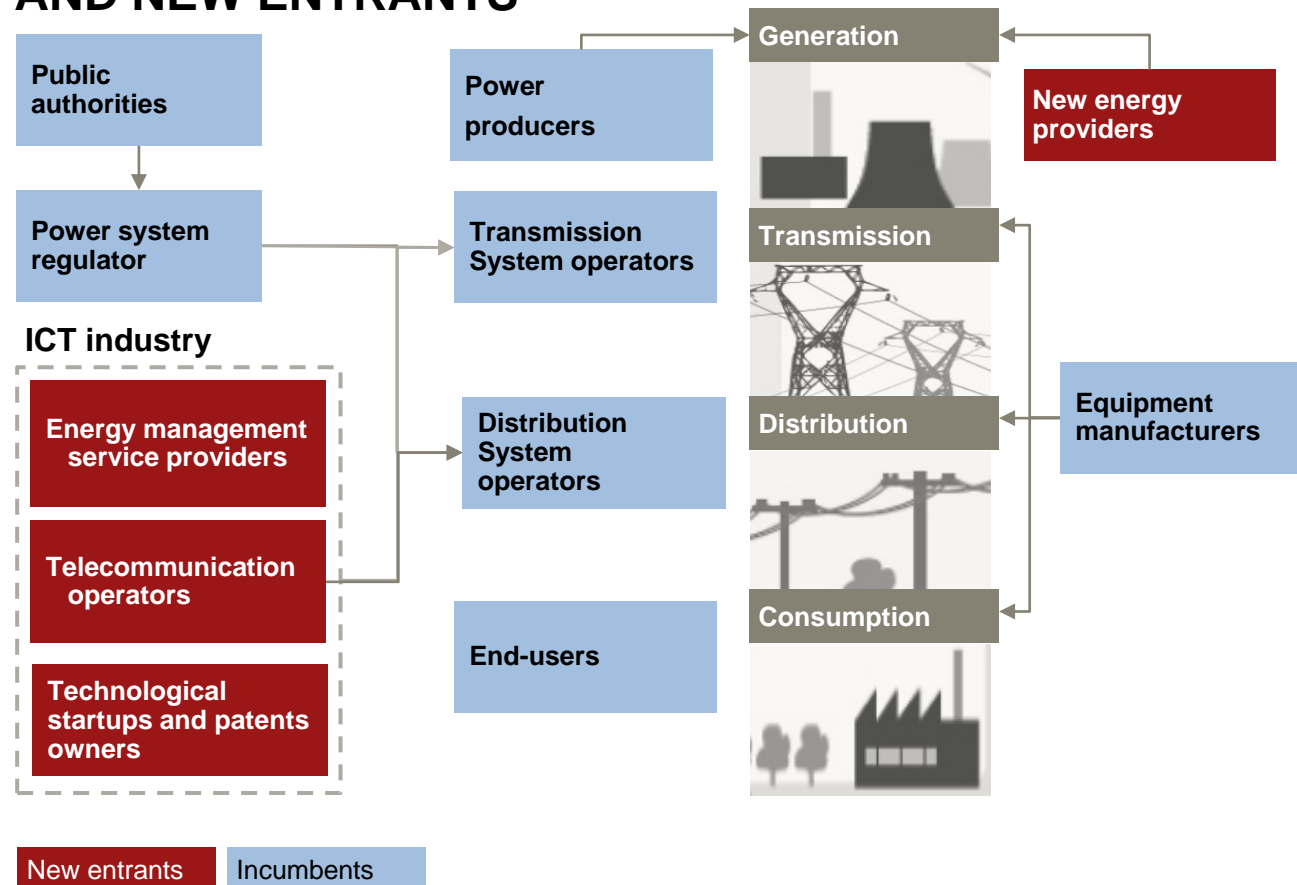

ELECTRICITY VALUE-CHAIN STAKEHOLDERS: INCUMBENTS AND NEW ENTRANTS



- There are new collaborations between the ICT industry and T&D system operators: Partnership are important for the development of demonstration scale projects and technology deployment.
- New energy providers compete with traditional power producers, through decentralized power generation or Virtual Power Plants (VPP, see Appendix 6.3 slide 99).

As T&D utilities' profit margins remain regulated, smart grid business models has to be tailored to each local regulation

Regulatory frameworks and objectives in four states/countries


	 France	 Japan	 California (U.S.)	 UK
Remuneration model	Rate-Of-Return (ROR) model <ul style="list-style-type: none"> Regulator defines the operator's estimated tariff income for the period under consideration, based on a business plan submitted by the operator During periodic regulatory reviews, the regulator examines the utility's base rate, cost of capital, operating expenses, and overall depreciation. Expenditures that are deemed appropriate by the regulator are added to the base rate in order to estimate the total revenue needed for the firm to cover its expenses fully Rate of return is set by using conventional cost-of-service methodology (Weighted Average Cost of Capital) 			RPI-X revenue model (Performance-Based Rate: PBR) <ul style="list-style-type: none"> Regulatory method based on price caps and periodic reviews (both set every five years by a regulator) The utility can fix a price at a maximum amount decided by the regulator Rates are back-calculated from a revenue target
Regulation incentives	<ul style="list-style-type: none"> Under consideration by the regulator body 	Yardstick incentive <ul style="list-style-type: none"> This involves comparing the utility with its own past performance and benchmarking the efficiency and performances of the three other utilities 	Incentive for quality service based on penalties and rewards <ul style="list-style-type: none"> The regulator sets up quality standards that the utility can be rewarded for achieving or penalized for failing to achieve 	<ul style="list-style-type: none"> International survey of 15 transmission utilities Comparison and benchmarking of in order to set price caps
Utilities revenue structure	<ul style="list-style-type: none"> $RR = O + T + D + r(RB)$ Set rate of return at 7.25%, Variable bonuses are added according to the operator's performance, evaluated in relation to regulator-set indicators: level of investment for interconnection for the European electricity system and for R&D, including smart grids; incentives for quality of supply 	<ul style="list-style-type: none"> $RR = O + T + D + r(RB)$ Set return rate fixed at 4.4% 	<ul style="list-style-type: none"> $RR = O + T + D + r(RB)$ Rates are set by allocating a share of revenue to each customer class and determining the structure of rates required to recover that revenue. 	<ul style="list-style-type: none"> The price cap for each year is set according to the Retail Price Index (RPI) and an efficiency factor, X. Prices remain fixed for the rate period and the utility keeps or shares the cost savings achieved. Revenue is the variable regulated Revenue reward of +/-1%, enhancing performance and quality improvement
Benefits	<ul style="list-style-type: none"> ✓ Reward over investment ✓ Protect the consumer by preventing overcharging ✓ Encourage operator to improve its performance and service quality 			<ul style="list-style-type: none"> ✓ Improve the efficiency of the distribution system and the quality of utility investments ✓ Price mechanism restricts revenue, not profit, so it encourages efficiency ✓ No quantity risk

Note : RR: Revenue Required ; O: OPEX ; T: Taxes; D: Depreciation ; r: Rate of Return ; RB: Rate Base.

Source: National Grid, "Annual Report and Accounts 2010/11"; Jamasb and Pollitt (2000), "Benchmarking and Regulation Of Electricity Transmission and Distribution Utilities Lessons from International Experience"; Deliberation of the French Energy Regulatory Commission of 3 April 2013 deciding on the tariffs for the use of a high-voltage public electricity grid; OECD, Japan - Regulatory Reform in Electricity; Fenrick et al. "Performance Based Regulation for Electric and Gas Distributors"

Governments and international institutions can play a critical role in mitigating certain risks in the financing of smart-grid projects

Public finance mechanisms (PFM)

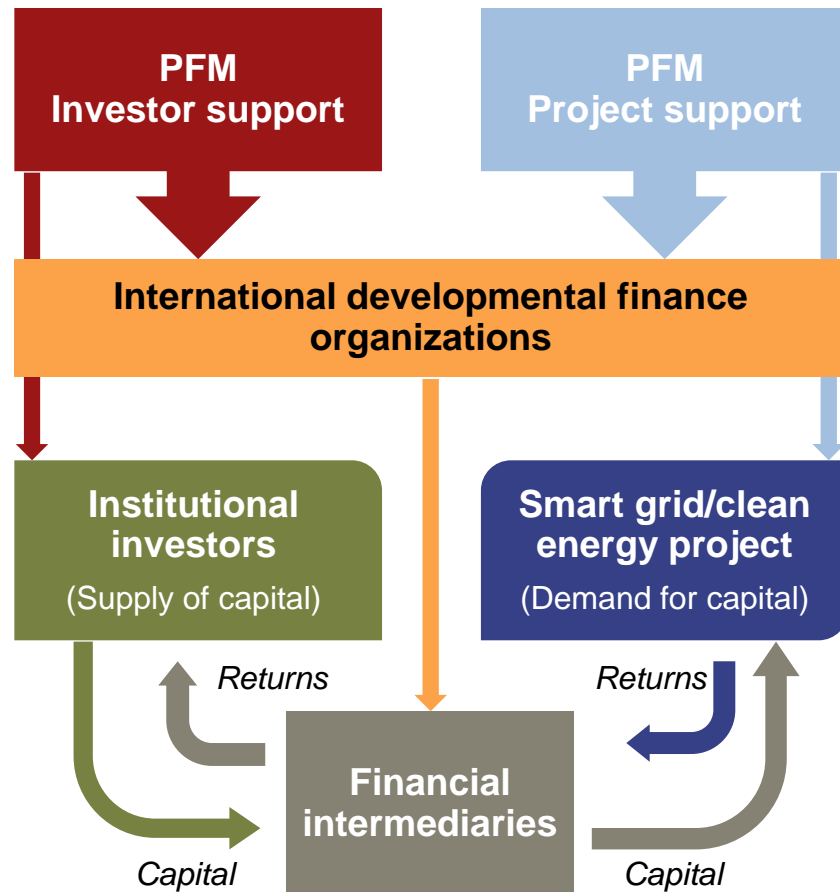

- Public Finance Mechanisms (PFMs) can support a variety of stakeholders in the financing of smart-grid projects by providing stable policy initiatives, both for suppliers of capital and entities that require capital.
- PFMs can support investors by taking on risks such as: political risk, currency risk, regulatory risk. Or by taking a first-loss equity position.
- PFMs can support the viability of energy projects by assuming energy-policy risk and assisting with project development.
- Development Finance Institutions (DFIs) bid for certain projects and provide public financing as well as offering risk management and mitigation through public-private risk allocation.

Regulators in the United Kingdom and Italy are at the forefront of innovative financing mechanisms, especially for supporting R,D&D

Office of Gas and Electricity Markets



- The Innovation Funding Incentive (IFI) promotes general technical innovation by **allowing up to 0.5% of annual revenue to be spent on innovation.**
- The Registered Power Zones (RPZ) instrument was focused on **encouraging innovative ways of connecting distributed generation.**
- **Allowances to recover RD&D expenditures** for distribution network operators (DNOs) have been provided:
 - Regulatory allowances to recover demonstration expenditure via tariffs;
 - Funding awards to help fund a small number of flagship projects by up to £500 million (\$790 million);
 - Discretionary rewards for successful project completion and exceptional projects.
- DNOs are required to **disseminate the learning** that the projects generate, as a learning-by-doing mechanism.

RIIO: “Revenue = Incentives + Innovation + Outputs”

- *RIIO is an output-based regulation set in the UK, offering the possibility of including expenditure for technical and commercial innovation projects in business plans*

Autorità per l'energia elettrica e il gas



- Temporarily enhanced return on revenue for capital-intensive demonstration projects:
 - Additional 2% extra on Weighted Average Cost of Capital (WACC¹) remuneration for a period of 12 years;
 - Only covers capital expenditure and not operative costs.
- **Supports pilot projects** aimed at testing different market models for electric vehicle charging services. Five new pilot projects have been allowed, according to three market models:
 - Distribution model;
 - Competitive-service provider model;
 - Sole-service provider model.

Regulatory Asset Base (RAB)


- Several EU member states do not recognize smart-grid investments in the RAB of European DSOs.
- Therefore, DSOs may be reluctant to invest in smarter grids: they replace the grids, but do not upgrade them

1. WACC is a calculation of a firm's cost of capital in which each category of capital is proportionately weighted.

Source: World Energy Council (2012), “Smart Grids best practices fundamentals for a modern energy system”; Eurelectric (2011), “Regulation for Smart Grids”

Standards covering interoperability, compatibility and industry best practices are among the most important prerequisites for smart-grid deployment

Interfaces in the electricity grid of the future

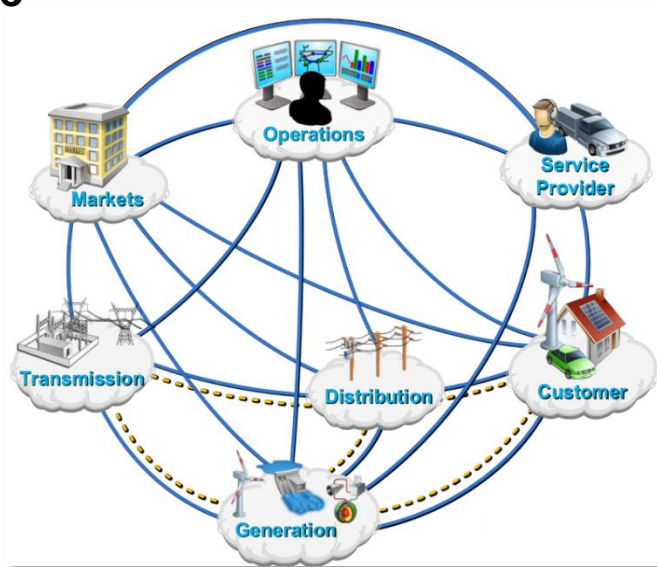


— Secure communication flows — Power flows ☁ Domain

- More than one hundred communication interfaces have been identified between all the systems that make up a smart grid.
- These will require standards of interoperability to enable the smooth transfer of data and two-way communications.

List of Standards Identified


of standards

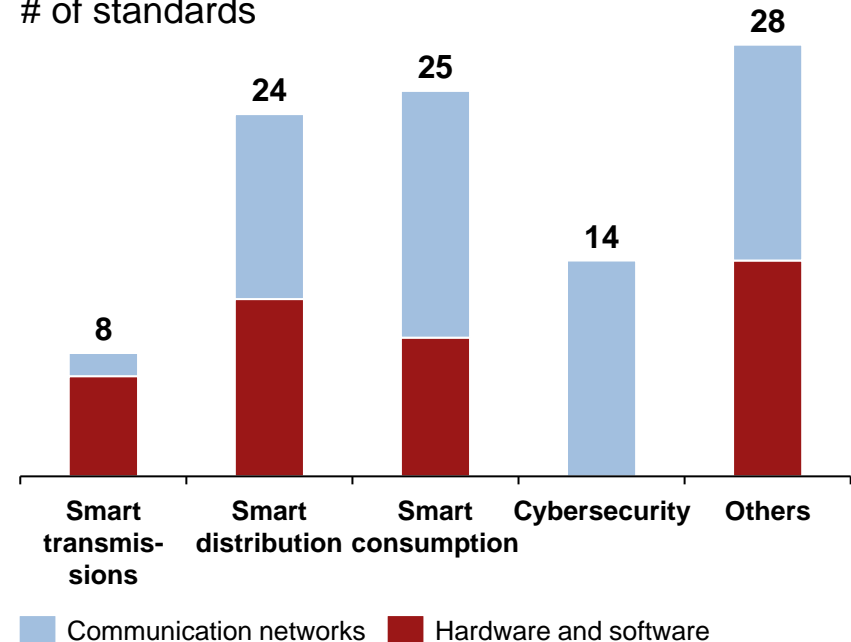

- Standards are key facilitators of compatibility and interoperability, as they define specifications for communications protocols, data formats, linkages within and across systems, and software/hardware interfaces.

Standardization and best practices would avoid the premature obsolescence of future smart-grid devices


Main Levers for a systematic approach to smart-grid standardization

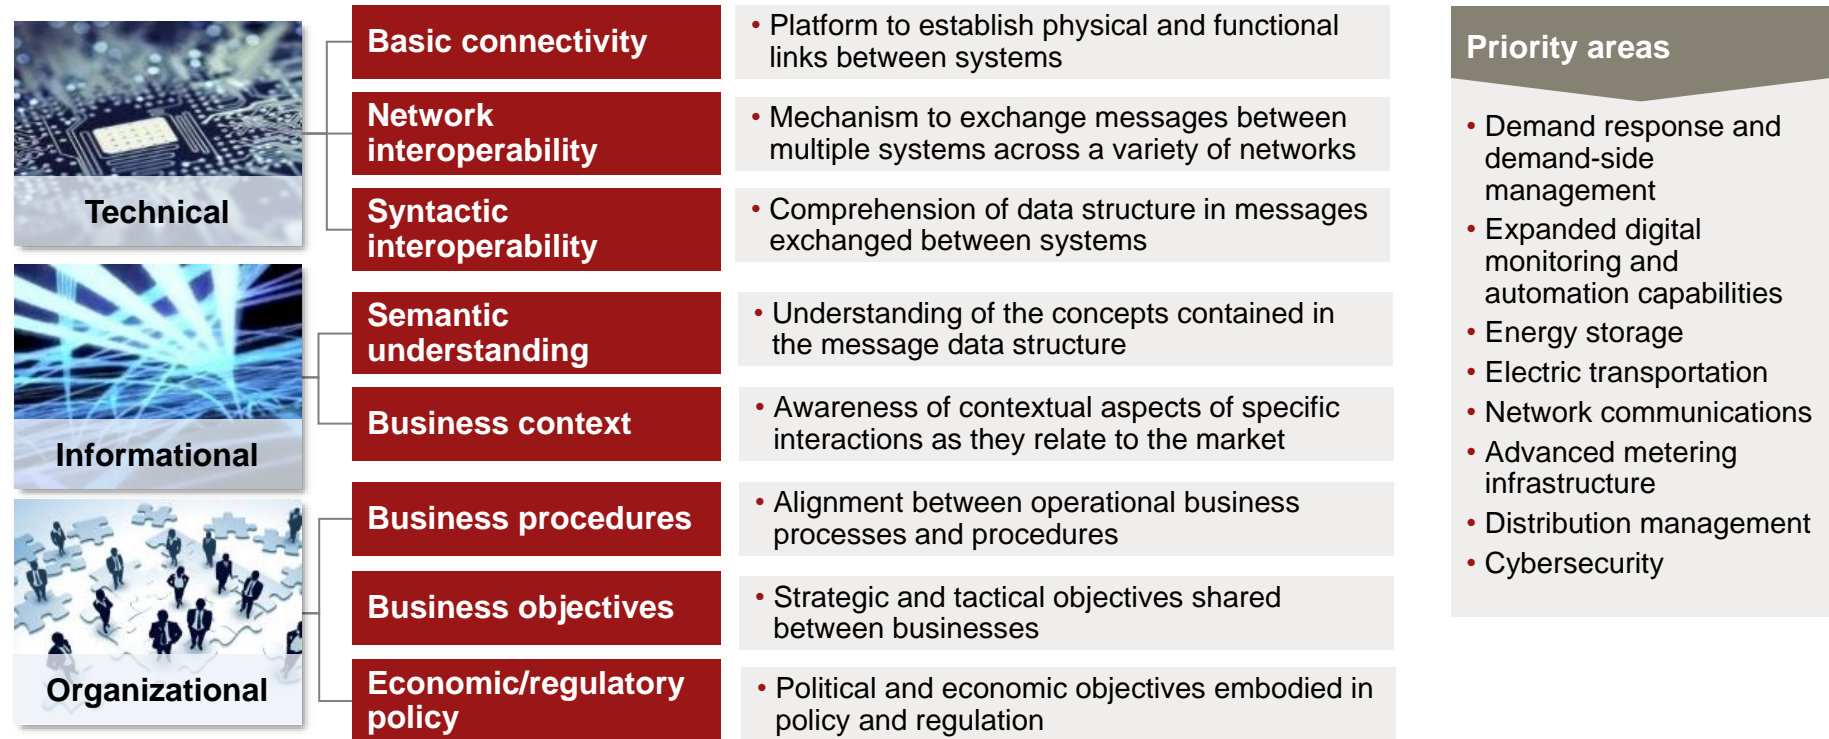

- Standardization and best practices requires collaboration between industries, regions and technologies.
- In the absence of standards, there is a risk that smart-grid technologies will become prematurely obsolete or implemented without adequate security measures.
- These reliability risks cause regulators to reject deployment, increasing the likelihood of slow technological adoption.

Appendix: smart-grid technology insights









Enhance physical network capacity

Smart-Grid technologies by application and device type

Click on each box to navigate to the associated FactCard

Type of device	Generation	Transmission	Distribution	Consumption
Communication networks	Micro-Grids and Smart Cities	(no transmission)	Micro-Grids and Smart Cities	
	Wide Area Network (WAN)		Field Area Network (FAN)	Home Area Network (HAN)
Electric power infrastructure		High Voltage/Direct Current (HV/DC), Superconductors	Smart Switches	Vehicle-to-Grid (V2G)
		Flexible AC Transmission Systems (FACTS)	Capacitor Banks	Smart Inverters
		Fault Current Limiters (FCL)		
Electronic power devices and sensors		Dynamic Line Rating (DLR)	Advanced Metering Infrastructure (AMI, Smart meters, MDMS...)	
		Phasor Measurement Unit (PMU)		Smart Appliances, In-Home Display (IHD)
Systems and processes	Wide-Area Measurement System (WAMS) Wide-Area Monitoring & Control (WAMC)		Distribution Management System (DMS), Distribution Automation (DA)	Building and Home Energy Management Systems (HEMS)
	Supervisory Control and Acquisition Data (SCADA)			Demand Response (DR)
		Volt/VAR Control (VVC), Conservation Voltage Reduction (CVR)		Net Metering
		Smart Protection: Predictive (Failure Prediction Algorithms) or Reactive (Fault Detection, Isolation and Restoration, FDIR)		Virtual Power Plant (VPP)
				Demand Forecasting

FactCard: AC vs. DC principles


Design	 Overview of AC current 	 Overview of DC current 
PROS	<ul style="list-style-type: none"> • Alternators are the most common method of producing electricity • In a synchronous grid, frequency can be monitored in real time, and reflects overall supply/demand balance. • Efficient increase in voltage through transformers • Safer over longer distance 	<ul style="list-style-type: none"> • Reduced land footprint (only two conductor cables) • Less transmission loss (2/3 that of AC) • Used for interconnection (asynchronous/fault-level) • Used for offshore subsea cables (>30 km) • Used for small power appliances (computing)
CONS	<ul style="list-style-type: none"> • Power transport capacity decreases with distance • Charging and skin effects: electron tendency to flow only at the surface of the conductor cable, requiring larger cable than in DC for the same transfer power capacity 	<ul style="list-style-type: none"> • Point-to-point transport only unless HVDC circuit-breakers are commercialized • High cost of equipment (converter stations) • Transformers cannot be used to change voltage • No frequency regulation mechanism to manage supply/demand
Frequency	• Variable (50 or 60Hz)	• 0 Hz
Source	• Alternators	• PV cells and batteries
Direction	• Reverses at every cycle	• Flows in one direction
Types	• Sinusoidal	• Pure, pulsating
Transformers	• Cost-effective transformers	• Expensive transformers
Cost effectiveness	<ul style="list-style-type: none"> • Cables < 50-100 km • Lines < 600-800 km 	<ul style="list-style-type: none"> • Cables > 50-100 km • Lines > 600-800 km
Switch and reset	• Easy to reset or switch on/off (voltage zeros every time current reverses direction ~100 time/sec at 50 Hz)	• Hard to switch on/off and further development needed (DC current never zeros, which leads to electric arcs at high voltage when circuit breakers open or close)

FactCard: High Voltage Direct Current (HVDC)

- High Voltage is an electricity-transmission method that results in reduced thermal losses. Indeed, the thermal losses associated with a given power flow are proportional to the inverse of the square of the voltage
- High Voltage Direct Current (HVDC) refers to power lines transporting DC current at a high voltage
- HVDC is principally used as an asynchronous bi-directional linkage to stabilize non-synchronous AC areas (e.g. between incompatible frequency areas) and to connect large and remote variable renewables such as offshore wind farms to the main grid (e.g. subsea HVDC cables, since AC dissipates quickly underwater)
- However, converting AC-to-DC (also known as rectification) is very expensive. (DC-to-AC is called inversion)



AC-to-DC conversion diagram

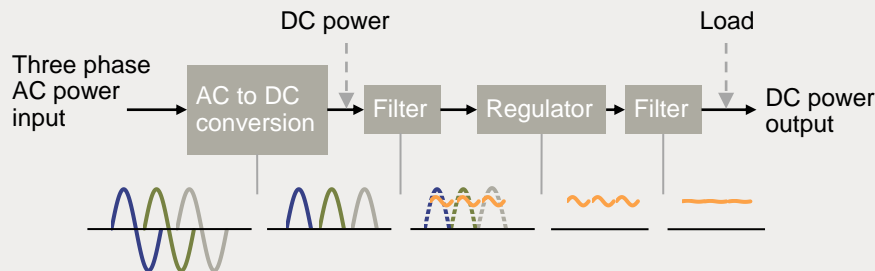

- **Technology:** Power infrastructure - Overhead or underground cable
- **Grid integration:** Point-to-point
- **Maturity:** HVDC (Deployment), related electronics (R,D&D)
- **Potential benefits:**
 - Small transmission losses
 - Power-stability improvements
 - Mitigation of cascading supply disruptions
- **Barriers:**
 - Cost of AC-to-DC converters
 - Cost of HVDC circuit breaker and control equipment



Maturity
Deployment

Note: Picture Credits: left: ABB, HVDC light cable cross section; right: Siemens, HVDC power transformer on the Australia – Tasmania cable.
Source: MIT (2011), "The Future of the Electric Grid"; ABB, "The Classic HVDC Transmission"; Larruskain et al. "Transmission and Distribution Networks: AC versus DC"; Hamerly (2010), "Direct Current Transmission Lines", Stanford university.

FactCard: Superconductivity and High Temperature Superconducting Cables (HTSC)



- Superconductivity is the phenomenon of no electrical resistance, which occurs in certain materials (e.g. metals, alloys), below a characteristic temperature T_c
- High Temperature Superconducting Cables (HTSC) operate at around $T_c \sim -195^\circ\text{C}$ (usually cooled with liquid nitrogen)
- There are numerous benefits to HTS technology, including:
 - Three-to-five times greater current density;
 - Significant reductions in transmission losses;
 - Less space required for deployment, as it is installed underground rather than needing large transmission towers;
 - Use of more environmentally sustainable liquid nitrogen rather than the dielectric oil used in traditional high-voltage transmission

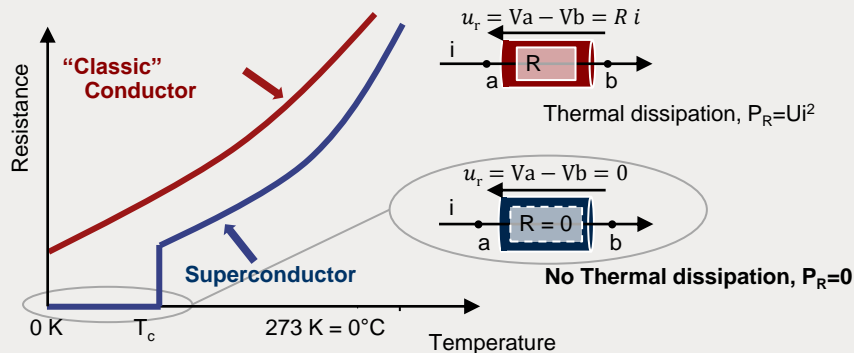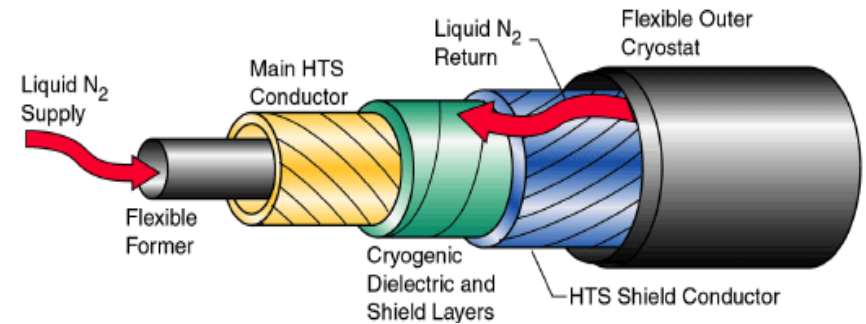

Note: Note that T_c ($^\circ\text{C}$) for all superconductors is currently negative and $< -140^\circ\text{C}$ (133 K).

Source: Picture credit (Top right): ORNL 2000-1499C EFG; Furukawa Electric Company, U.S. Department of Energy, Office of Electricity Delivery and Energy Reliability, Nexans, Superconducting Cable System

- **Technology:**
Power infrastructure – Underground cables

Maturity

Early demo


- **Maturity:**
 - Longest line installed: 1 km (Germany, 2014)
- **Grid integration:**
 - Cables linked to the conventional network at a substation
 - Cooling stations needed every 1-5 km
- **Potential benefits:**
 - Large transmission capacity in compact dimensions
 - Small transmission losses
 - Underground location precludes certain types of disruption

FactCard: Dynamic Line Rating (DLR)

- Stating line rating, a common practice, refers to the evaluation of the capacity that can effectively flow through a power line.
- Dynamic Line Rating (widely understood since 1984) measures the changing weather conditions that affect the temperature of the power cable in order to increase its maximum allowed capacity in low-risk situations, such as cold, windy, and cloudy winter days, when the power cable has a lower risk of overheating
- The DLR takes the form of sensors deployed at transmission buses to gauge wind speed, solar radiation and ambient temperature and communicates near-in-time measurements to management systems, which dynamically optimize power flow

Example of changing weather conditions' impacts on line capacity:

- Ambient temperature +/- 1°C ⇒ +/- 1% capacity
- Wind speed increase +1m/s ⇒ [+35%,+45%] (depends on angle)
- Solar radiation day/night variation ⇒ up to 18% (night)

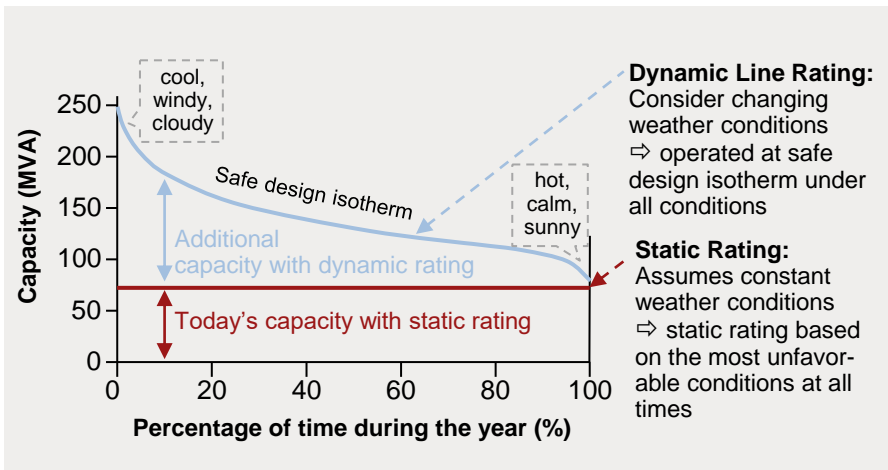

- **Technology:** Electronic sensor
- **Grid integration:**
 - Deployed at transmission buses
 - Every 1-10 km¹
- **Communication protocol:**
 - Send data to SCADA or WAMS by fiber or microwave
- **Potential benefits (after software treatment):**
 - Enhance power capacity of existing power line
 - Better dimensioning of new power lines
 - Synergies in case of wind power transmission

Maturity


Deployment

1. The device can be installed along the cable or on top of its insulation.

Source: The Valley Group, Aivaliotis S.K. (2010), "Dynamic Line Ratings for Optimal and Reliable Power Flow"; Dombek (2014), "Energy Storage, Dynamic Line Ratings Yield More Efficient Grid"; Picture credits: PACWorld & Ceati

FactCard: Fault Current Limiter (FCL)

- A fault current occurs when the line intensity suddenly fluctuates, creating a short circuit that potentially overwhelms the electrical network components, causing failures, a tripped circuit or blown fuses. This fluctuation is generally due to lightning or a line outage
- The Fault Current Limiter (FCL) introduces a high impedance that actively absorbs the amplitude of the fluctuation
- “Development is driven by rising system fault current levels as energy demand increases and more distributed generation and clean energy sources, such as wind and solar” (DOE 2009)
- FCLs benefits:
 - For utilities: great potential for cost savings (by maintaining a grid and protecting it from faults; and reducing damage to expensive T&D system components);
 - For the consumer: higher power reliability and quality

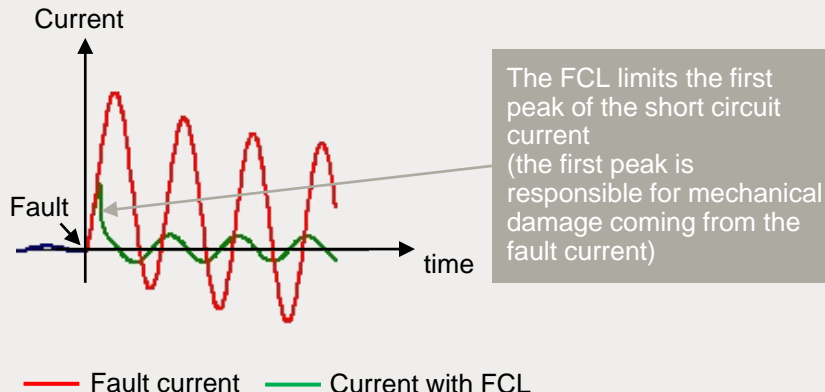


- **Technology:** Physical infrastructure
- **Grid integration:**
 - Deployed at electrical network substations
 - Distributed (renewable) generation connections
 - Micro-grid connections
- **Potential benefits:**
 - Current stability improvements
 - Protects installations

Maturity

Demo

FactCard: Flexible Alternating Current Transmission System (FACTS)

- FACTS consists of very large capacitors and feedback-control mechanisms, which are installed on the AC transmission network to complement substations in order to enhance transmission network capacity
- FACTS comprises various power electronic devices (Static Var Compensator (SVC), thyristor, condensers, capacitors, and, potentially, phasor measurement units (PMU)), and costs up to \$35-45 million per unit (compared with \$15-35 million for a substation). Only one FACTS every 200 substations is needed to be installed on average, which statistically increases total substation capital expenditure by more than 10%
- FACTS “involves the injection of a variable-voltage source, which adjusts the power flow across a transmission line, resulting in variable voltage, impedance, and phase angle”. (EPRI 2011)

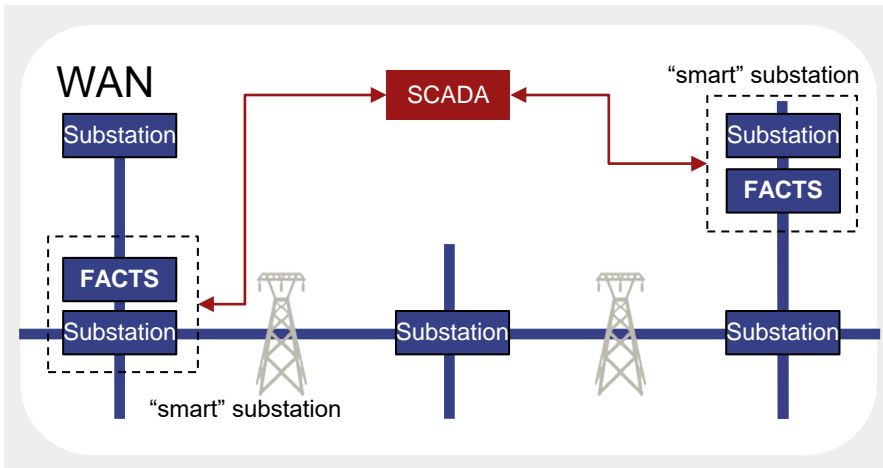


- **Technology:** Power infrastructure
- **Grid integration:** Along transmission networks
- **Maturity:** Deployment
- **Potential benefits:**
 - Provides dynamic voltage-control that enhances high voltage power quality, controllability and stability
 - Increases utilization of transport infrastructure
 - Defers installation of new or higher-voltage cables

Maturity
Deployment

FactCard: Volt/VAR Control (VVC), Static Var Compensators (SVC) and Capacitor Banks



- Vol/VAR Control (VVC) is an essential feature of AC electricity networks, whose goal is to maintain acceptable voltages at all points of the grid under all loading conditions. While VVC principles are well known, advanced Vol/VAR optimization via algorithms and centralized control centers is in the demonstration phase in distribution grids (see CVR next slide), and in early deployment phase in transmission grid (though SVC built within FACTS)
- The working principle of VVC is to minimize the angle between voltage and current signal in the grid. *Apparent* (or total) electric power S delivered by the grid is the product of current (I) and voltage (V). Ideally, both sinusoids should peak and cancel as simultaneously as possible so as to maximize the product of both. Purely resistive loads like lightbulbs create no angle. However, inductive loads such as electric motors create a positive angle (θ) at the terminal, while capacitive loads such as capacitors create a negative one¹. As a result, apparent power S changes sign at every AC cycle. The portion of apparent power that is positive when averaged over a complete AC cycle (i.e. that results in net transfer of energy in one direction) is called *active* (or real) power P , and is the only power utilized by the rotor to turn, and the only power billed to the consumer. The remaining portion, which oscillates symmetrically between positive and negative values, is called *reactive power* Q . It creates no useful work, but has to be transported back and forth by the grid, utilizing cable capacity and creating additional heat losses. Therefore, system operator interest is in minimizing reactive power, i.e. phase θ , which is VVC's purpose
- Without VVC, because household demand is generally inductive ($\theta > 0$), any sudden increase in demand would create a large phase angle and an associated large reactive power flow into the grid, resulting in a drop of voltage
- VVC therefore requires capacitor banks ($\theta < 0$) at regular intervals in the grid to reduce phase angle, stabilize voltage, and allow appliances to work more efficiently near their optimal nominal voltage

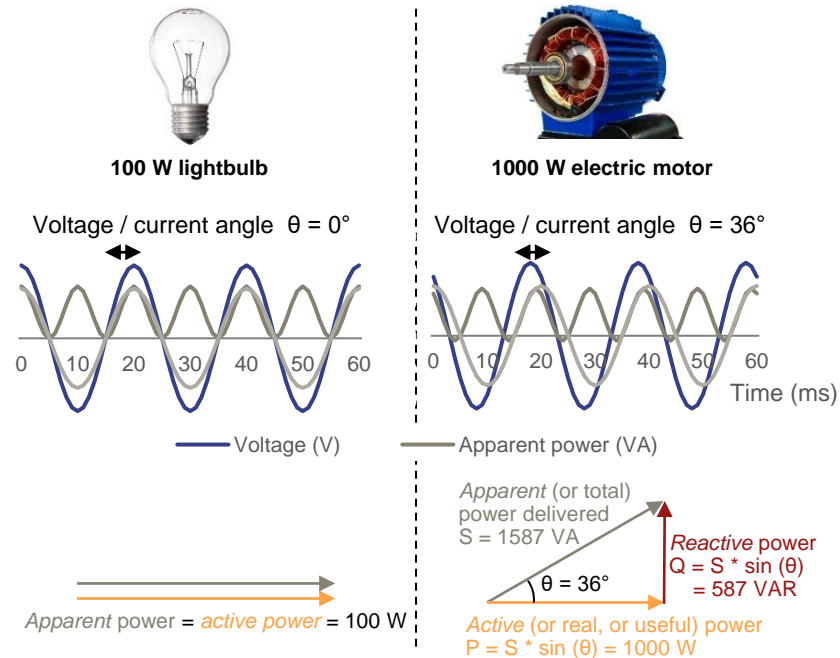

Apparent power S (measured in Volt Ampere VA) can be split into active power P (in Watt W) and reactive power Q (in Volt Ampere Reactive VAR), with $S^2 = P^2 + Q^2$ and the ratio between Q and P is equal to $\tan(\theta)$

• Grid integration: T&D

• Potential benefits:

- Increase power quality
- Reduce undesired impacts on devices
- Save energy


Maturity

Mature

1. Inductors possess long coiled wiring which “delays” the flow of electrons (i.e. the current signal) compared with the voltage signal delivered by the electricity provider. At the opposite, the voltage at the terminal of a capacitor only increases slowly as it charges, delaying voltage signal relative to the current, creating negative phase angle.

Source: EPRI, Uluski B. (2011), “Volt/VAR Control and Optimization Concepts and Issues”; picture Credits: <http://electric-motor-dealers.regionaldirectory.us/>


FactCard: Conservation Voltage Reduction (CVR)




The prime purpose of CVR is to maintain a stable voltage along the distribution grid, using VVC techniques. It has two main benefits: improve power quality, and minimize energy losses from customer appliances.

Without CVR, voltage generally drops along the distribution-feeder cables (right-hand picture): houses closer to the substation will have to receive higher voltage than required to spare voltage for houses downstream. As appliances are optimized for a single nominal voltage, higher voltage results in energy waste.


With CVR added at various intervals along the feeder cables, voltage can be readjusted to maintain voltage delivered to the customer in the lower portion of the acceptable range, smoothing voltage drop and achieving energy savings. Voltage is readjusted automatically depending on the load: Standalone CVR operates on a predetermined set of rules, and is not considered “smart”. DMS-controlled CVR uses external grid data to exert a much smarter control over voltage (see graph below)

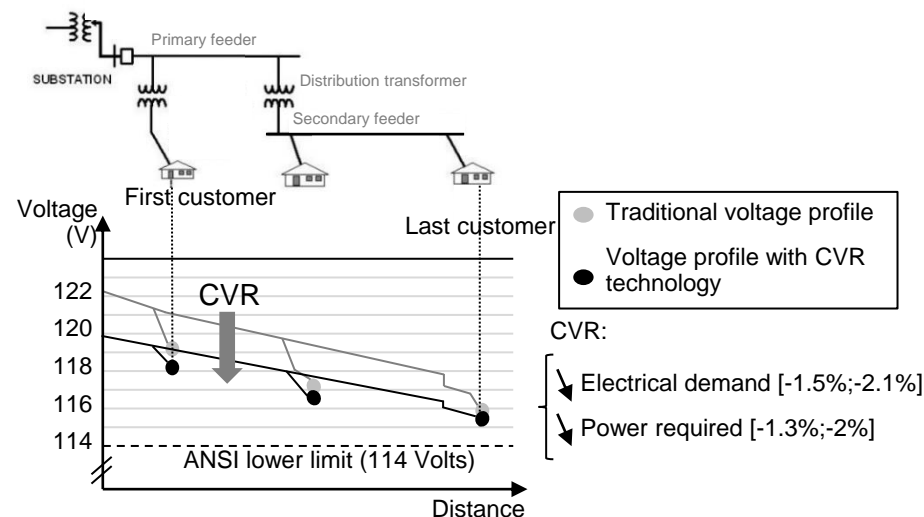

DMS-controlled CVR

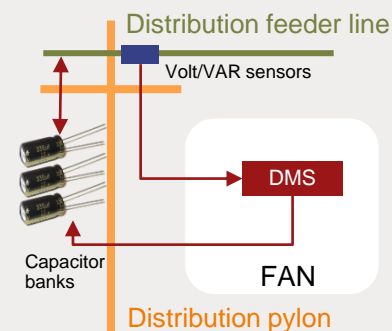

Rule-based standalone CVR

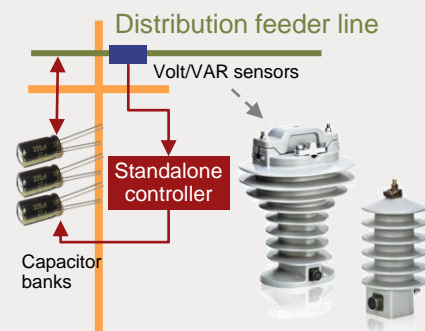

- **Technology:** Integrated system
- **Grid integration:** Buses along distribution feeder
- **Maturity:** Standalone CVR is mature but DMS-controlled CVR is in early deployment
- **Potential benefits:**
 - Improved power quality (voltage quality)
 - Customer energy saving (1-3% in pilot programs)
 - Very useful for high DG penetration, or for customers demanding high quality-power (e.g. servers)
- **Barriers:** Disproportionately high costs for utilities when installing numerous devices along each feeder

Maturity

Demo

Note: ANSI: American National Standards Institute; DMA: Distribution Management System.

Source: Warner & Willoughby (2013), “Conservation Voltage Reduction: An Energy Efficiency Resource”, IEEE Smart Grid; EPRI, Uluski B. (2011), “Volt/VAR Control and Optimization Concepts and Issues”; BNEF (2013) “The convergence of AMI and distribution automation”; Picture Credits: (right) ABB DistribuSense current and voltage sensors; (left) http://wiki.powerdistributionresearch.com/index.php?title=File:Voltage_profile_distribution.jpg.



Optimize grid monitoring and control

Smart-Grid technologies by application and device type

Click on each box to navigate to the associated FactCard


Type of device	Generation	Transmission	Distribution	Consumption
Communication networks	Micro-Grids and Smart Cities	(no transmission)	Micro-Grids and Smart Cities	
	Wide Area Network (WAN)		Field Area Network (FAN)	Home Area Network (HAN)
Electric power infrastructure		High Voltage/Direct Current (HV/DC), Superconductors	Smart Switches	Vehicle-to-Grid (V2G)
			Capacitor Banks	Smart Inverters
		Flexible AC Transmission Systems (FACTS)		
		Fault Current Limiters (FCL)		
Electronic power devices and sensors		Dynamic Line Rating (DLR)	Advanced Metering Infrastructure (AMI, Smart meters, MDMS...)	
		Phasor Measurement Unit (PMU)		Smart Appliances, In-Home Display (IHD)
Systems and processes	Wide-Area Measurement System (WAMS) Wide-Area Monitoring & Control (WAMC)		Distribution Management System (DMS), Distribution Automation (DA)	Building and Home Energy Management Systems (HEMS)
	Supervisory Control and Acquisition Data (SCADA)			Demand Response (DR)
		Volt/VAR Control (VVC), Conservation Voltage Reduction (CVR)		Net Metering
		Smart Protection: Predictive (Failure Prediction Algorithms) or Reactive (Fault Detection, Isolation and Restoration, FDIR)		Virtual Power Plant (VPP)
				Demand Forecasting

FactCard: Supervisory Control and Data Acquisition (SCADA)

- Supervisory Control And Data Acquisition (SCADA) systems are a general set of computer technologies that monitor and control grid operations
- SCADA's main function is to establish the link between:
 - Grid sensors, to receive data from switches (open/closed), voltage, current, angle, active or reactive power;
 - Energy Management Systems (EMS), for decision-making; and
 - Remotely operated equipment, to send coded control signals to generators, substation power electronics, switches, voltage controllers, *etc...*
- SCADA is not a smart-grid technology in itself, having been part of the traditional grid-management system since computerized control was introduced in the 1960s. The purpose of Wide-Area Monitoring Systems (WAMS) is to enhance SCADA through installation of newer technologies (see next slide)



WAN or FAN

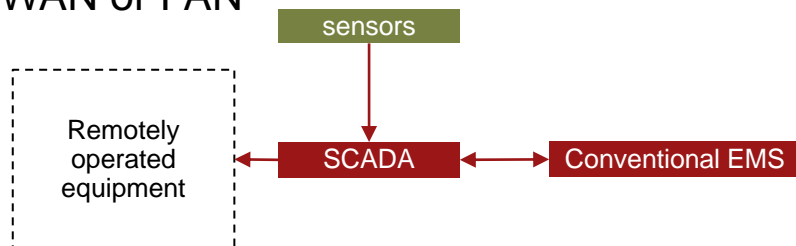

- **Technology:** Software and hardware
- **Grid integration:** Utility control centers, generators or substations
- **Maturity:** Installed in every grid (non-smart technology)
- **Potential benefits:**
 - Data acquisition for monitoring and grid control
 - Active avoidance of cascading supply disruption
- **Potential barriers:**
 - Low time resolution, over one second

Maturity


Mature

FactCard: Wide-Area Measurement System (WAMS) for Wide-Area Monitoring & Control (WAMC)

- Wide-Area Measurement System (WAMS) refers to a combination of interconnected devices, which allows for a Wide-Area Monitoring & Control (WAMC) of the transmission grid. WAMS comprises of:
 - Advanced sensors: Phasor Measurement Unit (PMU), optionally Dynamic Line Rating (DLR) or Fault Current Limiters (FCL);
 - Advanced software and algorithms, which process large amounts of data in short timeframes to help decision-making; and
 - Advanced hardware, both centralized and distributed, with improved memory storage, display, and communications systems.
- Thanks especially to Phasor Measurement Unit (PMU), WAMC operates on much greater portions of the grid and on much higher time resolutions than was possible with conventional SCADA systems
- Some new WAMC functionalities include Wide-Area Situational Awareness (WASA) and Wide-Area Adaptive Protection, Control And Automation (WAAPCA)



WAN

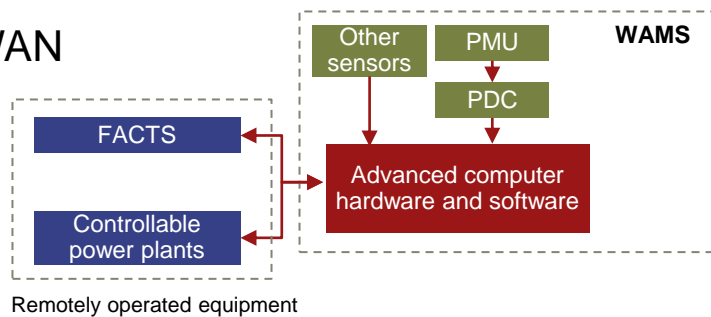

- **Technology:** Hardware and software
- **Grid integration:** Major Utility (TSO) control centers
- **Communication protocol:** Communicate through WAN
- **Maturity:** Early deployment
- **Potential benefits:**
 - Real-time visualization and awareness for operators
 - Efficiency and security of the transmission operations
 - Optimal utilization of the transmission network


Maturity

Deployment

FactCard: Phasor Measurement Unit (PMU)

- Phasor Measurement Units (PMU) are advanced sensors, which take synchronous measurements of the electrical signal dozens of times per AC cycle in order to digitalize the entire voltage and current waveform at specific locations of a grid, using a common time-source for synchronization – usually a GPS radio clock (see diagram)
- PMUs are crucial components of a smart grid**, enabling a real-time understanding of the status of the grid. By contrast, conventional sensors only allow asynchronous signal measurement every few seconds or so
- PMUs are generally installed in transmission grids (ideally at each critical substation, every 10-100 kilometers¹) for Wide-Area Measurement System (WAMS). Although capital intensive, PMU may also replace conventional sensors in a distribution grid to ensure power quality in case of high DG penetration


Time synchronization in PMU

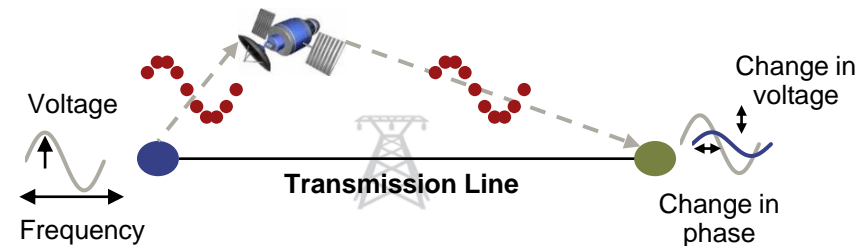

- Measure signal, transfer data
- Compare output signal with data from input signal

Visualization of:

- Voltage change (e.g. losses)
- Synchronization

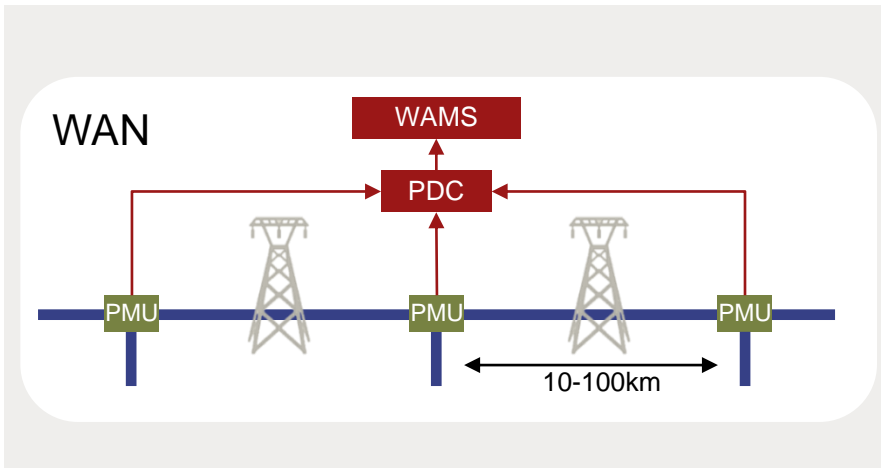



- Technology:** Electronic sensor
- Grid integration:** Deployed at grid substations/nodes
- Maturity:** Deployment stage in Transmission Grid, Demonstration stage in Distribution Grid
- Communication protocol:** Send data to PDC then to WAMS by fiber or microwave
- Potential benefits (after software treatment):**
 - Enable real time and country scale system state vision
 - Allow synchronous reconnection of a portion of the grid that has been islanded
 - Improve power quality in distribution grids with a very high share of distributed generation

Maturity
Deployment

1. A.T. Kearney Energy Transition Institute estimates based on devices deployed; 2 A phasor is a measurement of the magnitude and angle of an electrical waveform, either current or voltage. Source: Sexauer et al. (2013), "Phasor Measurement Units for the Distribution Grid: Necessity and Benefits"; U.S. Department of Energy (2013), "Synchrophasor Technologies and Their Deployment"; IEEE (2011), "Standard for Synchrophasors for Power Systems"

FactCard: Distribution Management System (DMS) for Distribution Automation (DA)

- Distribution Management System (DMS) refers to a combination of interconnected devices, which allow for an Distribution Automation (DA) of the distribution grid. DMS integrates:
 - Grid sensors: conventional volt/VAR sensors, and potentially synchronous Phasor Measurement Units (PMU)
 - Edge-of-grid sensors: Advanced Metering Infrastructure (AMI);
 - IT systems: SCADA and software: Geographic Information Systems (GIS), Workforce Management Systems (WMS), Outage Management Systems (OMS) for Fault Detection, Isolation and Restoration (FDIR)
- DMS adjusts system settings via remotely operated equipment to optimize load flows and operating conditions, given the constraints of the system
- DMS delivers real-time analysis and control of the distribution grid at the control centers, and is central to the integration of variable and distributed resources into the grid

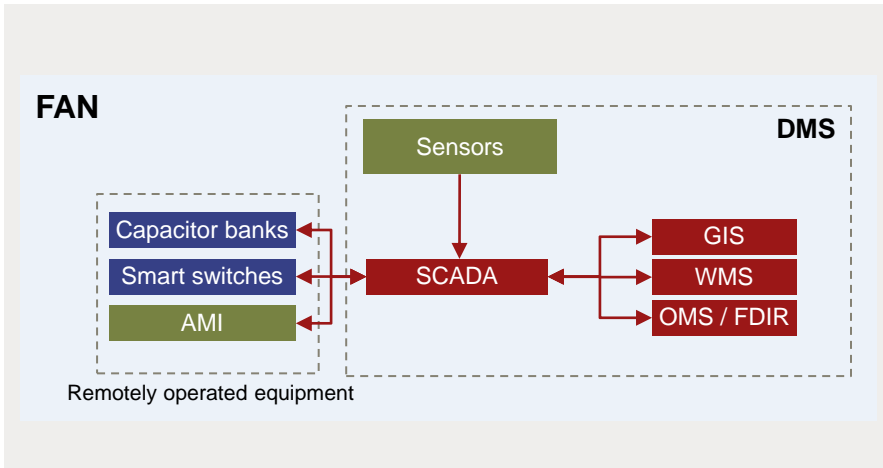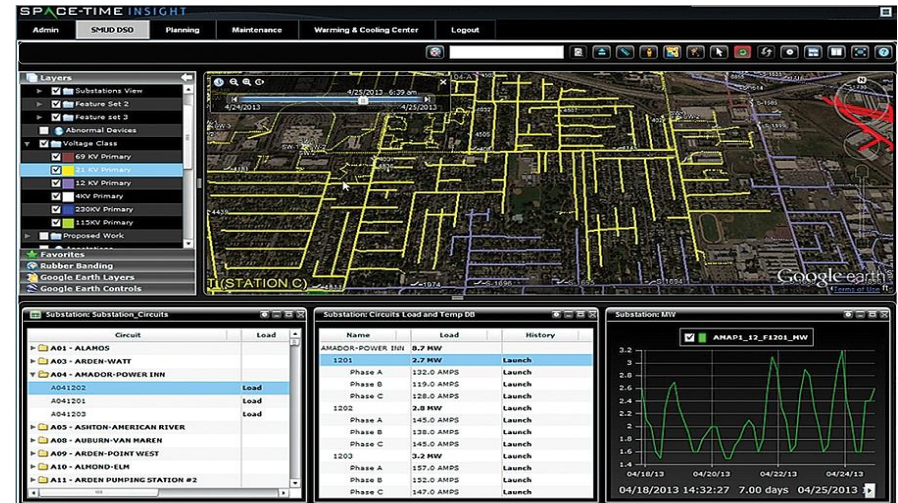

- **Technology:** System and software
- **Grid integration:** Distribution system operator control centers
- **Communication protocol:** Communicate with transmission infrastructure to optimize load delivery
- **Maturity:** Deployment
- **Potential benefits:**
 - Real-time visualization and awareness for operators
 - Improved detection of losses, theft or faults
 - Reduces crew resources for monitoring
 - Enables advanced VVC and CVR, which facilitate integration of distributed and variable electricity sources
 - Enables demand-side management and net metering


Maturity
Deployment

FactCard: Smart protection: predictive¹ or reactive²

Failure-prediction algorithms

- Statistical approaches can predict weak points or failure before they occur, and improve power reliability by taking preventing actions such as proactive maintenance
- Such machine-learning algorithms require vast amounts of historical and real-time data:
- Supply-related data such as wind or solar radiation;
- Grid data from PMU or DLR sensors; and
- Edge-of-grid data for demand prediction (see slide 93)

Machine learning and pattern analysis

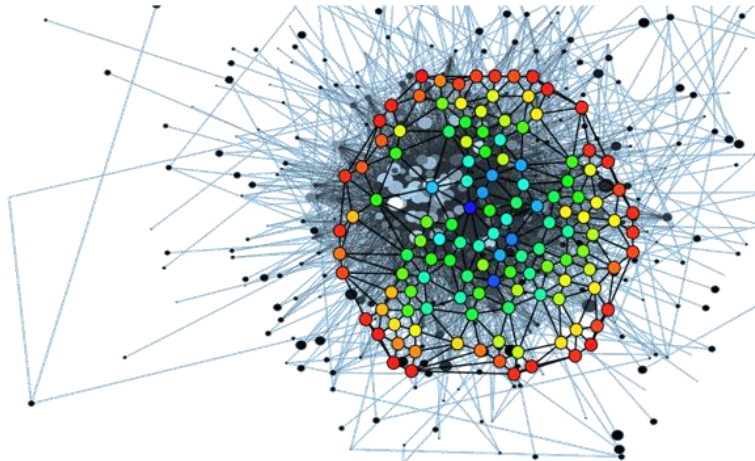


1. failure-prediction algorithms
2. Fault Detection, Isolation and Restoration, FDIR

Source: Smart Grid, Smart City (2012), "Smart Grid, Smart City Project"; Fang et al. (2012), "Smart Grid – The new and improved power grid: a survey"; Picture Credits: GE: https://www.gedigitalenergy.com/smartgrid_distribution.htm#DA; LLNL: https://casil.llnl.gov/technical_focus_area/machine_learning

Fault Detection, Isolation and Restoration (FDIR)



- FDIR is a key component of an automated and self-healing distribution grid. It integrates monitoring and reactive capabilities to reduce outage duration and area: It instantaneously detects both feeder and substation faults and takes immediate action, isolating faulty equipment and restoring unaffected network sections (picture below)
- FDIR requires field sensors to detect voltage/current faults at substations, along distribution feeders, or near-home AML; algorithms, such as Outage Management System (OMS), combining fault location with feeder-network geographical maps and topology to determine the optimal isolation plan; and smart switches (reclosers) to isolate and re-route electricity flow without human intervention

GE's recloser control system

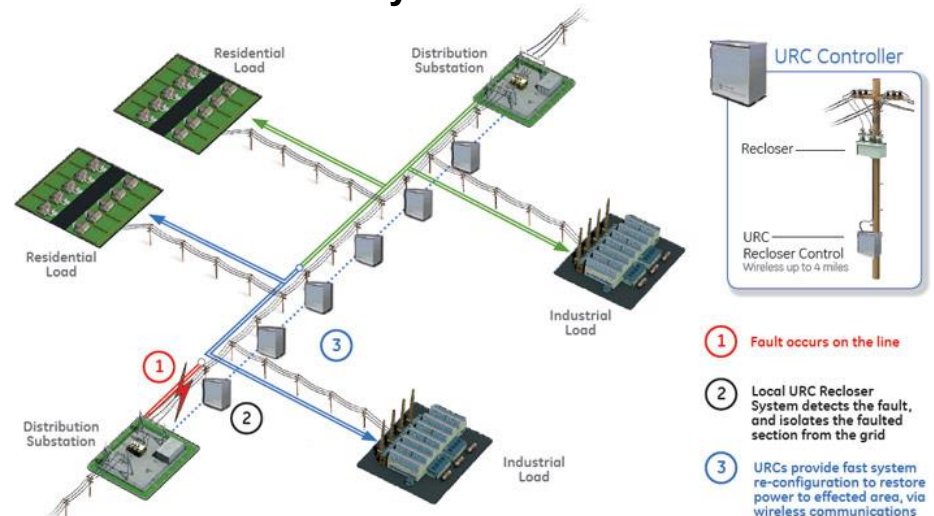

FactCard: Smart Switches (Intelligent Reclosers)

- Switches, mounted at each station along the T&D network, are the only devices used to re-route physical electricity flows in an electricity grid. When faults occur, switches automatically open in order to isolate the affected section of the grid in the shortest possible time and ensure grid security
 - Conventional Switches** (or Breakers) do not have remote communication and require human intervention to be closed again
 - Smart Switches** (or Intelligent Reclosers) can be automatically reclosed or closed remotely, enabling faster grid-healing and improved fault isolation by using more sensitive switches
- Smart Switches are installed at the Distribution Grid, where 80-90% of faults are small transient issues (e.g. a small branch blown on the line). These faults are immediately absorbed and do not require human intervention¹
- When equipped to communicate with SCADA, smart switches are the key smart-grid infrastructure for automated grid healing (FDIR), receiving control signals to open or close as requested

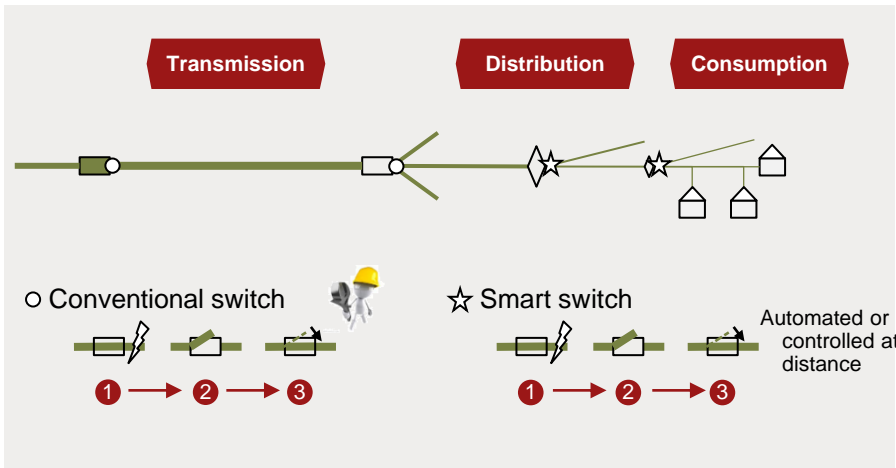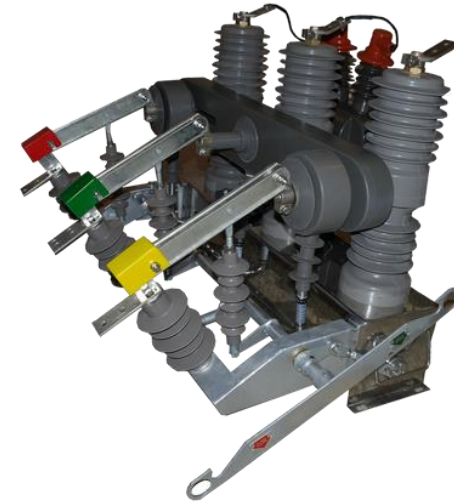


- Technology:** Electric Power Infrastructure
- Grid integration:** Distribution stations
- Maturity:** Deployment
- Potential benefits:**
 - Enables Automated Grid Healing Fault Detection, Isolation and Restoration (FDIR)
 - Increases sensitivity to perturbations (grid reliability)
 - Fault sensitivity can be adjusted

Maturity
Deployment

Note: FDIR: Fault Detection, Isolation and Restoration; SCADA: Supervisory Control and Data Acquisition (SCADA); DMS: Distribution Management System.
Source: O'Sullivan and Kimura, "Only Smart Reclosers Build Smart Grids"; Weedy B. M. (1972), "Electric Power Systems"; Picture credits: Smart Grid Network, Vacuum Switch, <http://smartgridnetworks.net/vacuum-switchactuators/>


FactCard: Forecasting energy consumption



- Forecasting consumption has always been used by grid operators to maximize power reliability. However, better algorithms and sensors are making prediction with higher spatial and temporal granularity possible.
- Household demand varies according to season, weather, consumer behavior, time of day... Forecasting this is therefore crucial for power optimization, especially when variable and distributed energy sources within micro-grid systems are in use.
- To increase the accuracy and develop ever-more precise predictive methods, larger amounts of data need to be obtained and analyzed, in order to find recurrences in consumption patterns and correlations with external variables (see figure). Four main forecasting methods exist:

Short term (hour-week)	Trend method: Projection based on historical data from the evolution of the consumption curve in a non-causal way. This method doesn't explain, it projects.	
	✓ Easy data availability and fast processing	✗ Only suitable for short-term forecasting
	Similar day method: Track several parameters (weather, time, day of week...) and refine projections, based on multiple correlations with records from previous days.	
Long term (week-year)	✓ High short-term forecasting accuracy. Several computational tools can be used	✗ Forecasting accuracy decreases with increased time-span
	End-use method: Disaggregated approach to analyzing the individual usage patterns of appliances/systems, at all scales, predicting consumption based on the way each technology is deployed.	
	✓ Suitable for long-term forecasting. Enable forecasts for energy-efficiency programs	✗ Accuracy depends on the granularity of information. Limited samples prevent large-scale forecasts
	Econometric method: Combine economic theory and statistical analysis such as similar-day method. Combined with end-use method for better accuracy.	
	✓ Suitable for long-term forecasting and simulation of different demand scenarios	✗ All variables (consumption history, economics, behavior...) for the same sample are required

Forecasting step by step process description

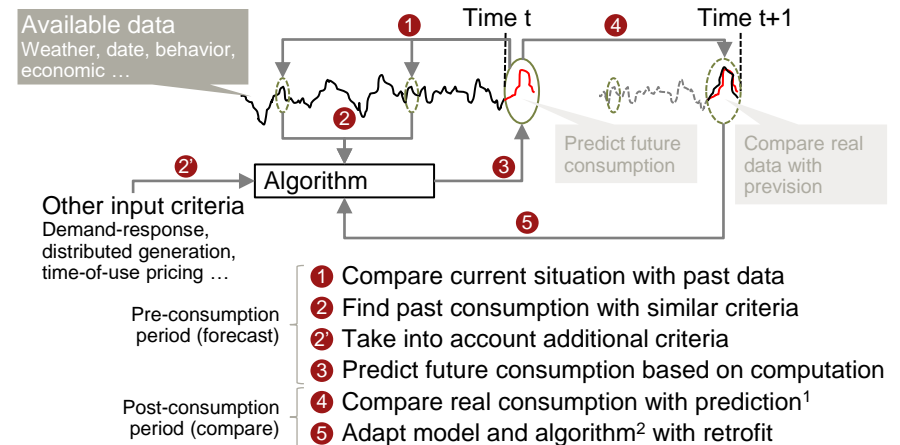

- Technology:** Data analysis
- Grid integration:** Consumer side
- Maturity:** Demonstration
- Methods:** Algorithm based on past data, behavioral analyses and demand anticipation
- Potential benefits:**
 - Minimize short-term balancing, which is often costly and carbon-intensive
 - Optimize long-term plans aiming at ensuring adequacy between power plant capacity and future demand

1. A learning period is very important for forecasting, as models are usually stochastic calculations based on historical data; 2 Unexpected/unplanned events are taken into account for the granularity and precision of algorithms (e.g. sporting events ...).



Enable active customer contribution

Smart-Grid technologies by application and device type

Click on each box to navigate to the associated FactCard

Type of device	Generation	Transmission	Distribution	Consumption
Communication networks	Micro-Grids and Smart Cities	(no transmission)	Micro-Grids and Smart Cities	
	Wide Area Network (WAN)		Field Area Network (FAN)	Home Area Network (HAN)
Electric power infrastructure		High Voltage/Direct Current (HV/DC), Superconductors	Smart Switches	Vehicle-to-Grid (V2G)
			Capacitor Banks	Smart Inverters
		Flexible AC Transmission Systems (FACTS)		
		Fault Current Limiters (FCL)		
Electronic power devices and sensors		Dynamic Line Rating (DLR)	Advanced Metering Infrastructure (AMI, Smart meters, MDMS...)	
		Phasor Measurement Unit (PMU)		Smart Appliances, In-Home Display (IHD)
Systems and processes	Wide-Area Measurement System (WAMS) Wide-Area Monitoring & Control (WAMC)		Distribution Management System (DMS), Distribution Automation (DA)	Building and Home Energy Management Systems (HEMS)
	Supervisory Control and Acquisition Data (SCADA)			Demand Response (DR)
		Volt/VAR Control (VVC), Conservation Voltage Reduction (CVR)		Net Metering
		Smart Protection: Predictive (Failure Prediction Algorithms) or Reactive (Fault Detection, Isolation and Restoration, FDIR)		Virtual Power Plant (VPP)
				Demand Forecasting


Technology application Enhance physical network capacity Optimize grid monitoring and control Enable active customer contribution

Note: Numerous technologies have been voluntarily excluded from the scope of this report for reasons of simplification.

Source: A.T. Kearney Energy Transition Institute analysis

FactCard: Advanced Metering Infrastructure (AMI): smart meters and Automated Meter Reading (AMR)


- An Advanced Metering Infrastructure (AMI) consists of a smart meter to read consumption of electricity, and Automated Meter Reading (AMR) to communicate these data to the Distribution System Operator (DSO) via Meter Data Management System (MDMS) in a bi-direction information flow
- Information flow from end-users to the DSO enables:
 - A real-time, non-aggregated knowledge of consumer demand, and of electricity added back to the grid by local producers (net metering)
 - Cheaper reading and more precise control over consumer bills
- Information flow from the DSO to end-users enables:
 - Dynamic demand-response programs via real-time pricing signals
 - Energy consumption visualization through in-house displays
- Perhaps more importantly, AMI could act as edge-of-grid sensors and provide a functioning communication network to enhance performance of Distribution Automation (DA) applications such as voltage control, fault detection, and predictive algorithms (demand forecast, failure prediction)

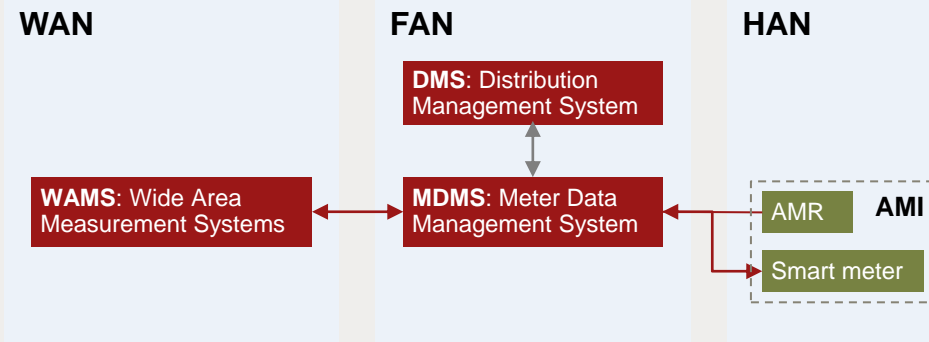

- **Technology:** Electronic device
- **Grid integration:** Consumer's side
- **Communication protocol:**
 - Various protocol are being developed between AMI and MDMS, such as Open Smart Grid Protocol, TCP/IP,...
- **Potential benefits:**
 - Enable dynamic demand-response, net-metering and vehicle-to-grid
 - Enhance distribution automation via volt/VAR control; conservation voltage reduction, fault detection and predictive algorithms


Maturity
Deployment

FactCard: Demand Response (DR)



DR programs enable Distribution System Operators (DSOs) to manage program participants' consumption in response to grid imbalances, primarily during times of peak demand or unexpected drops in supply. End-user Energy Management Systems (EMS) are programmed to alter, at the reception of a trigger signal from the DSO, the demand of smart appliances at residential and commercial sites, or even the demand of electricity-intensive industrial plants that wish to cooperate. The trigger signal depends on the type of demand-response program implemented:

- **Economic demand-response programs** use price or time signals to allow consumers to optimize their electricity bills:
 - Time-of-use signals define fixed prices for peak vs. off-peak periods pre-determined months in advance, without requiring any smart-grid infrastructure
 - Dynamic signals improve DR effectiveness, but require smart meters to receive live control signals from Meter Data Management Systems (MDMS), such as real-time electricity spot-market prices, or the prices of various derivatives
- **Emergency demand-response programs** send signals calculated from both DMS and AMI data in order to force targeted load reductions in case of emergency imbalances. This avoids uncontrolled blackouts, in exchange for a pre-agreed fee (only applies to large load consumers)

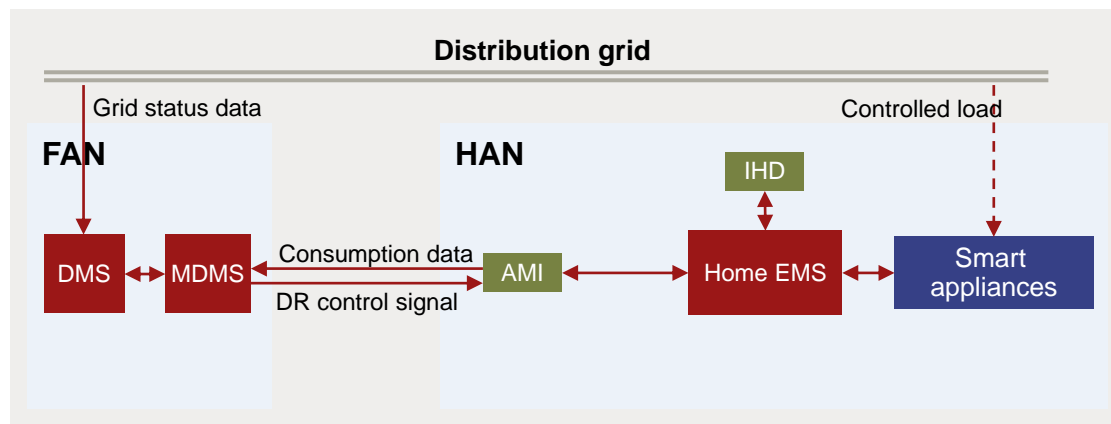


Benefits

- Reduce end-user electricity consumption and electricity bills.
- Provide large customers with remuneration in exchange for their “availability to shut-down”.
- Reduce the need for other flexibility sources (peaking power plants or storage capacity).
- Reduce grid instability in times of system distress.


Effectiveness

- Time-of-use DR is already mature in countries, such as France, where peak-demand periods occur reasonably regularly, because of the high degree of penetration of electrical residential heating.
- Dynamic pricing is at the demonstration stage, with various regional pilot programs showing encouraging results in terms of load reductions. It seems particularly effective when used in conjunction with central air-conditioning and electrically heated water systems.
- Emergency DR is a more mature business model, as it primarily targets a reduced number of large industrial or commercial consumers. As of 2010, 11 GW of capacity had been installed in the U.S.

FactCard: Smart Appliances, In-Home Display (IHD) and Home Energy Management Systems (HEMS)



- **HEMS** receive real-time custom messages from utility companies regarding billing and electricity prices, and are programmed to react to price spikes (or other signals) by ordering smart appliances to modify their electricity consumption, enabling demand-response programs. HEMS can also control residential distributed power generation, storage or electric vehicles, in the same way
- **Smart appliances** are appliances equipped with a *load-control switch* that are able to receive power commands from HEMS. The most common appliances are for heating, ventilating, and air-conditioning (HVAC), electrically heating water, and refrigeration
- **An In-Home Display** (IHD, see picture) communicates with utility smart meters (electric, gas, water) to display information such as electricity consumption and tariffs in real time, raising consumer awareness of electricity demand and control over it

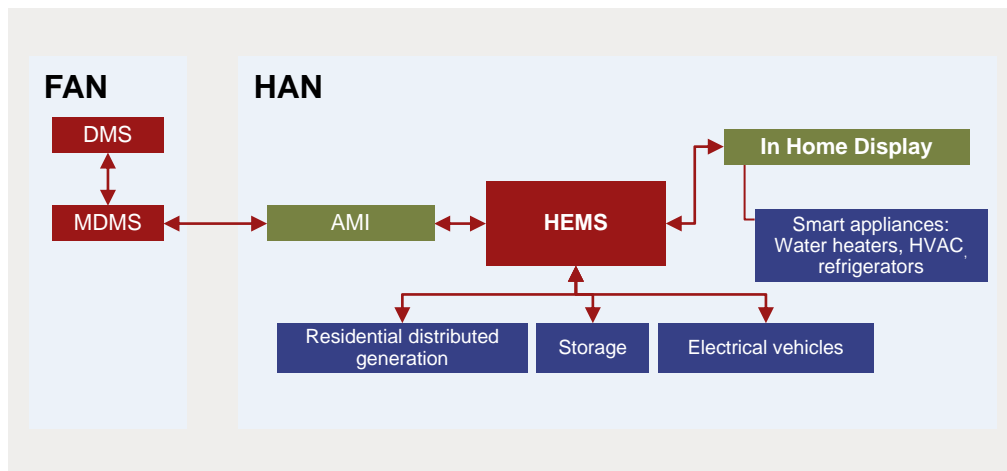

- **Technology type:** Various
- **Grid integration:** Consumer side
- **Communication protocol:**
 - Wireless or Power Line Communication (PLC) within the Home Area Network (HAN)
- **Potential benefits:**
 - Enable demand-response programs
 - Enable integration of distributed generation and storage
 - Raises consumer awareness of their electricity demand
 - Contribute to reduce housing consumption

Maturity
Deployment

FactCard: Net metering and smart inverters


Net metering measures electricity generated locally and fed back into the grid, enabling end-users to contribute to total power supply.

Smart inverters mounted at each local generator automatically reduce output in case of grid oversupply, enabling local producers to contribute more actively to grid management. There are various types of net-metering programs, but only those with dynamic and adaptive signals are considered “smart”:

Conventional (energy-based) net metering gives kWh-credits to end-users when their production exceeds demand (*i.e.* their meters spin backwards). Such credits cannot exceed cumulated energy demand over the billing period.

- **Advanced (price-based) net metering** gives financial credits to end-users when their production exceeds demand, allowing them to receive financial revenues if cumulated supply exceeds demand over the billing period. This can enable a higher penetration of distributed generation and electric vehicles. Such configurations require bi-directional Smart Meters able to read electricity tariffs, calculate compensation credits, and be read remotely. Compensation rates generally depend on the electricity price prevailing at the time the surplus occurred:
 - **Time-of-use net metering** defines fixed rates for peak vs. off-peak periods pre-determined months in advance;
 - **Dynamic pricing net metering** offers variable rates calculated on the basis of real-time electricity prices.
- **Feed-in-tariffs or purchasing agreements** differ from net metering, since they do not subtract physical consumption from production prior to calculating financial compensation. They require two (unidirectional) meters: one records any electricity drawn from the grid and its associated cost, and the other records any electricity generated by the distributed plant and its associated revenues


Smart home with dynamic price net metering and demand response

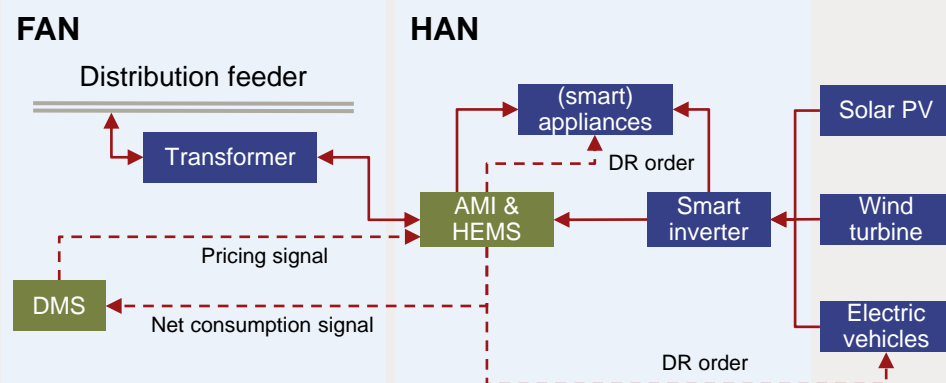


- **Technology:** Electronic device
- **Grid integration:** Consumer side
- **Maturity:** Early deployment
- **Communication protocol:** Quantify production over consumption and communicate with Distribution System Operators (DSO) for credits calculation
- **Potential benefits:**
 - Remote readings
 - Compensation for over-production (feeding the network)
 - Real time metering/monitoring for dynamic actions (e.g. pricing)

Maturity
Deployment

FactCard: Virtual Power Plants (VPP)



- Virtual Power Plants (VPP) correspond to an aggregation of distributed generating end-users (residential, commercial, industrial) that could collectively generate power comparable to that of a centralized power plant. A central controller runs this cluster of dispatched generators, and manages and delivers electricity directly at the distribution level
- VPP clustering differs from individual energy programs (such as dynamic pricing, demand-response, distributed generation), by the depth of its granularity. VPP not only aggregates by type and location, but also by criteria such as topology, customer choices and resources
- With better clustering, utilities can better forecast, analyze and group customer consumption patterns and habits. VPPs are therefore able efficiently to combine physical models (DG, DR) with financial ones (dynamic pricing). The DMS would then execute the right program in order to optimize power flows across the distribution grid (better integration of variable renewables, reductions in peak demand...)
- The concept of VPP is linked to that of *demand-dispatch*, which – unlike *demand-response* – orders increases in supply as well as reductions in load

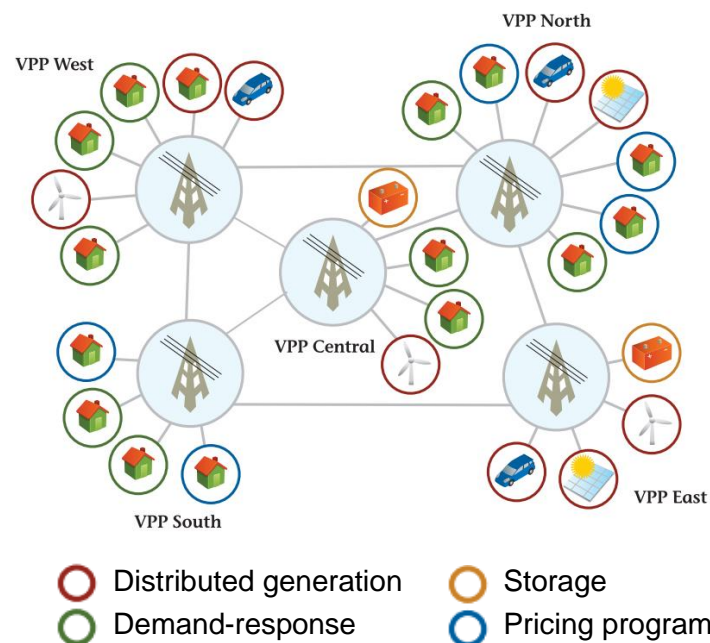


- **Technology:** Energy management system
- **Grid integration:** distribution and consumption side
- **Maturity:** Research & Development
- **Potential benefits:**
 - Pave the way for fully decentralized micro-grids and super-grids

Maturity

R&D

FactCard: Smart Electrical Vehicles (EVs) and Vehicle-to-Grid (V2G)

Different electric vehicles used as transportation and energy storage/source

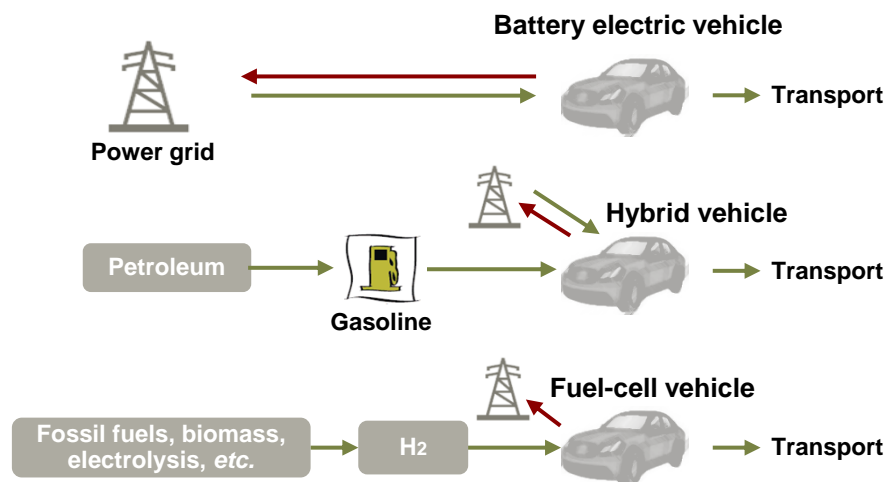

- The vehicle-to-grid technology concept is a version of battery-to-grid power, applied to vehicles. It enables users of electric, hybrid-electric and alternative-fuel vehicles to sell energy stored in vehicles back to the electricity utility
- With a smart grid, utilities can manage when and how EV charging occurs, while adhering to customer preferences. They can also collect EV-specific meter data, apply specific rates for EV charging, engage consumers with information on EV charging, and collect data for greenhouse-gas abatement credits

Cons

- EV charging will have a direct impact on the distribution network, raising the power requirements of a single home with an EV from 30% to more than 200%
- It is likely that many EV owners would plug in their vehicles when they return home each day. In many instances, this would coincide with residential evening-load peak times. Unless consumers are offered opportunities to charge while at work, peak load would rise by 4% in a scenario where EVs represent ~1% of average electricity demand

Pros

- Vehicles are parked, on average, 95% of the time. Energy stored in vehicle batteries could provide operating reserves.
- EVs have a relatively large energy capacity (for instance, the "Tesla model S" has a capacity of 80 kWh, eight times more than the commercialized home energy storage solution "Tesla Powerwall")

Acronyms and bibliography



Acronyms (1/2)

AC/DC	Alternating/Direct Current	FCL	Fault Current Limiter
AMI	Advanced Metering Infrastructure	FDIR	Fault Detection, Isolation and Restoration
AMR	Automatic Meter Reading	FERC	Federal Energy Regulatory Commission
ARRA	American Recovery and Reinvestment Act	GCC	Gulf Cooperation Council
BRICS	Brazil, Russia, India, China and South Africa	GHG	Greenhouse Gas
CAGR	Compound Annual Growth Rate	GIS	Geographic Information System
CAPEX	Capital Expenditure	HAN	Home Area Network
CAIDI	Customer Average Interruption Duration Index	HTSC	High Transmission Superconducting Cables
CAIFI	Customer Average Interruption Duration Index	HVAC	Heating ventilation, and air conditioning
CSP	Concentrated Solar Power	HVDC	High Voltage Direct Current
CVR	Conservation Voltage Reduction	ICT	Information and Communication Technology
DA	Distribution Automation	IEA	International Energy Agency
D&D	Demonstration & Deployment	IEEE	Institute of Electrical and Electronics Engineers
DG	Distributed Generation	IHD	In-Home Displays
DLR	Dynamic Line Rating	ISGAN	International Smart Grid Action Network
DMS	Distribution Management System	ISO	Independent System Operator
DR	Demand Response	IT	Information Technology
DSO	Distribution System Operator	LAN	Local-Area Network
EMF	Electro-magnetic Field	MDMS	Meter Data Management Systems
EMS	Energy Management System	O&M	Operation and Maintenance
EPRI	Electric Power Research Institute	OECD	Organization for Economic Co-operation and Development
ETP	Energy Technology Perspective	OFGEM	Office of Gas and Electricity Markets
EV	Electric Vehicles	OMS	Outage Management System
FACTS	Flexible AC Transmission Systems	OPEX	Operation Expenditure
FAN	Field Area Network	PDC	Phasor Data Concentrator

Acronyms (2/2)

PE	Private Equity
PMU	Phasor Management Unit
PV	Photovoltaic
R&D	Research and Development
RDD&D	Research, Development, Demonstration & Deployment
SAIDI	System Average Interruption Duration Index
SCADA	Supervisory Control & Acquisition Data
SVC	Static VAR Compensator
T&D	Transmission and Distribution
TSO	Transmission System Operator
V2G	Vehicle-to-grid
VC	Venture Capital
VAR	Volt-Ampere Reactive
VPP	Virtual Power Plant
VRE	Variable Renewable Energy
VVC	Volt/VAR control
WAAPCA	Wide-Area Adaptive Protection, Control and Automation
WACC	Weighted Average Cost of Capital
WAMS	Wide Area Monitoring System
WAMC	Wide-Area Monitoring & Control
WAN	Wide Area Network
WASA	Wide-Area Situational Awareness
WMS	Workforce Management System

Bibliography (1/4)

- ABB (2009). *Network Manager SCADA/EMS and SCADA/GMS*. [Link](#)
- ABB. *Overview about FACTS*. [Link](#)
- ABB. *The Classic HVDC Transmission*. [Link](#)
- Adm21.fr. (2015). *Moxa - Connecting to a SCADA System*. [Link](#)
- Aivaliotis, S.K. (2010). *Dynamic Line Ratings for Optimal and Reliable Power Flow*. The Valley Group. [Link](#)
- Amin, M. (2011). *Turning the Tide on Outages*. University of Minnesota. [Link](#)
- Arhgira, N., Ploix, S., Fagarasan, I., Iliescu, S. S. (2013), "Forecasting Energy Consumption in Dwellings". [Link](#)
- ATCO Electric. *AMR, AMI, Smart Meters & Smart Grid*.
- Bloomberg New Energy Finance – BNEF database
- Bloomberg New Energy Finance – BNEF (2013). *The convergence of AMI and distribution automation*
- Bloomberg New Energy Finance – BNEF (2015). *Q1 2015 Global Digital Energy Outlook*;
- Brown, M. H., Sedano, R. P. (2004). *Electricity Transmission, A Primer*. National Council on Electric Policy. [Link](#)
- Campillo, J., Wallin, F., Torstensson, D., Vassileva, I. (2012), "Energy demand model design for forecasting electricity consumption and simulating demand response scenarios in Sweden". [Link](#)
- Clark, M. (2014). *Aging US Power Grid Blacks Out More Than Any Other Developed Nation*. International Business Times. [Link](#)
- Collier, S. (2013). *The Evolution of the Smart Grid*. Institute of Electrical and Electronics Engineers – IEEE. [Link](#)
- A.T. Kearney Energy Transition Institute (2013). *Electricity Storage Factbook*. [Link](#)
- Dombek, C. (2015). *Energy Storage, Dynamic Line Ratings Yield More Efficient Grid*. [Renewableenergyworld.com](#). [Link](#)
- Edison Electric Institute (2010). *RE: Addressing Policy and Logistical Challenges to Smart Grid Implementation*. [Link](#)
- Electric Power Research Institute - EPRI (2011). *Estimating the Costs and Benefits of the Smart Grid*. [Link](#)
- ElMoursi, M. S., Sharaf, A. M. (2004). *Flexible AC Transmission FACTS-Technology and Novel control Strategies for Power System Stability Enhancement*. Electrical and Computer Engineering Department. University of New Brunswick. [Link](#)
- Energy Tariff Expert (2014). *Net Metering in Massachusetts* [Link](#)
- Eurelectric (2011). *Regulation for Smart Grids*. [Link](#)
- European Commission (2013). *Green Paper, A 2030 framework for climate and energy policies*. [Link](#)
- European Commission Joint Research Centre (2014). *Smart Grid Projects Outlook 2014*. [Link](#)

Bibliography (2/4)

- Fairley, P. (2015). *Germany Takes the Lead in HVDC*. Spectrum.ieee.org. [Link](#)
- Fang, X., Misra, S., Xue, G., Yang, D. (2012), "Smart Grid – The new and improved power grid: a survey". IEEE Communications surveys & tutorials, vol. 14, no. 4, fourth quarter 2012. [Link](#)
- Fenrick, S., Macke, R., Getachew, L. *Performance Based Regulation for Electric and Gas Distributors*. Power System Engineering Inc's (PSE). [Link](#)
- Giordano, V., Onyeji, I., Fulli, G., Sánchez Jiménez, M. Filiou, C. (2015). *Guidelines for conducting a cost-benefit analysis of Smart Grid projects*. Ses.jrc.ec.europa.eu. JRC Smart Electricity Systems and Interoperability. [Link](#)
- Federal Energy Regulatory Commission – FERC (2011). *Assessment of Demand Response and Advanced Metering*. [Link](#)
- Hamerly, R. (2015). *Direct Current Transmission Lines*. Large.stanford.edu. [Link](#)
- Hauer, J.F., DeSteele, J.G. (2007). *Descriptive Model of a Generic WAMS*. Pacific Northwest National Laboratory - PNNL. Prepared for U.S. Department of Energy Office of Electricity Delivery and Energy Reliability, under Contract DE-AC05-76RL01830. [Link](#)
- Hidayatullah, N., Paracha, Z., & Kalam, A. (2011). *Impact of Distributed Generation on Smart Grid Transient Stability*. SGRE, 02(02). [Link](#)
- Institute for energy research - IER. *History of electricity*. [Link](#)
- Institute of Electrical and Electronics Engineers - IEEE (2011). *Standard for Synchrophasors for Power Systems*. [Link](#)
- International Energy Agency - IEA (2011). *Harnessing Variable Renewables*. [Link](#)
- International Energy Agency - IEA (2011). *Technology Roadmap, Smart Grids*. [Link](#)
- International Energy Agency - IEA (2012). *Energy Technology Perspectives 2012*. [Link](#)
- International Energy Agency - IEA (2013). *Tracking Clean Energy Progress*. [Link](#)
- International Energy Agency - IEA (2014). *World Energy Investment Outlook*. [Link](#)
- International Energy Agency - IEA (2014). *World Energy Outlook 2014*. [Link](#)
- International Energy Agency - IEA (2015). *Energy Technology Perspectives 2015*. [Link](#)
- International Smart Grid Action Network - ISGAN (2013). *Smart Grid project catalogue: part 2, by contribution to policy goal*. [Link](#)
- Jamasb, T., Pollitt, M. (2000). *Benchmarking and Regulation Of Electricity Transmission and Distribution Utilities Lessons from International Experience*. University Of Cambridge. [Link](#)
- Joskow, P.L., Wolfram, C.D. (2012). *Dynamic Pricing of Electricity*. [Link](#)
- Kaminker, Ch., Stewart, F. (2012). *The Role of Institutional Investors in Financing Clean Energy*. OECD working papers on finance, insurance and private pensions. No. 23. [Link](#)
- Larruskain, D. M., Zamora, I., Mazón, A. J., Abarrategui, O., Monasterio, J. *Transmission and Distribution Networks: AC versus DC*. [Link](#)

Bibliography (3/4)

- Laudani, G. A., Mitcheson, P.D. *Comparison of cost and efficiency of DC versus AC in office buildings*. Imperial College London.
- Massachusetts Institute of Technology - MIT (2011). *The Future of the Electric Grid*. [Link](#)
- Morgan, T. (2012). *Smart Grids and Electric Vehicles: Made for Each Other?*. International Transport Forum, Discussion Paper. [Link](#)
- Motorola (2007). *SCADA Systems*. [Link](#)
- National Grid. *Annual Report and Accounts 2010/11*. [Link](#)
- National Energy Technology Laboratory - NTEL (2011), "Demand Dispatch –Intelligent Demand for a More Efficient Grid". [Link](#)
- National Institute of Standards and Technology - NIST (2012). *Framework and Roadmap for Smart Grid Interoperability Standards*. Release 2.0. [Link](#)
- Navigant Research (2014). Executive Summary: *Smart Grid Technologies*.
- Navigant Research (2013). *Executive Summary: Smart Meters*. Smart Electric Meters, Advanced Metering Infrastructure, and meter Communications: Global Market Analysis and Forecasts, United States.
- Navigant Research (2014). *Global Distributed Generation Deployment Forecast*.
- NERA (2014). *Self-Consumption and Net Balancing: Issues and solutions; EPRG & CEEPR European Energy Policy Conference*.
- Neumann, A. (2007). *Application of fault current limiters*. [London]: BERR.
- Northeast Group (2015). *India Smart Grid: Market Forecast (2015-2025)*. [Link](#)
- NRG Expert (2013). *Electricity T&D white paper*. [Link](#)
- O'Sullivan, N., Kimura, B. *Only Smart Reclosers Build Smart Grids*. [Link](#)
- Pratt, R. G. et al. (2010). *The Smart Grid: An Estimation of the Energy and CO2 Benefits*. Pacific Northwest National Laboratory (PNNL). [Link](#)
- Purchala, K., Belmans, R., Exarchakos, L., Hawkes, A.D. *Distributed generation and the grid integration issues*. Imperial College London.
- Relecura (2013). *Smart Grid Patent Analysis*. INDUS Technology. [Link](#)
- Réseau de Transport d'Electricité, www.rte-france.com/fr/developpement-durable/eco2mix
- Sexauer, J., Javanbakht, J., Mohagheghi, S. (2013). *Phasor Measurement Units for the Distribution Grid: Necessity and Benefits*. - IEEE.
- Shahraeini, M., Javidi, M. H. (2012). *Wide Area Measurement Systems*. Intechopen.com. [Link](#)
- Siemens (2011). *Microgrid white paper*. [Link](#)
- Smart Grid, Smart City (2012). *Smart Grid, Smart City Project*. Monitoring and Measurement Report - report III. Grid Applications Streams: Fault Detection Isolation and Restoration. [Link](#)

Bibliography (4/4)

- Taylor, C. W. (2008). *Voltage Stability for undergraduates*. University of Minnesota Power Group. [Link](#)
- The World Bank.
- Ton, D. (2011). *Smart Grid R&D at the U.S. Department of Energy*. U.S. Department of Energy - Office of Electricity Delivery and Energy Reliability. Presented at the ONRL Sustainable Summit. [Link](#)
- U.S. Department of Energy (2013). *Syncrophasor Technologies and Their Deployment*. American Recovery and Reinvestment Act of 2009. [Link](#)
- U.S. Department of Energy (2013). *Economic Impact of Recovery Act Investments in the Smart Grid*. Electricity Delivery & Energy Reliability. Smart Grid Investments Grant Program. [Link](#)
- U.S. Department of Energy (2013). *Smart Grid Investment Grant Program*. American Recovery and Reinvestment Act of 2009. Progress Report II. [Link](#)
- U.S. Department of Energy, Office of Electricity Delivery and Energy Reliability. [Link](#)
- U.S. Department of Energy (2009), Office of Electricity Delivery and Energy Reliability (2009). *Fault Current Limiters Factsheet*. [Link](#)
- U.S. Department of Energy. *The Smart Grid - An introduction*. [Link](#)
- Uluski, B. 2011. *Volt/VAR Control and Optimization Concepts and Issues*. Electric Power Research Institute – EPRI. [Link](#)
- Vittal, V. (2003). *Transient Stability and control of large scale power system*. Power Systems Engineering Research Center. Iowa State University. [Link](#)
- Warner, K., Willoughby, R. (2013). *Conservation Voltage Reduction: An Energy Efficiency Resource*. Institute of Electrical and Electronics Engineers - IEEE Smart Grid. [Link](#)
- Weedy, B.M. (1972). *Electric Power Systems*.
- Williamson, C. (2012), *OG&E Smart Study Together Impact Result*. Final Report - Summer 2011. 1299-02. Global Energy Partners. [Link](#)
- World Energy Council (2012). *Smart Grids best practices fundamentals for a modern energy system*. [Link](#)
- Wright, A. (2012). *Ofgem's response to DECC's Consultation on the Draft DCC Licence and Licence Application Regulations*. The Office of Gas and Electricity Markets – Ofgem. [Link](#)
- Zhang, Y. (2012). *State of the Art of Fault Current Limiters and Their Applications in Smart Grid*. University of South Carolina. DOI: 10.1109/PESGM.2012.6344649 Conference: Power and Energy Society General Meeting, 2012 IEEE
- Zurboarg, A. (2010). *Unlocking Customer Value: The Virtual Power Plant*. Word Power. Virtual Power plants. [Link](#)

Picture Credits

Slide 5: (clockwise, from top left corner): 1st: General Electric ([link](#)); 6th ourpowercampaign.org ([link](#)); 7th BC Hydro Smart Meter; 8th British Gas; 10th sustainablecitynetwork.com; 14th LNNL ([link](#))

Slide 10: Foolcdn.com; National Geographic; H2heuro.org; Forbesimg.com

Slide 12: Bryan Christie Design

Slide 14: NASA

Slide 18: U.S. Department of Energy

Slide 33: ourpowercampaign.org ([link](#))

Slide 34: cleanskies.org; prcee.org; sustainablecitynetwork.com

Slide 44: The Hindu (newspaper, online); Wikipedia (online)

Slide 78: ABB, HVDC light cable cross section; Siemens, HVDC power transformer on the Australia – Tasmania cable

Slide 79: ONRL ([link](#))

Slide 80: PACWorld & Ceati

Slide 81: Cgsdigital.com

Slide 82: ABB, SVC (FACTS) installation at the Parkdale substation

Slide 83: Electric-motor-dealers ([link](#))

Slide 84: wiki.powerdistributionresearch.com ([link](#)); ABB DistribuSense current and voltage sensors

Slide 87: Institute Mihailo Pupin “SCADA system at a control center”;

Slide 89: electricenergyonline.com: “How SMUD Deals with Big Data: Correlate, Analyze and Visualize It”

Slide 90: General Electric ([link](#))

Slide 91: Smart Grid Network, Vacuum Switch ([link](#))

Slide 94: BC Hydro Smart Meter

Slide 96: British Gas

Slide 98: Zurboarg (2010), “Unlocking Customer Value: The Virtual Power Plant”

The A.T. Kearney Energy Transition Institute is a nonprofit organization. It provides leading insights on global trends in energy transition, technologies, and strategic implications for private sector businesses and public sector institutions. The Institute is dedicated to combining objective technological insights with economical perspectives to define the consequences and opportunities for decision makers in a rapidly changing energy landscape. The independence of the Institute fosters unbiased primary insights and the ability to co-create new ideas with interested sponsors and relevant stakeholders.

For further information about the A.T. Kearney Energy Transition Institute and possible ways of collaboration, please visit www.energy-transition-institute.com, or contact us at contact@energy-transition-institute.com.

Permission is hereby granted to reproduce and distribute copies of this work for personal or nonprofit educational purposes. Any copy or extract has to refer to the copyright of the A.T. Kearney Energy Transition Institute.